

FINAL REPORT

RAPID ENERGY MODELING WORKFLOW DEMONSTRATION

ESTCP Project EW-201259

OCTOBER 2013

John Sullivan
Jennifer Rupnow
Vincent Corsello
Autodesk, Inc.

Distribution Statement A

This document has been cleared for public release



REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing this collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. **PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.**

| | | | | | | |
|---|-------------------------|---------------------------------------|--|--|--|--|
| 1. REPORT DATE (DD-MM-YYYY) 31-10-2013 | | 2. REPORT TYPE Final Report | | 3. DATES COVERED (From - To) Aug. 2012 - Oct. 2013 | | |
| 4. TITLE AND SUBTITLE RAPID ENERGY MODELING WORKFLOW DEMONSTRATION PROJECT | | | | 5a. CONTRACT NUMBER W912HQ-12-C-0071 | | |
| | | | | 5b. GRANT NUMBER NA | | |
| | | | | 5c. PROGRAM ELEMENT NUMBER NA | | |
| 6. AUTHOR(S) Jennifer Rupnow John Sullivan | | | | 5d. PROJECT NUMBER EW-201259 | | |
| | | | | 5e. TASK NUMBER NA | | |
| | | | | 5f. WORK UNIT NUMBER NA | | |
| 7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) Autodesk, Inc. 111 McInnis Parkway San Rafael, CA 94903 | | | | 8. PERFORMING ORGANIZATION REPORT NUMBER NA | | |
| 9. SPONSORING / MONITORING AGENCY NAME(S) AND ADDRESS(ES) ESTCP PROGRAM OFFICE 4800 MARK CENTER DRIVE, SUITE 17D08 ALEXANDRIA VA 22350-3600 | | | | 10. SPONSOR/MONITOR'S ACRONYM(S) ESTCP | | |
| | | | | 11. SPONSOR/MONITOR'S REPORT NUMBER(S) NA | | |
| 12. DISTRIBUTION / AVAILABILITY STATEMENT | | | | | | |
| 13. SUPPLEMENTARY NOTES | | | | | | |
| 14. ABSTRACT The DoD has a critical need to evaluate energy consumption of existing facilities. To address this need Rapid Energy Modeling (REM) methodology was deployed. The workflow captures and information on operations and geometry of a building, generates a 3D building model and then simulates energy use patterns and reports on energy conservation measures. REM was applied to a sample of 23 DoD buildings. The simulated and actual building energy data was analyzed by energy type (electricity and natural gas) and energy use intensity (EUI). | | | | | | |
| 15. SUBJECT TERMS Rapid Energy Modeling | | | | | | |
| 16. SECURITY CLASSIFICATION OF: U | | | 17. LIMITATION OF ABSTRACT SAR | 18. NUMBER OF PAGES 135 | 19a. NAME OF RESPONSIBLE PERSON Vincent Corsello | |
| a. REPORT U | b. ABSTRACT U | c. THIS PAGE U | | | 19b. TELEPHONE NUMBER (include area code) 312-502-2249 | |

Standard Form 298 (Rev. 8-98)
Prescribed by ANSI Std. Z39.18

Table of Contents

| | |
|--|-----------|
| Acknowledgments | vii |
| Acronyms and Definitions | viii |
| EXECUTIVE SUMMARY | 2 |
| 1.0 INTRODUCTION..... | 5 |
| 1.1 BACKGROUND..... | 5 |
| 1.2 OBJECTIVE OF THE DEMONSTRATION | 6 |
| 1.3 REGULATORY DRIVERS..... | 6 |
| 2.0 TECHNOLOGY DESCRIPTION..... | 7 |
| 2.1 TECHNOLOGY OVERVIEW | 7 |
| 2.2 TECHNOLOGY DEVELOPMENT | 8 |
| 2.3 ADVANTAGES AND LIMITATIONS OF THE TECHNOLOGY | 10 |
| 3.0 PERFORMANCE OBJECTIVES..... | 11 |
| 3.1 QUANTITATIVE PERFORMANCE OBJECTIVES..... | 13 |
| 3.2 QUALITATIVE PERFORMANCE OBJECTIVES..... | 16 |
| 4.0 FACILITY/SITE DESCRIPTION | 16 |
| 4.1 FACILITY/SITE LOCATION AND OPERATIONS | 16 |
| 4.2 FACILITY/SITE CONDITIONS..... | 18 |
| 5.0 TEST DESIGN..... | 20 |
| 5.1 CONCEPTUAL TEST DESIGN | 20 |
| 5.2 BASELINE CHARACTERIZATION | 21 |
| 5.3 DESIGN AND LAYOUT OF TECHNOLOGY COMPONENTS..... | 22 |
| 5.4 OPERATIONAL TESTING | 29 |
| 5.5 SAMPLING PROTOCOL | 32 |
| 5.6 SAMPLING RESULTS | 33 |
| 6.0 PERFORMANCE ASSESSMENT..... | 37 |
| 6.1 OVERALL CORRELATION OF MODELED RESULTS TO METER DATA..... | 37 |
| 6.2 VARIANCE IN MONTHLY CONSUMPTION (BILLING HISTORY)..... | 64 |
| 6.3 TESTING THE REM PROCESS FOR DESIGN ALTERNATIVES TO MODEL POTENTIAL ENERGY SAVINGS | 65 |
| 6.4 TIME AND COST TO ENERGY MODEL | 79 |
| 6.5 QUALITATIVE PERFORMANCE OBJECTIVES..... | 81 |
| 6.6 PERFORMANCE OBJECTIVE CONCLUSIONS..... | 85 |
| 7.0 COST ASSESSMENT | 85 |

| | |
|--|------------|
| 7.1 COST MODEL | 86 |
| 7.2 COST DRIVERS | 88 |
| 7.3 COST ANALYSIS AND COMPARISON..... | 88 |
| 8.0 IMPLEMENTATION ISSUES | 90 |
| 8.1 METER DATA COMPARISONS | 90 |
| 8.2 SITE SELECTION AND DATA GATHERING | 91 |
| 8.3 ANALYTICAL MODELING | 92 |
| 9.0 FUTURE OF RAPID ENERGY MODELING | 94 |
| 10.0 REFERENCES..... | 95 |
| | |
| Appendix A: Points of Contact | 96 |
| Appendix B: Summary Data- All Viable Buildings: Offices, Barracks, Specialty Use, Combined..... | 98 |
| Appendix C. Buildings Excluded from Core Analyses..... | 100 |
| Appendix D: Issues Identified with Meter Data at Individual Buildings | 101 |
| Appendix E: Modeled End Use Breakdowns and Potential Energy Savings Charts | 103 |
| Appendix F: Building Feature Design Options within Automatic PES Analysis | 126 |

Figures

| | |
|--|----|
| Figure 1-Schematic Workflow of REM Process | 4 |
| Figure 2-REM Technology Components..... | 8 |
| Figure 3-Site Locations..... | 19 |
| Figure 4-Visual Depiction of Technology Components..... | 23 |
| Figure 5-Visual Depiction of DoD Technical Workflow | 24 |
| Figure 6-FormIt Model Creation | 25 |
| Figure 7-Energy Settings with REM tools..... | 26 |
| Figure 8-Satellite Image Import..... | 27 |
| Figure 9-Bing Birdseye Image..... | 27 |
| Figure 10-Energy End Use Chart Example from Green Building Studio | 28 |
| Figure 11-Potential Energy Savings Analysis | 28 |
| Figure 12-Operational Phases | 30 |
| Figure 13-Dates and Duration of Operations..... | 31 |
| Figure 14-Example Report Content from REM Process | 34 |
| Figure 15-ECM Dashboard Listing | 34 |
| Figure 16-Annual End Use Chart | 34 |
| Figure 17-REM Analysis Charts..... | 35 |
| Figure 18-Comparison of Absolute Error Percentages Across Buildings | 39 |
| Figure 19-Comparison of Meter and Model Data in Relative kBtu/ ft ² | 40 |
| Figure 20-Comparison of Meter and Model Data in Relative kBtu/ ft ² | 40 |
| Figure 21-Percent Deviation - Model vs. Meter Data (Offices) | 42 |
| Figure 22-Monthly Natural Gas and Electric Charts - Offices | 44 |
| Figure 23-Comparison of Office Meter and Model Data to CBECS..... | 49 |
| Figure 24-Percent Deviation - Model vs. Metered Electric, Natural Gas and EUI for Barracks . | 51 |
| Figure 25-Dorm 484 Panama City, Florida - Electric and Natural Gas Data | 52 |
| Figure 26-Dorm 373 Portsmouth Naval Base – Electric and Natural Gas Data..... | 53 |
| Figure 27-Dorm 831 Fort Leonard Wood - Electrical and Natural Gas Data | 54 |
| Figure 28-Dorm 937 Fort Leonard Wood- Electrical and Natural Gas Data | 55 |
| Figure 29-Dorm 9136 Joint Base Lewis McChord - Electric and Natural Gas Data | 56 |
| Figure 30-Comparisons of Meter and Model EUI to CBECS for Barracks | 57 |
| Figure 31-Mean Absolute Error in Specialty Use Buildings | 58 |
| Figure 32-Cafeteria 3650, Seymour Air Force Base | 60 |
| Figure 33-School Building 4103, Seymour Air Force Base | 61 |
| Figure 34-Automotive Facility 4537, Seymour Air Force Base..... | 61 |
| Figure 35-Gym Building 640, Fort Leonard Wood..... | 62 |
| Figure 36-Comparisons of Meter and Model EUI to CBECS for Specialty Use Buildings..... | 63 |
| Figure 37-Potential Energy Savings Chart for CERL Building 2..... | 66 |
| Figure 38-Basic Package Upgrades for CERL B2..... | 66 |
| Figure 39-Advanced Package Upgrades for CERL B3 | 67 |
| Figure 40-Potential Energy Savings Chart for Building 1 – Peterson AFB | 69 |
| Figure 41-Basic Package Design Alternative Measures | 69 |
| Figure 42-Advanced Package Design Alternative Measures..... | 70 |
| Figure 43-Potential Energy Savings for Fort Leonard Wood – Building 470..... | 72 |
| Figure 44-Basic Package Improvements – Building 470 | 73 |

| | |
|--|----|
| Figure 45-Moderate Package Improvements– Building 470 | 73 |
| Figure 46-Advanced Package Improvements– Building 470 | 73 |
| Figure 47-Potential Energy Savings Chart for Peterson B 350 | 75 |
| Figure 48-Basic Package Improvements B350..... | 75 |
| Figure 49-Potential Energy Savings Chart for Seymour AFB Building 4601 | 77 |
| Figure 50-Basic Package Improvements – Building 4601 | 77 |
| Figure 51-Advanced Package Improvements – Building 4601 | 77 |
| Figure 52-Building Model | 79 |
| Figure 53-Peterson Air Force Base Concept - Installation Wide Energy Model | 94 |

Tables

| | |
|--|----|
| Table 1-Performance Objectives..... | 11 |
| Table 2-Typical Mean Absolute Percentage Error Values for Model Evaluation..... | 14 |
| Table 3-Site Information..... | 19 |
| Table 4-Test Phases | 20 |
| Table 5-Sampling Parameters and Types | 32 |
| Table 6-Summary Info on Data Collected | 33 |
| Table 7-Summary Data for All Analyzed Buildings (n=23) (<i>See also Appendix B</i>)..... | 39 |
| Table 8-Office Buildings - Photos | 41 |
| Table 9-Summary Data for Offices..... | 43 |
| Table 10-Comparison of Office Meter and Model Data to CBECS | 48 |
| Table 11-Barracks Buildings - Photos | 50 |
| Table 12-Summary Data for Barracks | 51 |
| Table 13-Specialty Use Buildings - Photos | 58 |
| Table 14-Summary Data for Specialty Use Buildings..... | 59 |
| Table 15-CVRMSE Data | 64 |
| Table 16-Design Alternatives Packages for Energy Savings – CERL B2..... | 68 |
| Table 17-Design Alternatives Packages for Energy Savings – Peterson B1 | 71 |
| Table 18-Design Alternatives Packages for Energy Savings – Fort Leonard Wood, B470..... | 74 |
| Table 19-Design Alternatives Packages for Energy Savings – Peterson AFB, Building 350..... | 76 |
| Table 20-Design Alternatives Packages for Energy Savings– Seymour AFB Building 4601 | 78 |
| Table 21-Comparison of REM and Level 2 Cost and Time Savings | 81 |
| Table 22-Comparison of Technologies Used | 82 |
| Table 23-REM Cost Model..... | 86 |
| Table 24-DoD Enterprise Wide Life Cycle Cost for REM Components | 89 |

Acknowledgments

This work was performed under the project EW-201259, administered by the ESTCP (Environmental Security Technology Certification Program) technology program of the Department of Defense.

The team and authors gratefully acknowledge the financial support and technical guidance provided by the ESTCP Office under the leadership of Dr. Jim Galvin. The team is very thankful to the support provided by various DoD Installations that supplied information and coordination assistance for the project, including staff at Port Hueneme, Joint Base Lewis McChord, Peterson AFB, Seymour AFB, Fort Leonard Wood, Naval Station Great Lakes, Portsmouth Naval Shipyard, Panama City Naval Weapons Station, Earle Naval Weapons Station and ERDC-CERL.

Acronyms and Definitions

| | |
|-----------------|--|
| 3D | Three-dimensional |
| ASHRAE | American Society of Heating, Refrigerating and Air Conditioning Engineers |
| BIM | Building Information Modeling |
| BPA | Building Performance Analysis |
| BTU | British Thermal Unit |
| CBECS | Commercial Building Energy Consumption Survey |
| CoV | Coefficient of Variation |
| CVRMSE | Coefficient of Variation of the Root Mean Square Error |
| DoD | Department of Defense |
| DOE-2.2 | Department of Energy-2.2-the simulation engine contained within Autodesk Green Building Studio |
| ERDC-CERL | Engineer Research and Development Center, Construction Engineering Research Laboratory of the US Army Corps of Engineers |
| ECM | Energy Conservation Measures |
| EPD | Equipment Power Density |
| EUI | Energy Use Intensity |
| FM | Facilities Management |
| ft ² | Square foot or square feet |
| GBS | Green Building Studio, Autodesk service for energy analysis |
| GSA | General Services Administration |
| GSF | Gross Square Foot |
| kBtu | Thousand British Thermal Units |
| kWh | Kilowatt hours |
| LPD | Lighting Power Density |
| MAPE | Mean Absolute Percentage Error |
| MBE | Mean Bias Error |
| MMBtu | Million British Thermal Units |
| MEP | Design disciplines of Mechanical, Electrical and Plumbing engineering. |
| MFE | Mean Forecasting Error |
| O&M | Operations and Maintenance |
| PES | Potential Energy Savings |
| POC | Point of Contact |
| REM | Rapid Energy Modeling |
| STDEV | Standard Deviation |
| USACE | The United States Army Corps of Engineers |
| VA | The United States Department of Veterans Affairs |

EXECUTIVE SUMMARY

The Department of Defense (DoD) energy success is measured against mandated goals for energy reduction and sustainable facility management. In order to make consistent and well-informed decisions across its entire portfolio of buildings, DoD has a critical need for a consistent, scalable approach to evaluating energy consumption of existing facilities, to compare tradeoffs between energy conservation measures, and to identify facilities that are in greatest need of improvement.

In the last several years, it has become increasingly evident that existing methods of simulating and estimating energy use in buildings require highly trained engineers to spend significant time constructing energy analysis simulations. Shortcomings of past approaches included labor-intensive data inputs, the need for subject matter experts to operate the modeling systems, and the inability to model the DoD building inventory in a timely or cost effective way. Autodesk began looking at ways to combine various data collection methods, best practices and software tools to address this problem, and the idea of Rapid Energy Modeling (REM) was conceived.

Overall, the goal of the demonstration was to evaluate REM workflows and performance by comparing simulated to actual building energy consumption and investigate the scalability of REM workflows for the DoD. This project demonstrated that the REM workflow quickly captures and utilizes information on operations, geometry, orientation, weather, and materials, generates 3D Building Information Models (BIM) guided by satellite views of building footprints and simulates energy use patterns. In addition, the project demonstrated the application of simulated Energy Conservation Measures (ECMs) on a subset population of buildings to understand effective ways to reduce their energy consumption. The REM technology including the ECM capabilities uses whole-building energy simulation algorithms driven by the DOE-2.2 engine for energy analysis (Figure 1).

REM was applied to a sample of 23 DoD buildings across 8 locations and representing 7 building types. The simulated and actual building energy data was analyzed by energy type (electricity and natural gas) and energy use intensity (EUI) and further segregated by building type. The results show that the models for offices and specialty use buildings performed better than models for barracks, where variable occupancy did not match model assumptions.

Quantitatively, a primary performance objective was to have REM electric and natural gas estimates come within $\leq 10\%$ of actual utility information (90% average accuracy). Aggregate results indicate average accuracy of 81.88% for predicting electric consumption with a mean absolute percentage error of 18.12% (Table 7), considered to be a good forecast according to published criteria (Lewis 1982). Natural gas and combined EUI predictions were on average 58.20% accurate and 77.56% accurate respectively, considered reasonably accurate (Table 2). The demonstration produced margins that while outside the target range, were still within the range of useful forecasting values (Table 2), with strong correlations in energy use curves for many buildings.

Qualitatively, the training completed to date indicates that the project meets the performance objectives showing that DoD participants can learn the workflow and begin creating and analyzing using REM in less than one day. Participants also indicate a high level of satisfaction with the REM workflow. Preliminary results indicate that energy models can be completed in less than 3 hours after the process is learned (the performance objective was 2 days).


A significant number of considerations were uncovered that help guide the refinement of the REM process in the future, including data gathering and model sensitivity. Additionally, the quality of the DoD building meter data was not as high as expected before the start of this project and as a result, there may be discrepancies in comparison of simulations to the meter data.

While the REM process and reports do not mirror traditional audits, the workflow has potential benefits in that it can be implemented by DoD personnel directly. It is difficult to do a direct comparison to cost or time savings with traditional audits as there is not complete overlap in capabilities, but results indicate that REM can yield >90% savings in time and cost compared to traditional ASHRAE Level 2 auditing approaches, with the added benefits of computer simulation characteristic of Level 3 audits. REM analysis can be completed in less than one hour, with up to two additional hours that may be required for data collection. The modeling process requires minimal training or expertise and has been taught to DoD staff in less than one day during this demonstration project.

The results of this study indicate that REM can scale to help meet the need for EISA 2007 data reporting requirements as well as support government policy including Executive Order 13423. REM provides the DoD with a way to quickly establish building geometry, scale energy analysis of the existing building portfolio, visualize end-use breakdowns of energy consumption, compare tradeoffs and potential energy savings between energy conservation measures automatically, identify facilities that are in greatest need of improvement, and enhance scalability of energy evaluations and retrofits.

| Quantitative Benefits | Average Accuracy Comparison to Historic Utility Information |
|--|---|
| EUI Electric Average | 81.88% |
| EUI Natural Gas Average | 58.20% |
| Combined Energy Use Intensity Average | 77.56% |
| Application of Design Alternatives to Model Potential Energy Savings | Energy savings greater than 30% achieved on 3 out of 5 buildings. |
| Time and Cost to Create Energy models | Cost savings of over 95% and Time savings of 90-95% compared to ASHRAE Level 2 audit |
| | |
| Qualitative Benefits | End User Effort |
| Ease of Learning REM Process | Less than one day |
| Effort to Create a Rapid Energy Model | 3 hours per building with added benefit of auto-generation of multiple simulations to explore and prioritize ECMs |

Figure 1-Schematic Workflow of REM Process

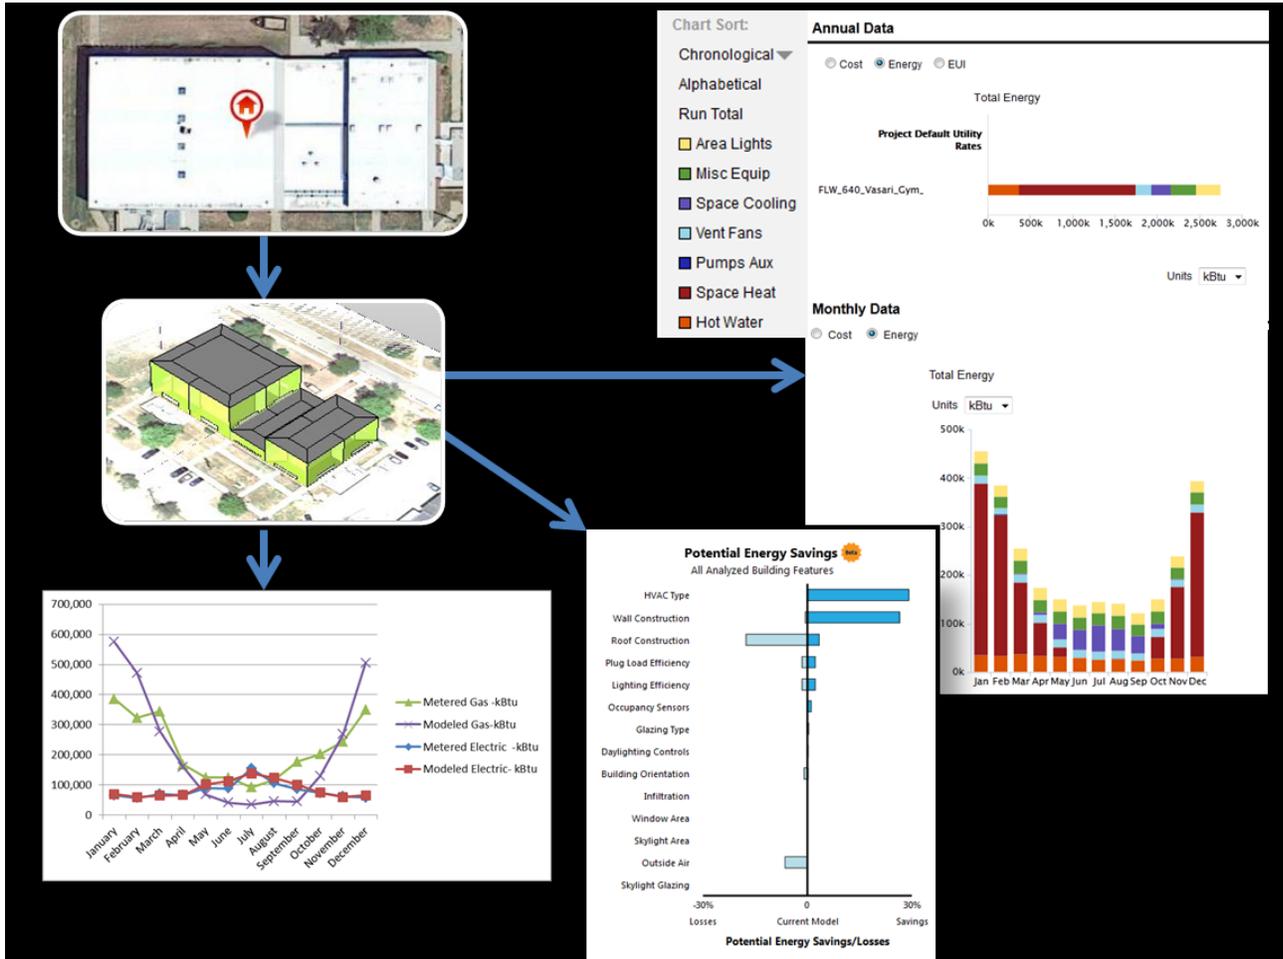

The REM Workflow (from top left): Capture Satellite Image, Generate Geometry Model, Produce Analytical Reports

1.0 INTRODUCTION

1.1 BACKGROUND

Current building energy assessment methods for existing buildings are expensive, laborious, time consuming and require a high level of technical sophistication, experience and expertise that takes years to establish. In short, typical building energy assessment methods are not scalable across a large number of buildings.

The energy consumed by facilities owned and operated by the U.S. Department of Defense accounts for approximately 80% of the total energy used by Federal buildings (DoD, 2005). However, determining information about the energy use on military bases is challenging, as buildings have historically not been metered individually. Due to data quality issues and lack of access to information, facility managers or resource efficiency managers have difficulty managing their building energy footprints and prioritizing their energy retrofit budgets effectively.

The Department of Defense (DoD) energy success is measured against mandated goals for energy reduction and sustainable facility management. In order to make consistent and well-informed decisions across its entire portfolio of buildings, DoD has a critical need for a consistent, scalable approach for evaluating energy consumption of existing facilities, to compare tradeoffs between energy conservation measures, and to identify facilities that are in greatest need of improvement.

Evaluation of baseline energy use and identification of opportunities for improved building performance are top priorities for decreasing carbon emissions, reducing energy costs and enhancing energy efficiency. Additionally, energy security and regulatory mandates are key drivers of energy efficiency retrofits across the DoD. Typical approaches for rapidly assessing and benchmarking energy usage and evaluating proposed energy retrofit measures are not precise and often fail to acknowledge the complexity of buildings and building performance. Interrelated factors, such as building orientation, location, operational use, and structural idiosyncrasies can all influence energy use and the effectiveness of retrofit decisions on reducing energy usage and energy costs. More comprehensive energy auditing techniques, such as ASHRAE level audits are costly, time-intensive and require a high level of expertise.

To address these challenges, Autodesk executed a demonstration of Rapid Energy Modeling (REM) workflows that employed building information modeling (BIM) approaches and conceptual energy analysis. The project investigated the hypothesis that REM is a viable and scalable method for generating accurate, rapid and cost-effective estimates of energy consumption for DoD buildings. The demonstration was a pilot-scale operation over a one-year period using a population of 35 buildings and an analyzed sample of 23 buildings.

The benefit of this technology is that it puts a viable building energy assessment method in the hands of DoD installations. On-site personnel can reasonably learn and use this approach to prioritize the energy management decisions needed at their installation. This technology can dramatically decrease the time it takes to understand the energy performance of DoD buildings.

1.2 OBJECTIVE OF THE DEMONSTRATION

The project's objective was to investigate REM to determine if the workflow is capable of producing useful, rapid and cost-effective estimates of energy consumption for DoD buildings. REM would then provide the DoD numerous benefits, including the ability to prioritize energy efficiency retrofit projects, track energy use reductions, and manage facilities in new and cost-effective ways.

The overarching objective of the field demonstration was to provide lightweight Building Information Models (BIMs) and an easily scalable REM methodology for estimating energy intensity in DoD buildings, identifying buildings that would be most responsive to improvements and exploring various Energy Conservation Measures (ECMs) for buildings. The motivation is to provide the DoD with an enhanced understanding of how to utilize the REM technology to help the DoD meet federal mandates, reduce costs and increase energy security.

The technology demonstrated included a workflow for creating digital, 3D models of buildings from publicly available satellite or aerial imagery. The process captures existing building geometry, appends operational characteristics as well as local weather data to generate 3D models to estimate the energy use of the modeled buildings. A subset of buildings in this study also demonstrated the technology to apply energy conservation measures (ECMs) to the REM models to provide recommendations on ways to improve the energy performance of the studied buildings.

The research objectives in this demonstration include a comparison of the REM generated energy use simulations to historical metered data. This validation was carried out to provide confidence in the REM methodology. Also validated are the time and cost to produce results with this REM approach as well a comparison of cost requirements for other approaches such as energy auditing. In addition, this demonstration validated the acceptance and use of the REM technology by DoD personnel at installations.

1.3 REGULATORY DRIVERS

The following existing or anticipated federal, state, or local regulations or DoD directives have resulted in a need for a new technology such as REM:

- *Energy Policy Act (2005)* - Requires that “*all federal buildings shall, for the purposes of efficient use of energy and reduction in the cost of electricity used in such buildings be metered ... to the maximum extent practicable.*” While this mandate has stimulated meter installation on some large existing buildings and newly constructed buildings, the majority of installation buildings are still without individual meters due to cost-effectiveness barriers. Additionally, the Office of the Secretary of Defense has established that only buildings with an estimated electrical usage of at least \$35,000 annually are practical / cost effectiveness to meter (DoD, 2005). Without knowledge of baseline energy use in individual buildings, it is difficult to determine which buildings to meter or to evaluate energy conservation measures. REM processes can help the DoD evaluate and benchmark energy utilization in buildings, assist in determining which buildings are practical to meter, identify buildings with meters that are not functioning

well, identify poorly performing buildings and provide the tools to evaluate measures to improve energy efficiency and enhance energy security.

- *Energy Independence and Security Act of 2007 (EISA 2007)* - Sets a target for the government to reduce its energy and other resource consumption by 30 percent by 2015 compared to a 2003 baseline. Additionally, EISA calls for energy and water audits for 25% of facilities annually and all appropriate facilities on a four-year cycle. ^(AEMR, 2010) Using REM processes, the project team conducted rapid audits of DoD buildings and investigated energy conservation measures to achieve reductions in energy use on a subset of five buildings.
- *Executive Order 13423 Strengthening Federal Environmental, Energy, and Transportation Management (2007)* - Encourages continuous improvement in the areas of energy efficiency, renewable energy, water conservation and sustainable building. Models produced through the REM process can be updated and accessed continually, thus allowing energy managers to continuously explore improvements in efficiency and opportunities for renewable energy production.
- *Guiding Principles for Federal Leadership in High Performance and Sustainable Buildings*- Calls for 30 % reduction in energy costs for new construction and 20% reduction in major renovations. REM processes can be used to investigate renovations to meet these energy cost reduction targets and provide a higher level of customization than benchmarking without the time and cost associated with ASHRAE or investment-grade energy audits.

2.0 TECHNOLOGY DESCRIPTION

2.1 TECHNOLOGY OVERVIEW


The demonstration defines a process to capture existing building geometry using satellite photos. The operational characteristics of the building are appended to the geometric model and local weather data to generate energy models that can quickly predict the energy use of the modeled buildings. This information can help asset managers determine which buildings are performing poorly compared to predicted energy use.

The REM process involves the following technologies (Figure 2):

- Autodesk® FormIt software is an iOS and Android operating system application to create 3D models. FormIt captures existing building conditions using satellite images from Google and allows users to create a 3D geo-referenced building model while in the field.
- Autodesk® Revit is a Building Information Modeling (BIM) software application with integrated energy and carbon analyses driven by Green Building Studio and DOE 2.2.
- Autodesk® Vasari software is for creating building conceptual models, with integrated energy and carbon analyses driven by Green Building Studio and DOE 2.2.
- Autodesk® Green Building Studio is a web service that performs whole building energy analysis using the DOE-2.2 engine.

The REM workflow involves three stages involving (1) capture of existing conditions, (2) conceptual modeling of building masses using FormIt, Revit and Vasari, and (3) comparative analysis. The energy results of these building analyses are represented as annual energy use for natural gas and electric, monthly and annual cost, monthly energy use and energy use intensity (Figure 2).

Figure 2-REM Technology Components

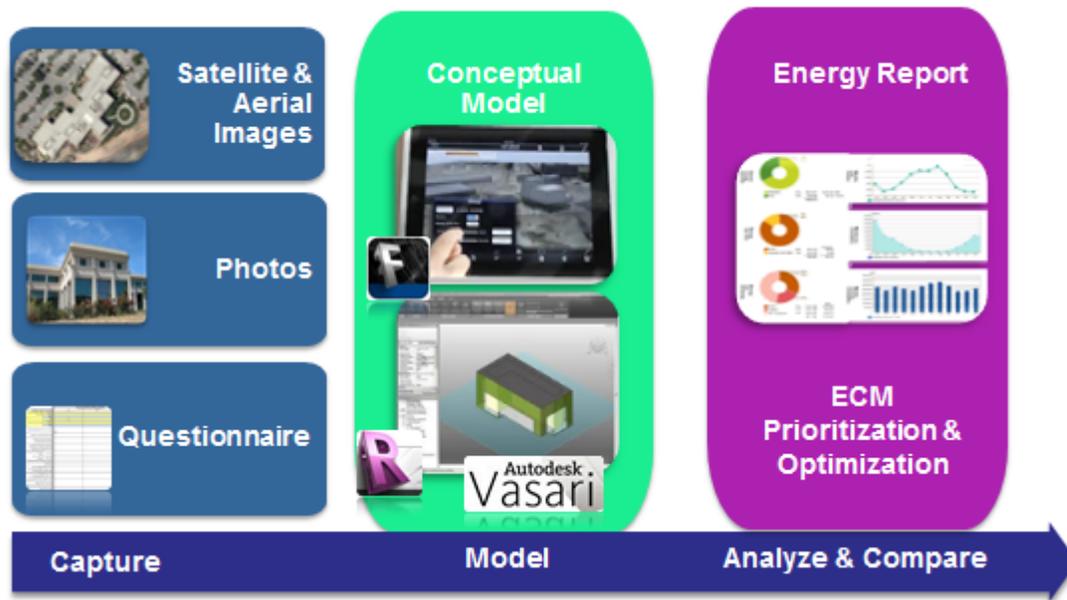

2.2 TECHNOLOGY DEVELOPMENT

REM began as an idea generated by the Autodesk Sustainability Solutions Team. As early as 2009, [a concept paper](#) was written by Autodesk and ICF International defining what could be done with the then current software technologies to provide a less resource intensive way to understand, analyze, and estimate building energy consumption. It is here that the connection of the public satellite imagery to lightweight 3D models to whole building energy analysis is considered; resulting in a new combinational use of these technologies.

That report summarized the results of an in-house experiment at Autodesk, where Autodesk products were applied to Autodesk’s own facilities. ICF and Autodesk worked together over the span of three months to test solutions for rapid energy modeling on six Autodesk facilities and investigate the application of Autodesk tools in the wider architecture community. While the rapid energy modeling workflow can be applied to both new and existing building projects, the focus of that study was on existing buildings, both to address a much-needed demand and to validate the models using actual energy consumption data.

In 2011 [a white paper](#) was released by Autodesk, giving additional detail to the original REM concept, and discussing new and emerging aspects of the various technologies that were

becoming available. This second paper provided additional details on the workflow as well as customer testimonials and pilot results.

This ESTCP demonstration project focused on this new and innovative workflow applied using the REM component technologies. This project utilized the field demonstration as a rigorous test environment for the methods, procedures and technology envisioned in the concept papers.

Separate from the development of the workflow as a “technology”, REM utilizes several software solutions with separate heritage and chronologies. The first technology is the utilization of publically available satellite imagery collected from services such as Bing or Google Maps. This imagery is used to generate building “footprint” areas of a studied building. Terrestrial digital imagery was investigated as a potential source for building geometry creation but this method proved unsatisfactory for this application.

The next class of technology used for this project is 3D geometric modeling applications. These include Revit, FormIt, and Vasari software applications. These 3D modeling tools provide flexibility to cover the variety of circumstances found at installations and take into consideration the level of experience with the installation personnel.

Revit has a 10-year history creating construction documentation for the building design industry. The basic benefit of the Revit technology is that with this 3D geometric modeling tool, volumes are created when buildings are modeled. In addition, information such as material types can be applied to the model. These capabilities allow for the data for energy modeling (a new use case) to be added to the 3D model and analyzed.

Vasari is also a 3D modeling tool but is designed for conceptual building design models and is easier to use than Revit. Vasari is “beta” software. It integrates energy modeling and analysis features into a geometric/parametric- modeling software application.

FormIt is the third 3D modeling tool tested for this project. FormIt allows for the creation of building models in the field using an iOS or Android tablet.

The final class of software is the energy modeling software Green Building Studio (GBS), which is based on the DOE-2.2 building energy simulation engine. This application utilizes weather station data, generates whole building energy analysis reports, populates analysis results into a user’s GBS online account for further analysis, and creates multiple automatic simulations exploring potential energy saving across multiple building parameters. GBS has been on the market for nearly ten years, and utilizes an XML data file format called Green Building XML (gbXML) for its data inputs.

The summary of these development efforts is that a collection of off-the-shelf software with emerging best practices are providing the potential to simulate the energy use patterns of large numbers of buildings cost effectively.

2.3 ADVANTAGES AND LIMITATIONS OF THE TECHNOLOGY

Current methods and high costs for energy audits may limit their practicality for implementation across the DoD, and less expensive benchmarking approaches such as Energy Star and CBECS do not provide building-specific detail or identify opportunities for savings.

Alternative technologies include several energy modeling graphical user interface front ends to generate building geometry and apply energy modeling attributes. It was beyond the scope of this project to understand the relative technical merits of these applications. Several of these alternatives are available from the [DOE](#) (NREL, 2013).

The REM workflow for energy assessments can provide advantages by offering a level of detail not obtained through benchmarking and with significantly less cost than energy audits. A limitation is that Rapid Energy Modeling (REM) does not provide the detail of investment grade energy audits and does not cover some aspects of a Level 2 energy audit (such as equipment inventories and estimating costs for ECMs), although it does include computer simulation often part of Level 3 audits. The detailed attributes typically required for the Level 1 or 2 energy audits are not based on an understanding of the relative sensitivity of these attributes to energy model performance, so it is difficult to say how much of a limitation it is to simply allow some attributes to be defined with default values. Where full data for the building is not available, intelligent defaults are used based on ASHRAE, extensive background from CBECS, research papers and expert systems developed by energy modeling professionals.

REM is useful in developing a starting point in understanding how the studied building is operating using a model derived from a large set of existing buildings that are operating correctly. Having an understanding of the building energy sensitivities and how building energy use differs from typical buildings allows one to focus the energy conservation work; evaluators can look at their portfolio to find outliers; or users can use prioritize retrofit budget where it is needed most.

Several inputs to the energy model are driven by observations from satellite/aerial imagery and survey responses from building managers. Building and operational attributes of a particular building not properly identified can impact modeling results. This is not a limitation with REM, but a general limitation with simulation in general.

Accurate modeling of building systems is an important factor in developing useful energy models. The downside to focusing on these building systems and their operation is that they add a high level of detail to a process whose goal is to remain rapid and agile. Engineers and energy analysts who want to do more detailed analyses can move REM data to [eQuest](#) or [EnergyPlus](#) for detailed work in those tools, which may require more expertise and detailed inputs. Constructing the initial model using REM can yield substantial timesavings versus initial model creation in eQuest or Energy Plus tools ([Schneider, 2011](#)).

Whole building conceptual energy analysis models provide benchmark building performance for similar buildings in the same climate. The benchmark results are generated based on the basic operational and building design inputs for those attributes known about the building or smart defaults based on the building model type, size and location.

Comparison of modeled and metered results to CBECS revealed that model estimates were much closer to CBECS values, indicating that the differences in the actual building performance were likely due to unique use patterns or poor operation of the buildings rather than incorrect energy model settings. For instance, several POCs indicated that their HVAC systems and boilers are not operating or scheduled correctly, and this may be the cause for the discrepancies; this points to one of the strong values of REM for identifying performance improvement opportunities quickly.

As an update to the demonstration plan and as described in Section 8, Implementation Issues, the quality of the meter data on DoD installations was generally less than was expected by the project team before the start of this demonstration project. This likely led to discrepancies in the comparison of actual and simulated energy use as well.

3.0 PERFORMANCE OBJECTIVES

Table 1-Performance Objectives

| Performance Objective | Metric | Data Requirements | Success Criteria | Results |
|--|----------------|---|--|---|
| Quantitative Performance Objectives | | | | |
| Correlation of REM with Annual Energy Electricity & Fuel Intensity | kWh and therms | Utility history and/or energy meter data (compared to gbXML model data) | Annual Electric and Natural Gas Energy +/- 10% compared to baseline historical utility data Annual Electric and Natural Gas within good to reasonable prediction levels as defined in literature. | -Results were within 10% error on 7 out of 25 buildings for electric. Two buildings fell within +/-10% for natural gas. Overall, there was 81.88% average accuracy for electric (18.12% mean absolute percentage error). -Models for electric use in office buildings performed better than models for barracks or specialty use buildings, with 85.70% average accuracy (14.30% mean absolute percentage error). Accuracy for natural gas averaged 58.2% (41.80% MAPE). -Principle reasons for deviations could be related to flawed meter data, weather anomalies, occupancy variations in building usage, or interior space utilization differences (see 8.0). -Also, deviations may point to operational inefficiencies that should be addressed through re-commissioning for energy and cost savings. |

| Performance Objective | Metric | Data Requirements | Success Criteria | Results |
|---|------------------------------------|--|--|---|
| | | | | -Although not within 10% error, electric mean absolute percentage error values were within the 11-20% threshold, considered “good”. Forecasts of natural gas usage at 41.80% MAPE were within 21%-50%, considered reasonable (Lewis, 1982; Chet et al. 2008) |
| Correlation of REM with overall Annual Energy Use Intensity | kBtu/ ft ² | Utility history and/or energy meter data (compared to gbXML model data) | Annual Energy Intensity +/-25% compared to baseline historical utility data Annual EUI predictions within good to reasonable levels as defined in literature. | -14 out of 25 buildings were within +/- 25% MBE in predicting overall EUI. Average accuracy was 77.56% (MAPE of 22.44%) -MAPE results fall within the 21%-50% threshold, considered reasonable. As above, deviations may be related to inaccurate meter data, operational inefficiencies, weather anomalies, or space utilization. |
| Variance in Monthly Consumption (Billing History) | % | Utility rates, energy meter data and modeled energy data for each building | Acceptable values are a Coefficient of Variation of the Root Mean Squared Error (CV(RMSE)) of $\leq 15\%$. | -Results were within 15% CVMSE for 3 buildings using billing history and cost as metrics. An additional 2 buildings were within 20% CVMSE. -Additional simulation runs did not attempt to tune the modeled results to match metered values, but the CVMSE provides a snapshot of how baseline models aligned with metered data. - It was not anticipated that initial models would align within 15%, as this is the standard that calibrated models are working towards and is outside of REM intent. Buildings with the closest calibration were selected for exploration of design alternatives for energy conservation measures. |
| Testing the REM process for Design Alternatives to Model Potential Energy Savings | % energy savings in kWh and therms | gbXML file and Green Building Studio design files | Design strategies will attempt to achieve energy savings greater than 30% | -ECMs explored basic and advanced design strategies for 5 buildings. Savings greater than 30% was achieved on 3 out of the 5 buildings. -The two buildings that did not achieve the target already had undergone energy retrofits, which were reflected in the models. |

| Qualitative Performance Objectives | | | | |
|--|---|--|--|---|
| Performance Objective | Metric | Data Requirements | Success Criteria | Results |
| Ease of learning technology and expertise required | Person hours of training to complete building model | Training Curriculum | On average less than 6 days to learn technology and complete 1st building model and generate an energy report | Training completed to data indicates that DoD participants can learn the workflow and begin creating and analyzing in less than one day. |
| User Satisfaction | Satisfaction with REM workflow and processes | Responses from informal interviews and anecdotal observations | Users are generally satisfied with the REM process, tools, and results | Participants indicate a high level of satisfaction with the workflow. |
| Ease of use creating REM models | Number of hours to complete model and generate predicted energy consumption reports after process has been learned. | Hours required for successful completion of REM training program. | After successful completion of first REM on average less than 2 days per building to complete model and generate reports | The one year of technology transition has not yet passed, however preliminary results indicate that energy models can be completed in less than 3 hours after the process is learned. |
| Ability to scale process across the DoD | Number of REM trained personnel at end of pilot study | Participants active in training program and completion of training | Five individuals trained and independently creating REM models at completion of first year of technology transition. | At this point in time, 3 individuals have received training, with others scheduled for training in the future. |

3.1 QUANTITATIVE PERFORMANCE OBJECTIVES

3.1.1 Correlation of REM with Annual Energy Electricity Intensity

- This objective sought to use REM workflows to estimate electricity intensity and then compare estimates with actual electricity intensity from utility meter. Performance was measured using a metric of kWh and electric kBtu per ft². Utility history and/or energy meter data was required; the meter data was held blind by ERDC-CERL and not released to Autodesk until after modeling and simulation were complete at which point the modeled estimates was compared to utility data.
- Results were analyzed using direct comparisons of annual electric data and reported through tables, charts and graphs. Plotting measured and predicted (modeled) monthly data values allows identification of periods that have the largest mismatch between estimated and measured energy values.
- Autodesk defines success as being able to estimate annual electricity energy usage within +/-10% error.

- This success metric is based on the assumption that meter data was accurate and normal weather conditions existed. The ESTCP project identified numerous issues with individual building meters that resulted in the exclusion of some buildings. Additionally, some buildings that were included in the study had periods of questionable data, evident in extreme spikes and drops in meter readings.
- Deviations can assist with portfolio analyses by helping to identify outliers, low hanging fruit, and buildings with operational inefficiencies which should be addressed through retrofits
- Results were analyzed on an overall and an individual building basis, as well as aggregated by building type. Mean Bias Error (MBE = (Modeled-Measured) / (Measured)) was used as a metric to evaluate individual building results compared to annual baseline historical meter data; performance objectives defined +/-10% error as the desired threshold. Lewis (1982) is often cited as a method to evaluate the accuracy of predictions, wherein 11%-20% is a good forecast, 21%-50% is a reasonable forecast, and 51% or more is an inaccurate forecast (Lewis as cited in Chen, 2008) (Table 2).
- Mean Absolute Percentage Error (MAPE) was calculated using the sum of the absolute percentage of error for aggregated buildings divided by the sample size. As a rule, the lower the MBE and MAPE values, the more accurate the model forecast. Standard deviations, coefficient of variations, mean absolute deviation (MAD), mean square error (MSE), and mean frequency error (MFE) were also documented.

Table 2-Typical Mean Absolute Percentage Error Values for Model Evaluation

| MAPE (%) | Evaluation |
|------------------|---------------------------|
| MAPE ≤ 10% | High Accuracy Forecasting |
| 10% < MAPE ≤ 20% | Good Forecasting |
| 20% < MAPE ≤ 50% | Reasonable Forecasting |
| MAPE > 50% | Inaccurate Forecasting |

Source: Lewis (1982).

3.1.2 Correlation of REM with Annual Energy Natural Gas Intensity

- This objective sought to use REM workflows to estimate natural gas intensity and then compares estimates with actual natural gas intensity from meter data.
- Performance was measured using a metric of natural gas MMBtu and kBtu per ft².
- Performance and success criteria are the same as referenced for electric intensity above.

3.1.3 Correlation of REM with Annual Energy Use Intensity (EUI)

- This objective used REM workflows to estimate overall Energy Use Intensity (EUI) then compares estimates with actual EUI intensity from combined electric and natural gas meter data held by CERL.
- Performance was measured using a metric of kBtu per ft² and success was defined as the ability to estimate energy usage within +/- 25% error compared to baseline historical meter data for individual buildings. MAPE, MBE were the primary metrics used to evaluate success. Additionally, Standard deviations, coefficient of variations, mean absolute deviation (MAD), mean square error, and mean frequency error were documented.

3.1.4 Variance in Monthly Consumption (Billing History)

- ASHRAE felt there was a need for a consensus framework that can be used to calculate normalized savings that adjusts for non-energy conservation measures that can influence energy use. Billing information was not available, therefore electric and natural gas usage from building meters and utility rates provided by installation POCs were used as a proxy. Results were analyzed using direct comparisons, charts and graphs.
- Acceptable values are a Coefficient of Variation of the Root Mean Squared Error (CV(RMSE)) of less than 15%. It should be noted that while models were compared to actual metered usage, then were not tuned or re-run to match metered usage, and this is outside of the scope of the Rapid Energy Modeling workflow. Rather, the CVRMSE calculation provides visibility into how close initial monthly modeled values are to calibration with monthly metered values.

3.1.5 Testing the REM process for Design Alternatives to Model Potential Energy Savings (PES)

This objective investigated energy conservation measures or strategies within Green Building Studio for a subset of five different buildings. Performance was measured using a metric of percentage energy savings for natural gas and electric individually, percentage reduction in EUI and cost savings.

- Selection of ECMs was guided by Potential Energy Savings (PES) analyses within Green Building Studio and will explore potential savings with different ECM packages: a basic package that does not include building envelope improvements and an advanced package that includes basic package measure but also includes more costly envelope improvements.
- Results were analyzed using comparison of the approaches and reporting the results through charts, graphs and standard deviations. Energy conservation strategies attempted to demonstrate energy savings greater than 30% (per EISA 2007 Whole Building Energy Reduction Targets).
- Results are displayed for both the simulation results and the baseline from meter data.

3.1.6 Time and Cost Effectiveness for Energy Modeling

- The objective investigated time and cost required for Rapid Energy Modeling to ASHRAE Level 2 audits. Performance was measured using a metric of hours and cost per building and per square foot. Comparisons referenced published information on ASHRAE Level 2 audits. Reported costs for detailed energy audits varied from \$0.12 up to \$0.50 per square foot, depending on the size and complexity of the building. (Baechler, et al. 2011). For the purposes of this study, researchers used the low-range estimate.
- Results focus on calculations of time and cost savings of REM compared to audits, with an emphasis on improved scalability for DoD.
- The performance objective attempted to demonstrate a >30% improvement in time and cost savings compared to typical auditing approaches, with the understanding that REM is not to be considered as a replacement technology to ASHRAE audits.

3.2 QUALITATIVE PERFORMANCE OBJECTIVES

3.2.1 Ease of Learning Technology and Expertise Required

- DoD personnel were trained on REM technology using training curriculum developed during this demonstration project. The target audience was installation energy managers or other staff; there was no prior experience with energy modeling technologies required.
- The objective of the initial training session was to get the average participant to learn the software solutions, understand the steps needed to incorporate the recorded data, complete the first building model and generate results from the analysis.
- The ease of learning the REM technology curriculum was measured in person hours.
- Results were analyzed using documentation of level of effort for each participant. It was anticipated that, on average, it will take less than 6 days for personnel to learn the REM technology, complete the 1st building model and generate reporting results.

3.2.2 User Satisfaction

- The purpose of this objective was to get feedback from DoD personnel that received training on the REM workflow and includes responses from informal interviews, a formal survey of training attendees and anecdotal observations.
- Upon completion of training, users were asked about their satisfaction with REM workflows, tools and processes. It was anticipated that the majority of users would be satisfied with the REM process, tools and results.

3.2.3 Ease of Use Creating REM models

- The purpose of this objective was to assess REM workflow ease of use.
- Researchers with only one day of prior conceptual energy modeling experience documented the number of hours to complete model and generate predicted energy consumption reports after process was learned and recommend optimized workflows based on lessons learned, and requirements for inputs, model outputs, time, and expertise.
- Results are presented as a decision matrix to communicate attributes of various workflows, and guide users to the most appropriate software given their capabilities and requirements.

3.2.4 Ability to Scale Across the DoD

- The purpose of this objective was to assess the ability to scale the REM workflow across the DoD and will be determined by the number of REM trained personnel at end of pilot demonstration period. Researchers will have five individuals trained and independently creating REM models within one year of technology transition.

4.0 FACILITY/SITE DESCRIPTION

4.1 FACILITY/SITE LOCATION AND OPERATIONS

Port Hueneme is located within Naval Base Ventura County (NBVC), covers more than 6000 acres and is located approximately 60 miles northwest of Los Angeles, California. Port Hueneme contains one of the few deep-water ports on the West Coast. NBVC Port Hueneme is home to the Pacific Seabees, four Naval Mobile Construction Battalions, Underwater

Construction Teams, the Naval Surface Warfare Center, Naval Facilities Engineering Service Command and Naval Facilities Engineering Logistics Command. Other facilities within NBVC include Point Mugu and San Nicolas Island. Altogether the facilities within NBVC have a base population of more than 17,000 personnel, making it the largest employer in Ventura County ([VCNavBASE](#)). This installation indicated that electric and natural gas data was available for 4 buildings but natural gas data was only available for one building; the other three buildings were modeled but were not included in pooled analysis.

Naval Station Great Lakes is located near North Chicago, Illinois. The base is the largest training station in the Navy and the Navy's only bootcamp. Each year approximately 38,000 individuals complete Navy enlistment requirements at Naval Station Great Lakes. ([NSGreatLakes](#)) The base has 1,153 buildings situated on 1,628 acres. All three buildings sampled at Naval Station Great Lakes were district steam which Green Building Studio cannot analyze; these buildings were modeled but not included in pooled analysis. One building (7103) is actually three buildings sharing common walls with one electric meter and one steam meter. Building 800 is a series of 7 separate dormitory buildings sharing one electric meter and one steam meter.

Naval Surface Warfare Center, Panama City is located on 650 acres along the Gulf of Mexico in Panama City, Florida. The base is a leader in amphibious warfare systems, mine warfare, mine systems, countermeasures and military diving. The base employs approximately 2,000 civilian and military personnel and has 221 buildings. ([PanamaCityInfo](#))

Naval Weapons Station Earle, is located in Colts Neck, New Jersey and Middleton, New York. The base provides all ordnance for all Atlantic Fleet Carrier and Expeditionary Strike Groups. The base encompasses approximately 12,000 acres and employs a workforce of over 1500 personnel. ([NWSEarle](#)) Models results and analysis for this installation are included in Appendix C, however there were apparent scaling issues identified by researchers and acknowledged by the installation POC; these buildings were not included in pooled analysis.

Portsmouth Naval Shipyard is located on over 297 acres in Kittery, Maine, across the harbor from Portsmouth New Hampshire. The base is one of four shipyards in the nation, and provides overhaul, repair and modernization of the Naval submarine fleet. The base employs approximately 4800 employees, including 100 naval officers and enlisted personnel. Many of the base's buildings are in a historic district and 50 buildings are listed on the National Register of Historic Places. ([Portsmouth](#))

Fort Leonard Wood Army Base is located on 62,991 acres in Fort Leonard Wood, Missouri, approximately 130 miles west of Saint Louis. Fort Leonard wood is home to Maneuver Support Center, Chemical, Biological, Radiological and Nuclear Schools, Engineer and Military Police Schools, and the Center of Excellence for Homeland Defense. ([FtLeonardWood](#)) The base is considered a leading training installation and has a major economic impact on the community, employing over 9000 civilians. ([Army2020FLW](#))

U.S. Army Construction Engineering Research Laboratory (ERDC-CERL), is located in Champaign, Ill. ERDC-CERL directs research to increase the Army's ability to *"more efficiently design, construct, operate and maintain its installations and contingency bases and to ensure*

environmental quality and safety at a reduced life-cycle cost". [\(CERL\)](#) CERL is located within 3 buildings at the University of Illinois at Urbana-Champaign (UIUC) and regularly collaborates with UIUC on DoD initiative. [\(CERLFactSheet\)](#) All three buildings at CERL were modeled and analyzed, however it should be noted that there is only one natural gas meter for all three buildings. CERL energy analysts supplied estimates of individual building metered natural gas usage based on allocation by building size.

Joint Base Lewis McChord is located on over 414,000 acres in the Puget Sound region outside of Tacoma, Washington. The Joint Base provides support to more than 40,000 service members and approximately 15,000 civilian workers. [\(JBLM\)](#) The mission of the base is to provide training, mobilization and deployment operations for Army, Navy, Air Force, and Marines. The base supports a population of over 100,000 individuals and has over 22.8 million square feet of buildings, not including family house. [\(JBLMBriefing\)](#)

Seymour Johnson Air Force Base is located on 3300 acres in Goldsboro, North Carolina. The base supports approximately 12,000 individuals including 4600 active duty and 1000 civilians. The base is home to the 4th Fighter Wing, a distinguished fighter wing within the Air Force that provides aircraft and personnel for executing combat missions. The base also provides technical officer military training for cadets. [\(SJAfB\)](#) The base population is approximately 12,000 including 5600 military members and over 900 civilians. There is approximately 4.5 million square feet of building area. [\(SJISA\)](#)

Peterson Air Force Base is an Air Combat Command base located on approximately 1300 acres adjacent to Colorado Springs, Colorado. The base is headquarters for the 21st Space Wing and is the Air Force's only provider for missile warning and space control to global combat forces [\(Peterson\)](#). The base supports over 6500 military members and approximately 600 civilians [\(SJUnits\)](#) and manages over \$400 million in Real Property.

4.2 FACILITY/SITE CONDITIONS

Researchers visited 10 installations and a population of 35 buildings across six climate zones (Figure 4) between December 2012 – March 2013 and selected 23 buildings for inclusion in the core analysis of the study. This includes a total of five Navy bases, three Army sites, one Air Force site, and one Joint Base (Figure 3).

Prior to scheduling the site visits, researchers had received verification that meter data was complete and usable by ERDC-CERL, a partner on this project working via a CRADA set up for this project. Site visits included engagement with the installation POC and review of the completed energy questionnaire. Researchers took the opportunity to ask clarifying questions from the POC and visited the exterior of individual buildings with the installation escort.

The military operations occurring at the selected installation sites varied depending on military sector, installation and building type. The demonstration project did not interact with ongoing operations at the military facilities.

Figure 3-Site Locations

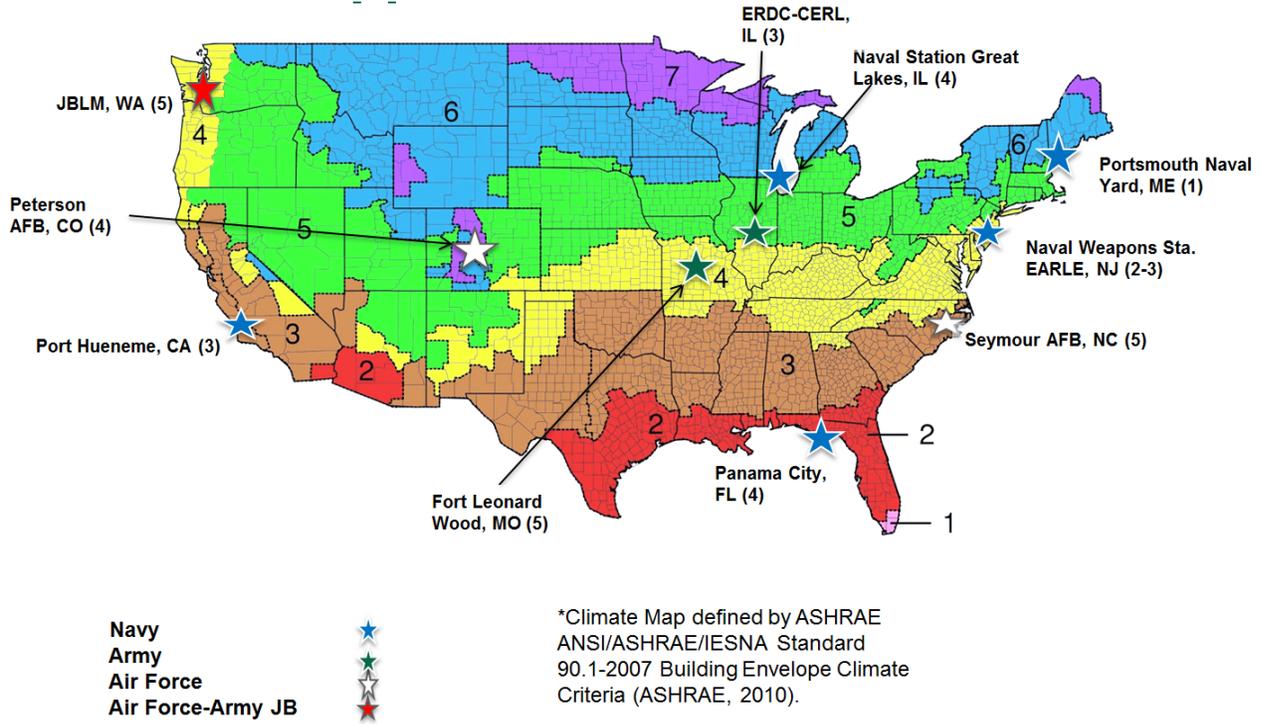


Table 3-Site Information

| Installation | Buildings |
|-----------------------------|--|
| ERDC-CERL | 3 Offices |
| Fort Leonard Wood | 1 Office; 3 Barracks (1 excluded from analysis), 1 Gym |
| Joint Base Lewis McChord | 2 Offices (1 excluded); 2 Barracks (1 excluded) |
| Panama City | 2 Offices; 1 Barracks |
| Peterson AFB | 4 Offices |
| Port Hueneme | 4 Offices (3 excluded) |
| Portsmouth | 1 Barracks |
| Seymour AFB | 1 Office; 1 Cafeteria; 1 School; 1 Fire station; 1 Automotive Facility |
| Earle Naval Weapons Station | 1 Office; 1 Auto Facility; 1 Cafeteria (all excluded) |
| Great Lakes | 2 Barracks; 1 Drill Hall (all excluded) |

5.0 TEST DESIGN

5.1 CONCEPTUAL TEST DESIGN

This project evaluated technical performance and cost characteristics of estimating energy consumption of buildings by conducting Rapid Energy Modeling (REM) simulations. These simulations were then compared blindly to historical energy use information of the same studied buildings.

The project utilized the REM methodology on 23 DoD buildings of varying use types across 6 different climate zones. A subset of five buildings was further processed with the design alternatives capabilities of Rapid Energy Modeling software tools in order to estimate how much energy could be saved by applying Energy Conservation Measures (ECMs). Design alternatives were selected for each of the five buildings by the project team and simulation estimates are included in this report. Test phases are described in Table 4.

Table 4-Test Phases

| Test Phase | Activity |
|-----------------|--|
| Reality Capture | <p>Capture - Pre-Installation Phase</p> <ol style="list-style-type: none"> 1. Identified a population of 35 candidate existing DoD facilities of various types in different locations; reduced the number to 23 buildings for aggregate analysis because of meter data quality concerns 2. Candidate buildings identified on satellite and verified by installation POCs 3. Captured structural, operational and systems information through Installation Energy Questionnaire, including: <ul style="list-style-type: none"> • Building profile: Location, building use type, age of building, operational schedule • Building geometry: floor height, total building height, gross square footage, window: wall ratio, number of floors and below grade floors, roof and wall construction • Operational parameters: HVAC systems • Structural and Operational Anomalies: Atriums, overhangs, basement storage rooms, refrigeration, elevators, escalators, vending machines, renewable energy sources, data centers <ul style="list-style-type: none"> ◦ <i>Note: Building energy variables are typically set to ASHRAE defaults if information is not available</i> 4. ERDC-CERL collected, verified and retained building energy utility meter data <p>Capture - Installation Phase</p> <ol style="list-style-type: none"> 1. Visited installation and asked clarifying questions about the submitted energy questionnaire, capture onsite reference photos |

| | |
|---------------------|---|
| Model | <p>Construct BIM-based Building Models</p> <p>Geometry Creation Subtask</p> <ol style="list-style-type: none"> 1. Used FormIt conceptual modeler in the field to create 3D building model, refined the model in Revit based on energy survey, site observations and reference photos 2. Vasari workflow explored a remote approach using software-integrated satellite imagery and the energy survey <p>Energy Analysis Subtask</p> <ol style="list-style-type: none"> 1. Generate Energy Models based on conceptual model building location, geometry, energy settings, ASHRAE defaults where energy settings were not provided, and weather information 2. Perform Conceptual Energy Analysis driven by Green Building Studio / DOE 2.2 engine 3. Produce energy reports |
| Analyze | <p>Analyze Model Results</p> <ol style="list-style-type: none"> 1. Comparison of modeled results to actual utility meter data 2. Compare metered and modeled energy information to benchmarking results using CBECS 3. Compare REM to time and cost of audits 4. Review the energy analysis findings under the High Performance and Sustainable Building Guiding Principles Compliance Pathways for building efficiency and sustainability goals for CVRMSE, using billing rates to compare monthly meter and modeled results. <ol style="list-style-type: none"> 1. CVRMSE monthly billing calculations 5. Five (5) of the study’s twenty three (23) buildings that were within an acceptable tolerance of CVRMSE calibration were further processed with the design alternatives capabilities of GBS, informed by PES analysis across a range of building parameters |
| Technology Transfer | Workshop, Webinar and Curriculum Development |
| Reporting | Report development and submission |

5.2 BASELINE CHARACTERIZATION

The historical metering data was used as a reference condition to determine the technical performance accuracy of the REM method and the existence of historical natural gas and electric metering information was a prerequisite for a building to participate in this study. ERDC-CERL requested building natural gas and electric meter data at the most granular level available from candidate installations. CERL then conducted a review of this data to ensure that at minimum there were 12 months of reliable natural gas and electric meter data for each building.

The inputs for the energy model were derived using imagery and responses to the site survey, and focused on rapid baseline characterization of the building geometry, operations and systems.

The REM workflow also does not utilize floorplans or model interior walls, opting instead for ASHRAE standard perimeter-core space simplification and a maximum width of perimeter zone to minimize the error introduced by removing interior partitions. The REM models also do not designate different space utilizations within a building, so buildings with different space utilizations (i.e. office and lab) are modeled as one building type per generalizations similar to the building-wide defaults recommended in ASHRAE 90.1 vs. the space-by-space method. Accurate modeling of interior spaces is possible with the software tools, however this requires a significant time investment to collect, organize, and translate building plans into the model, and would require additional expertise from DoD end users that is not of sufficient value for the purposes of a REM survey.

Similarly, building schedules may not be uniform throughout the building, or consistent on a weekly, monthly or annual basis. Researchers used information provided by installation staff to determine schedule selection in the modeling and energy analysis tools. Several installations provided monthly totals instead of interval meter data as requested, thus in these cases few insights regarding accuracy of schedule assumptions could be gleaned. It was assumed that weather for the year of meter data submitted was not anomalous.

Some installations submitted monthly interval data, while others submitted 15-minute interval data. Several buildings were eliminated during this validation stage, due to apparent issues with the meter data. Other datasets were validated and included in the study, only to have the meter data later determined to be unreliable when released from CERL to Autodesk for comparison with REM results. Several buildings included in the study have meter data anomalies, such as large spikes in usage that may or may not be accurate (see Appendix D).

Additionally, modeled energy results, and metered data were compared to the US Department of Energy Index for Commercial Buildings, which utilizes data from the Energy Information Administration (EIA) 2003 Commercial Buildings Energy Consumption Survey (CBECS) using the [Building Energy Data Book](#) tool. Primary search criteria were climate zone and building type, followed by size and vintage if sample sizes were sufficient ($n > 10$) to allow further refinement.

5.3 DESIGN AND LAYOUT OF TECHNOLOGY COMPONENTS

Technology components included REM tools (see section 2.1 for description)

Researchers explored the various software tools and workflows to better assess capabilities and then optimize scalability for DoD when technology is transferred. Some of the tools have overlap in terms of their functional attributes, and the portability of file formats between tools allows users a great deal flexibility in determining a workflow (Figure 4 and Figure 5) depending on the level of detail desired, expertise, and time constraints (See Section 6.5 for discussion of attributes of workflows.)

Figure 4-Visual Depiction of Technology Components


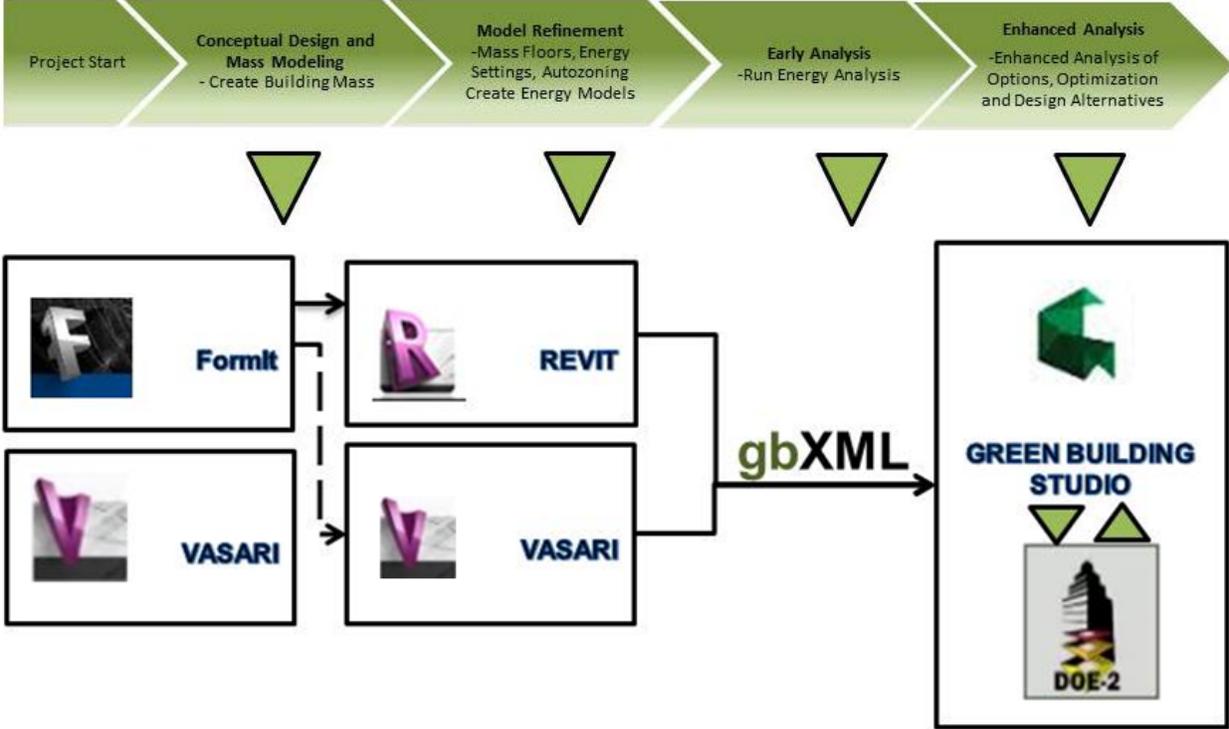


Figure 5-Visual Depiction of DoD Technical Workflow

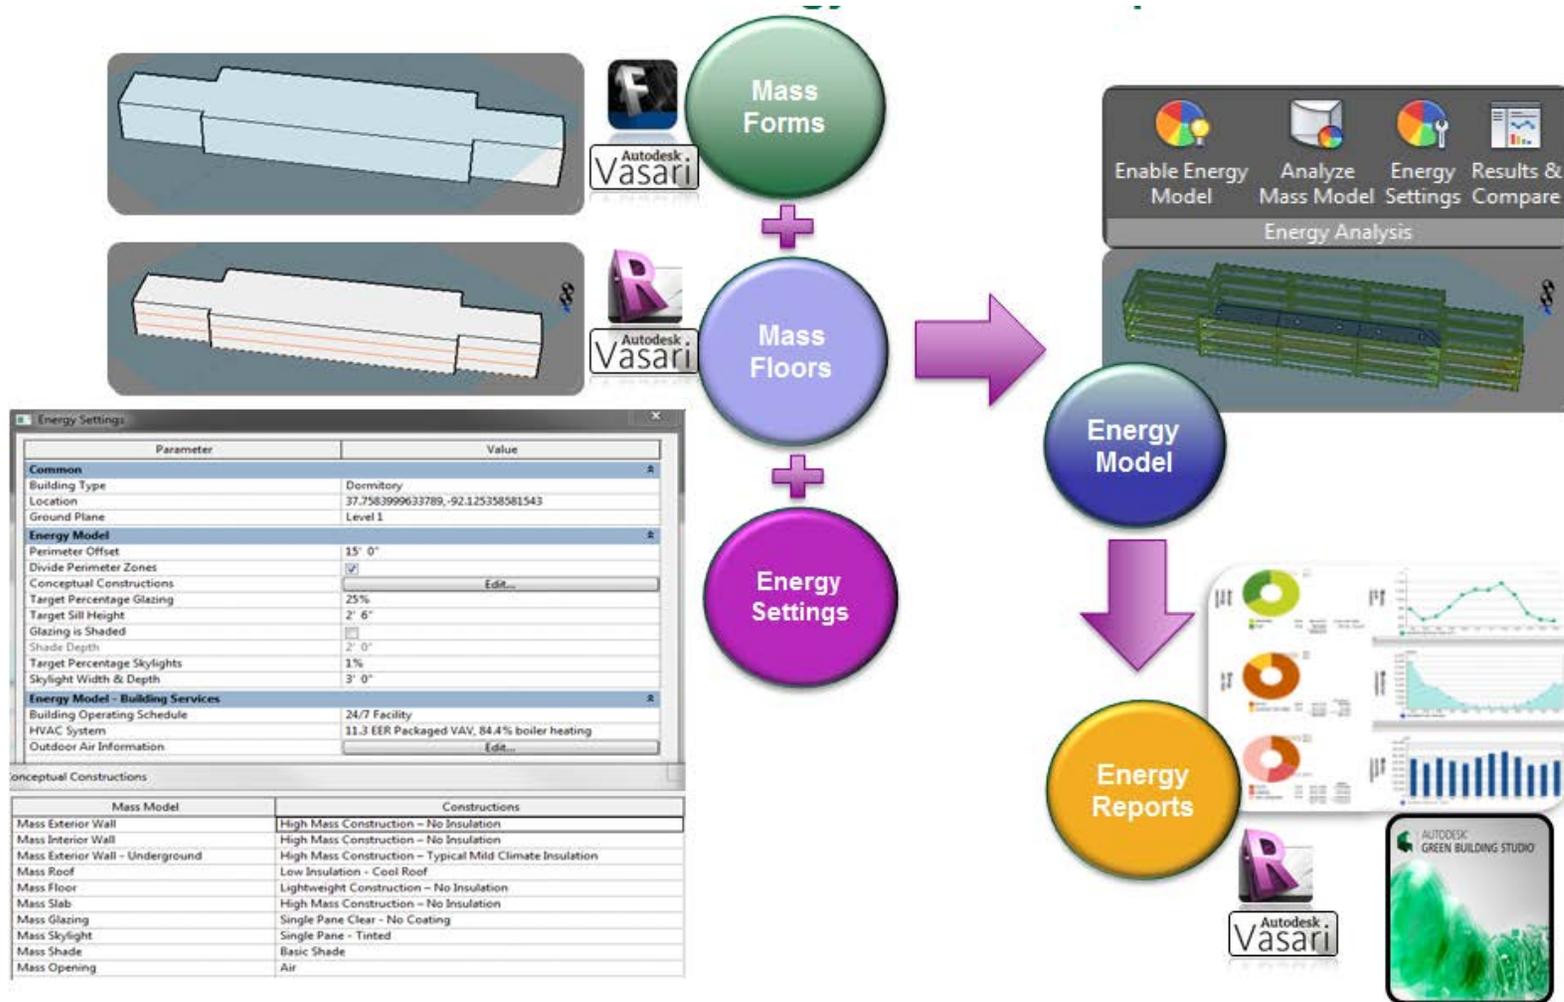

In the REM workflow, the mass form geometry is created using satellite imagery. Mass floors are then created to reflect the number of levels and floor-to-floor heights of the building, which are informed by the questionnaire responses and satellite images (See section 5.1). Energy settings are then selected based on questionnaire information or satellite information in the case where supplied information is inadequate. The energy model is then enabled and zoning is created based on ASHRAE. The energy model report is then generated in Green Building Studio. Enhanced analysis is then possible with GBS.

Workflows

Autodesk FormIt mobile was used on iPads in the field to create rough 3D building mass form models (Figure 6). This approach allowed teams to identify and model only conditioned spaces, and disregard atriums and overhangs in the models, which were apparent when teams were onsite but not always visible using exclusively satellite images.

Figure 6-FormIt Model Creation



FormIt models were then moved into Revit software, wherein teams calibrated the building size to the gross conditioned square footage indicated in the energy survey, created mass floors to match survey responses and site observations (Figure 5), designated energy settings guided by survey responses and site visit observations (Figure 7) ran energy analyses and created an energy report for each building.

A more streamlined and remote approach using Vasari was used for each building. Like FormIt, Vasari allows the user to easily import a scaled and geo-referenced satellite of a building, and also allows users to reference the nearest weather station (Figure 8). Upon pulling in a satellite image, the research team then used information from the energy surveys, and observations from satellite and aerial birdseye images, such as Bing Birdseye (Figure 9) or Google Streetview to guide energy settings and verify energy survey responses related to wall constructions, glazing ratios, etc.

The research team calibrated models to reported conditioned gross floor area, adjusted building height to match reported height, created floor levels, activated autozoning and ran energy analyses in Vasari.

Green Building Studio utilizes the DOE-2.2 engine to run energy analyses and create reports. DOE-2.2 is a whole building hourly simulation program that considers the geometry of the building and its internal spaces, construction, equipment, and hourly operation schedules. DOE-2.2 is also the engine behind eQuest, a freeware engineering tool that is one of the most widely used whole building hourly simulations tools in the U.S. today.

Starting with the first hour of the year and for every hour of the year, DOE-2.2 reads in the weather data based on location (temperature, humidity, solar, wind speed and direction, pressure) from the location's weather data file. DOE 2.2 then determines the heating and/or cooling loss or gain from the roof, skylights, walls, windows, and floors as well as calculates the equipment (lights, computers, etc.) running in the building and the heat, light and moisture coming off that equipment and its energy use for that hour, calculate the number of people in each space and the heat and moisture coming off the people in each space for that hour, determines the thermostat set-point for that hour, and calculates the amount of energy the HVAC equipment needs to use for that hour to maintain the thermostat set-point. DOE-2.2 does this for every hour of the year and generates a variety of results including monthly and annual energy use (electricity and natural gas) and cost of the building.

Researchers attempted to get specific information about building construction and operations from installation personnel and applied this information in the energy settings. Some information however was left as defaults, which are based upon ASHRAE standards, including: analytical space and surface resolutions, perimeter offset, sill height, and outdoor air information. Additionally, input defaults used in the energy analysis but not visible in Revit or Vasari Energy settings are also based on ASHRAE standards (GBS).

Green Building Studio and the DOE 2.2 engine allow the automatic generation and display of energy reports. The energy reports provide detail on: Energy Use Intensity (kBtu/ ft²/year), Annual and Monthly Electric, Fuel and Total Energy Use and costs, Detailed Annual Electric and Fuel End Use breakdowns (Figure 13), Carbon Emissions, Estimated Water Usage, PV and Wind Potential, as well as other detailed energy performance information (Figure 10).

Figure 7-Energy Settings with REM tools

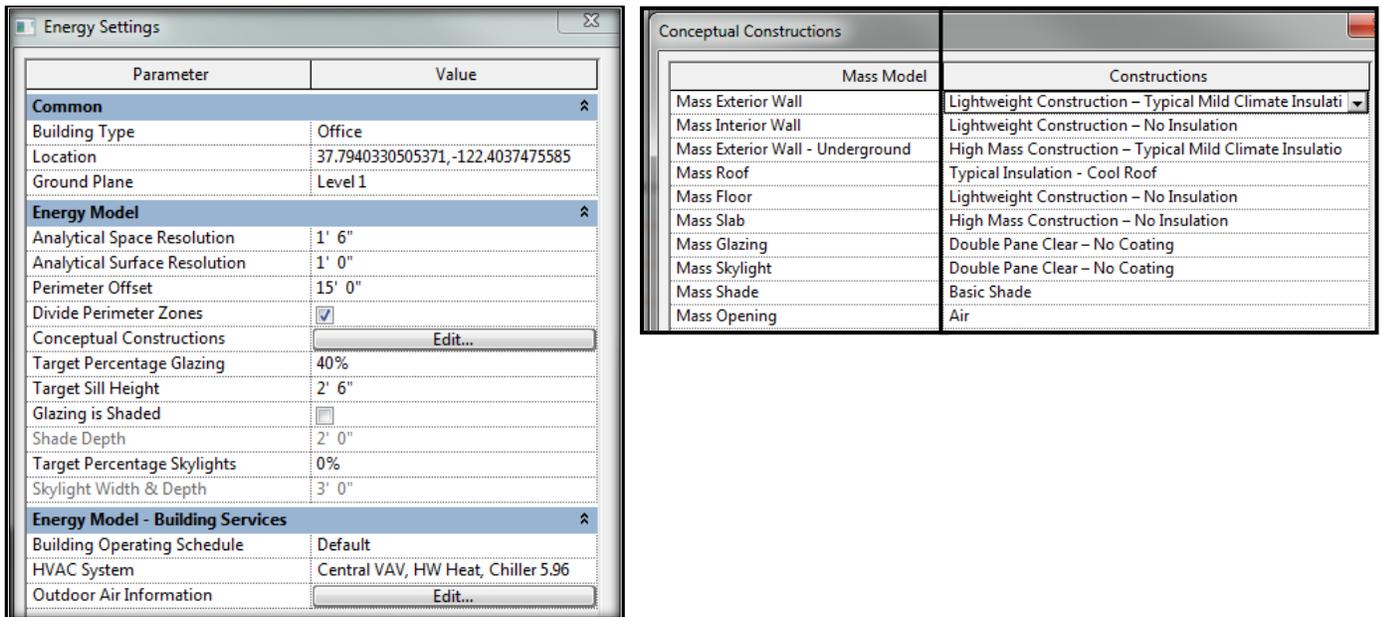


Figure 8-Satellite Image Import

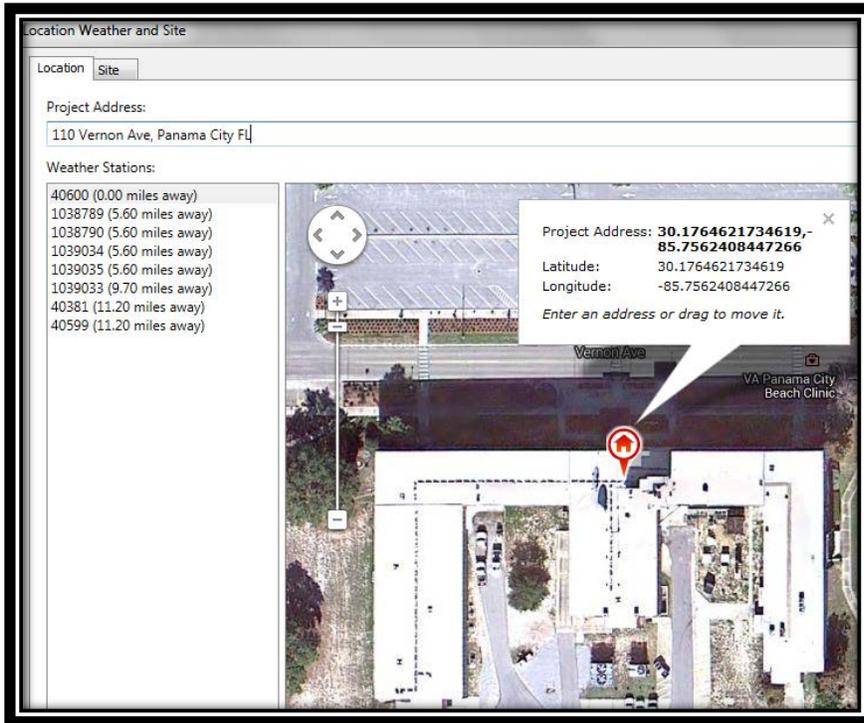


Figure 9-Bing Birdseye Image



Potential Energy Savings Analysis

Green Building Studio allows automatic analysis of Potential Energy Savings (PES) for several building features. Automatic PES analysis was performed on each building simulation run submitted. Specified building features from the model were retained and the REM process generated 50 alternative design variations with multiple options for 14 building parameters. The 50 separate parametric energy simulations were run simultaneously for each building and results were plotted against the current building conditions to give an understanding of the building's potential energy performance to for each parameter ([GBSPotentialEnergySavings](#)). The results can be visualized in table and graphical formats (Figure 11). See Appendix F for description of PES parameters and technical reference tables.

Figure 10-Energy End Use Chart Example from Green Building Studio


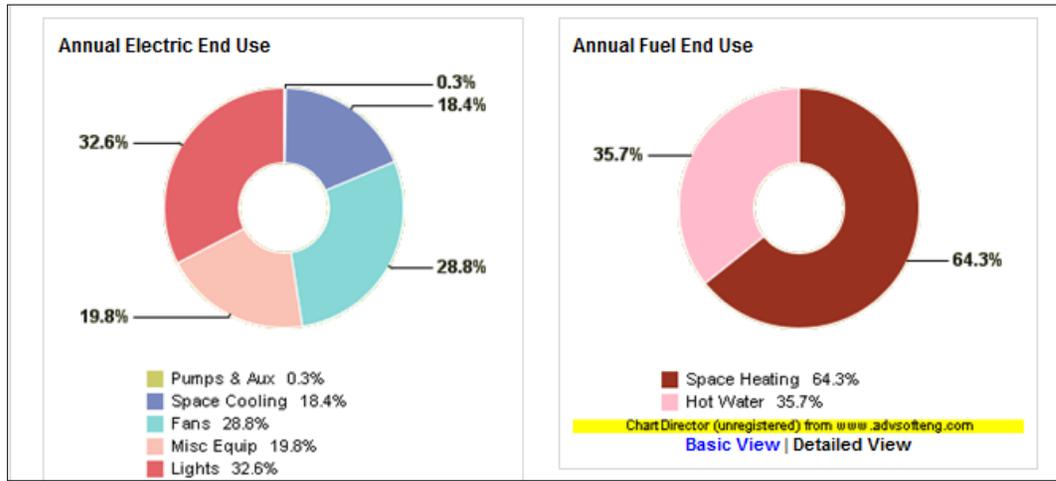


Figure 11-Potential Energy Savings Analysis

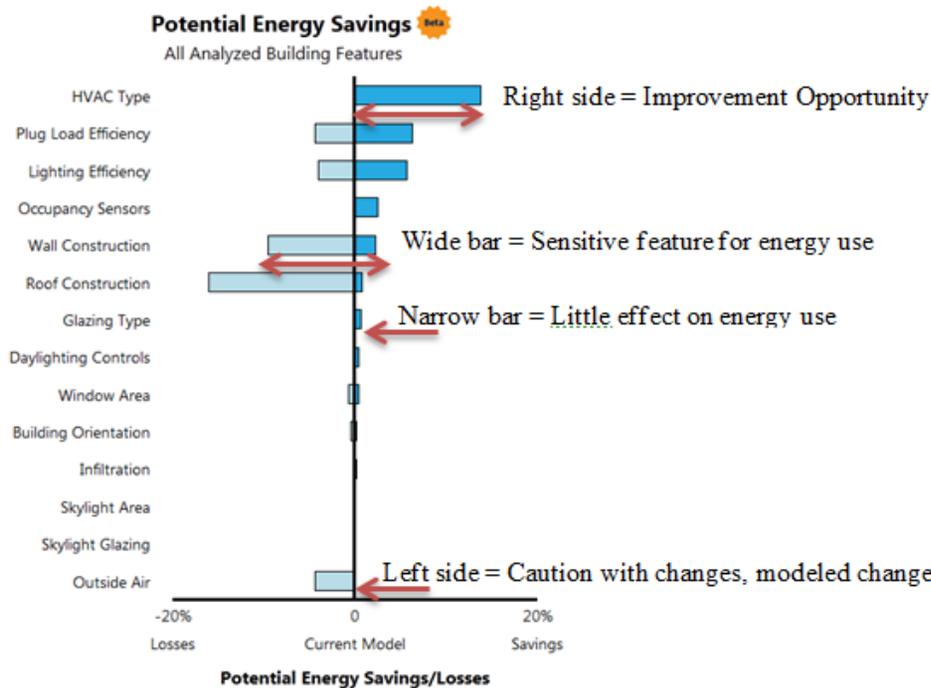

How Potential Energy Savings Analysis Works

1. Green Building Studio receives model, which contains any specific building feature design options defined in Revit or Vasari
2. For any building features that were not specified, GBS inserts appropriate default values for the building type and location and runs an energy analysis
3. Green Building Studio then generates 50 alternative design variations in the cloud with multiple options for 14 building parameters.
4. Green Building Studio then spawns 50 servers and runs all of these alternative models at the same time.
5. The results of the 51 simulations are displayed in the Potential Energy Savings chart with the center line reflecting the initial baseline run

Design Alternatives and ECMs

Results from PES analyses were used to explore Energy Conservation Measures (ECMs) for a subset of 5 DoD buildings. Researchers were able to modify base assumptions in the building energy model and run additional simulations to estimate impacts of energy conservation measures (ECMs) informed by PES analysis runs. Currently, PES analyses and design alternatives do not incorporate cost of measures, therefore researchers explored different scenarios for each building, including:

1. Basic Package - which may include LPD or EPD improvements of 10%, occupancy sensors and daylighting controls or possibly HVAC system upgrade using a similar system and infrastructure to what currently is present.
2. Advanced Package – which may include the above, and also envelope improvements such as wall construction and roof construction if indicated by the Potential Energy Savings chart.

Researchers did not explore changing window area, skylight area or building orientation considered in ECM packages due to feasibility, practicality and cost concerns. Changes to LPD and EPD were limited to 10% because these reductions did not have specific upgrade measures associated. Lighting power density can be reduced by lighting upgrades, ballast replacements, or other lighting system performance improvements. Researchers took a conservative approach however and modeled only 10% improvements to LPD when indicated as area for potential energy savings; it is quite possible that a systems approach to reducing lighting power density would yield higher energy savings. EPD measures such as improved efficiency in copiers, printers, servers, computers, monitors etc. could help reduce EPD. Additionally, training employees to set computers and monitors into standby mode can reduce EPD. Together or separately, these strategies can lead to significant energy savings, and may exceed the conservative 10% savings modeled for EPD and LPD in design alternatives for ECMs.

ECMs Energy and Cost Savings Analysis

The initial energy models and subsequent design alternative models provide energy consumption estimates for whole buildings, and also provide annual energy cost estimates. The cost function is dependent on rates for energy sources, provided by installation POCs as \$/kWh and cost/therm, and incorporated into the model assumptions. Energy usage and cost estimates for baseline building models were compared to metered energy usage and extrapolated costs. Upon completion of energy conservation measure simulations, the energy savings and energy cost savings potential for the retrofit solutions were evaluated.

5.4 OPERATIONAL TESTING

The relevant mode of operation is a standard methodology including: installation solicitation, data capture, site selection, site access, capturing imagery and measurements, assembling models, generating energy reports, analyzing and comparing energy data to meter data and CBECS, then exploration of energy conservation measures (Table 4; Figure 12). The testing occurred between October 2012 – October 2013 (Figure 13).

Figure 12-Operational Phases


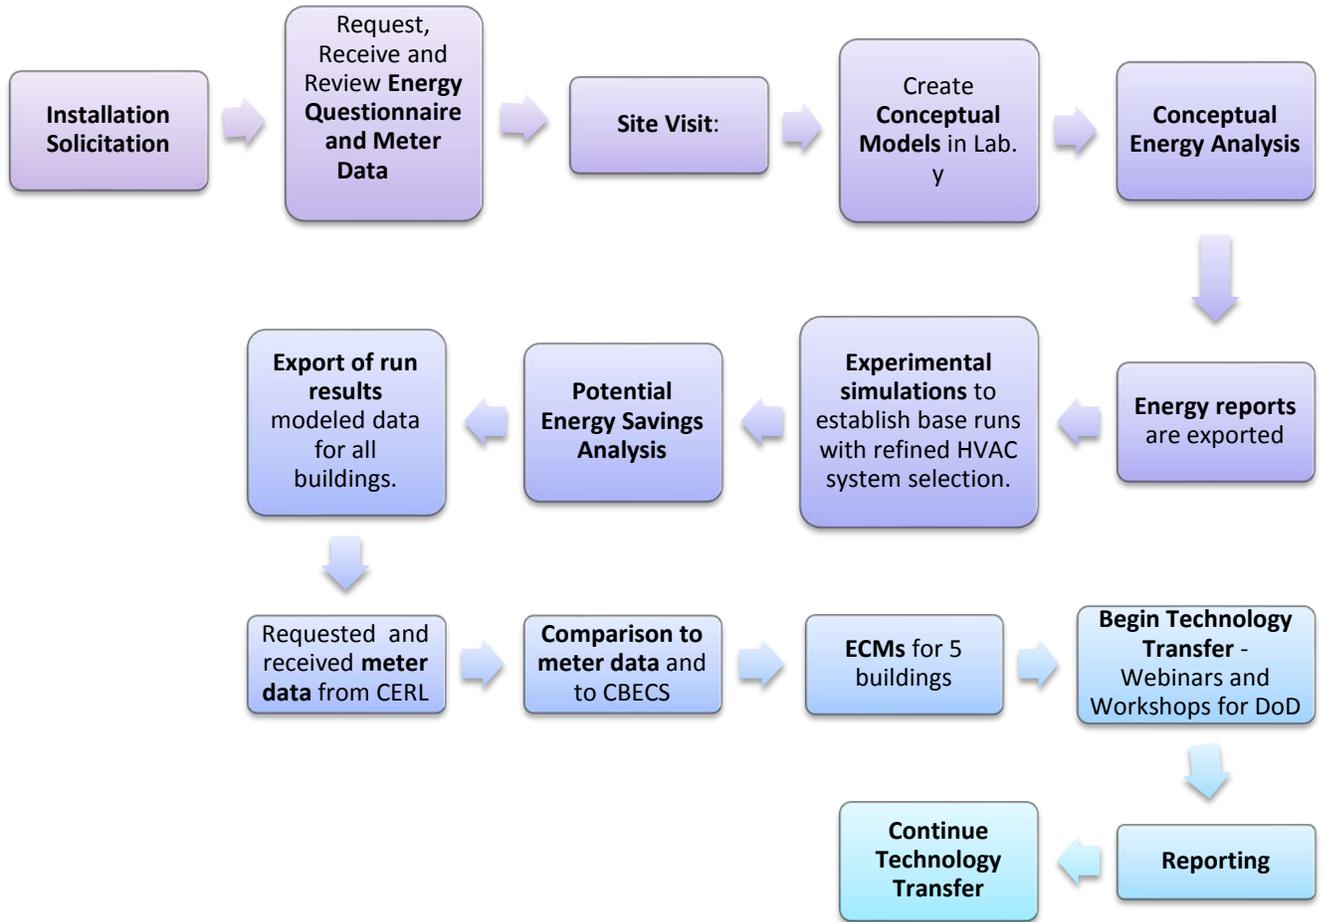


Figure 13-Dates and Duration of Operations

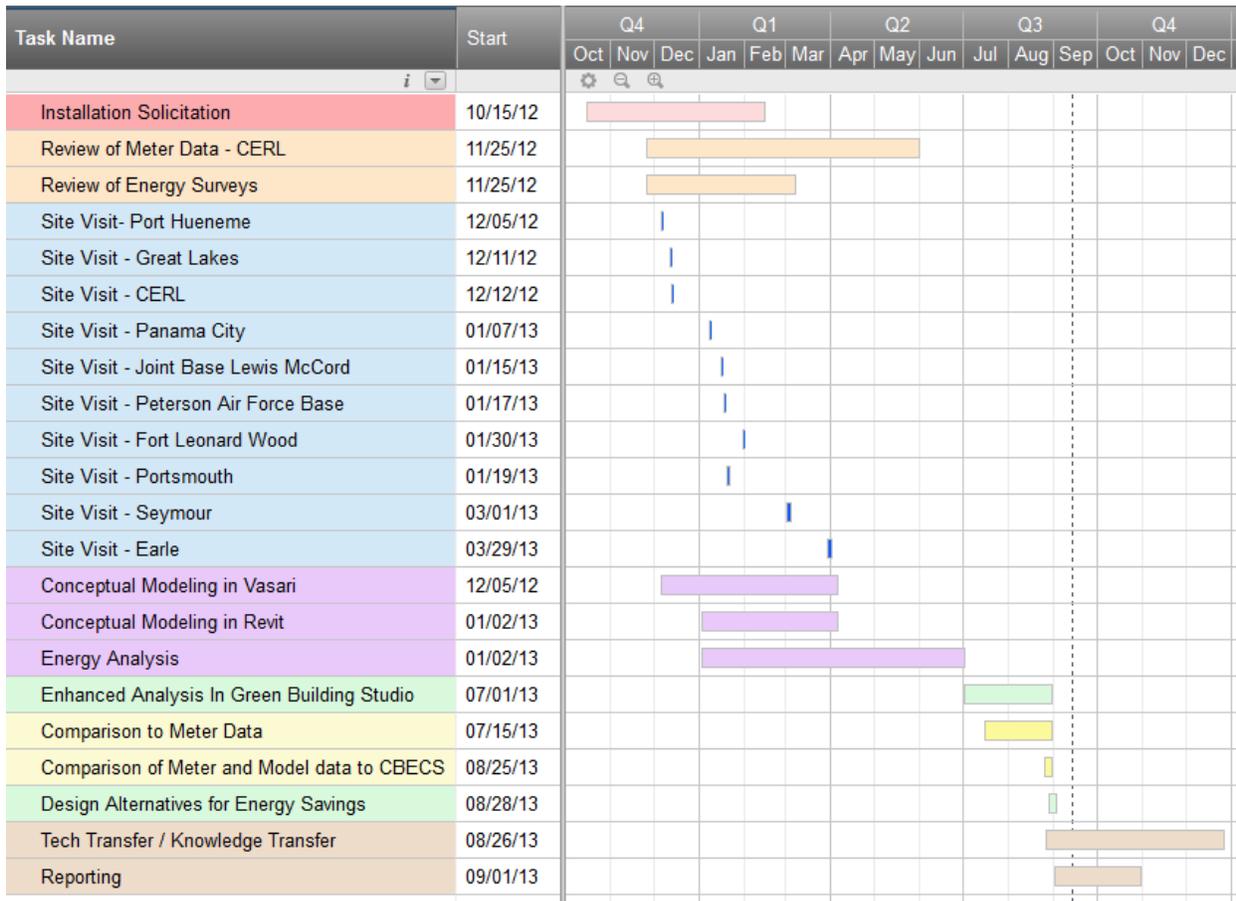

5.5 SAMPLING PROTOCOL

Table 5-Sampling Parameters and Types

| Performance Objective | Parameters | Number and Type of Samples |
|---|--|--|
| Correlation of REM with Annual Energy Electricity Intensity & Annual Fuel Intensity | Electricity and natural gas data from model and from meters | Meter data information; minimum of 1 year data and minimum monthly intervals Model data: Electric and natural gas model data is visible in annual and monthly intervals CBECS data: CBECS annual kBtu/ ft ² electric and natural gas respectively |
| Correlation of REM with Annual Energy Intensity | Electricity + Fuel = EUI | Meter data information; minimum of 1 year data and minimum monthly intervals for fuel and electric Model data: Fuel model data assumes natural gas; it is visible in annual and monthly intervals CBECS data: CBECS annual EUC kBtu/ ft ² |
| Variance in Monthly Consumption (Billing History) | Billing rates | Utility bills were unavailable. CVRMSE was calculated between monthly modeled versus metered billing costs based on utility rates provided and using monthly energy use |
| Energy reduction through GBS modeling of Energy Conservation Measures | % energy savings in kWh and therms; cost savings in \$ | PES analyses within Green Building Studio were used to identify design alternatives for energy conservation measures for 5 buildings. Documentation of energy and cost savings vs. model and meter data. |
| Time and cost to energy model | Hours or Hours/ square foot; \$/ ft ² | Published data in preparation for publication was used to assess average hour and cost requirements for ASHRAE Level 2 audits |
| Ease of learning technology and expertise required | Person- hours of training to complete initial building energy models | Autodesk staff to optimize workflows based on experience, input requirements and constraints, conduct hands-on workshops with DoD personnel and walk them through the workflow |
| User Satisfaction | Satisfaction with REM workflow and processes | Installation personnel to be surveyed regarding their satisfaction |
| Ability to scale across DOD | Number of REM trained personnel at end of pilot study, time to complete models | Documentation of number of personnel trained. |

Data quality and consistency issues are outlined in Section 8.0 and Appendix D. Inconsistencies and missing data were encountered in reviewing energy surveys and meter data. Energy survey questions were in some cases left blank, in other cases completed but with the respondent indicating uncertainty. Researchers documented missing data. If missing or questionable data was necessary for completion of the energy model, researchers made and documented assumptions related to the data.

Review and verification of the building meter data revealed numerous issues related to data quality including: lack of stated natural gas or electric data, zero readings, negative readings, make-up readings, time gaps, large usage/EUI jumps, duplicate timestamps, scaling issues (see Appendix D).

5.6 SAMPLING RESULTS

Table 6-Summary Info on Data Collected

| Division | # of Buildings Visited | # of Buildings in Core Study Set | Captured Data Pre-site Visit For each Building | On Site Information For each building | Models- For each building | Reports For each building |
|-----------|------------------------|---|---|---|---|---|
| Army | 8 | 7 | <ul style="list-style-type: none"> • Meter Data • Energy Survey • Location and Satellite image | <ul style="list-style-type: none"> • Photos of building exterior (<i>often non-essential</i>) • Reference measurement of building footprints (<i>non-essential</i>) • Clarifying questions re: energy survey | <ul style="list-style-type: none"> • Conceptual 3D models • Green Building Studio XML | <p>Green Build Studio Dashboard Charts</p> <p>Green Building Studio Data Tables</p> <p>Monthly and Annual tables and graphs of modeled parameters, such as kWh, therms, and EUI plotted in relation to results from building meters. This gives valuable information on performance of the energy model in comparison to the meter data, seasonal variations, and trends in building types.</p> |
| Navy | 14 | 5 | | | | |
| Air Force | 9 | 9 | | | | |
| Joint | 4 | 2 | | | | |
| Total | 35 | 23 | | | | |
| | | NOTE: 12 buildings removed due to meter data issues or use of district systems | | | | |

Figure 14-Example Report Content from REM Process


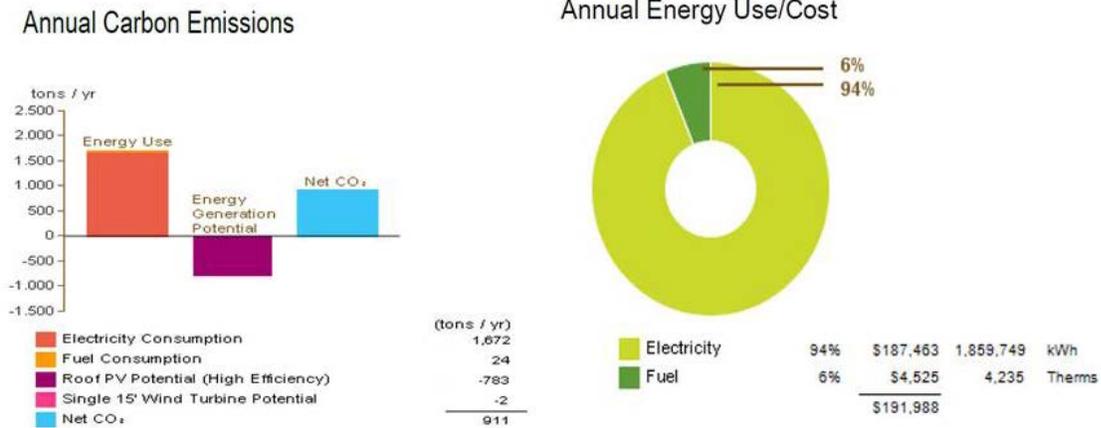


Figure 15-ECM Dashboard Listing

| Name | Energy Use Intensity (kBtu/ft ² /year) | Total Annual Cost ¹ | | | Total Annual Energy ¹ | | | Compare | Potential Energy Savings |
|--|---|--------------------------------|----------|-----------|----------------------------------|--------------|-------------------------|---------|--------------------------|
| | | Electric | Fuel | Energy | Electric (kWh) | Fuel (Therm) | Carbon Emissions (tons) | | |
| Project Default Utility Rates | | | | | | | | | |
| Project Default Utility | | | | | | | | | |
| Base Run | | | | | | | | | |
| FLW_470_V_Office_3 | 63.0 | \$140,779 | \$9,382 | \$150,161 | 1,564,214 | 10,601 | | 1,468.3 | |
| Alternate Run(s) of FLW_470_V_Office_3 | | | | | | | | | |
| FLW 470 Advanced P | 45.1 | \$103,842 | \$5,680 | \$109,522 | 1,153,805 | 6,418 | | 1,001.5 | |
| Basic_NO HVAC | 56.8 | \$120,161 | \$10,731 | \$130,892 | 1,335,124 | 12,126 | | 1,230.1 | |
| FLW 470 Basic Pack | 51.6 | \$108,113 | \$10,065 | \$118,178 | 1,201,255 | 11,372 | | 1,081.4 | |

Figure 16-Annual End Use Chart

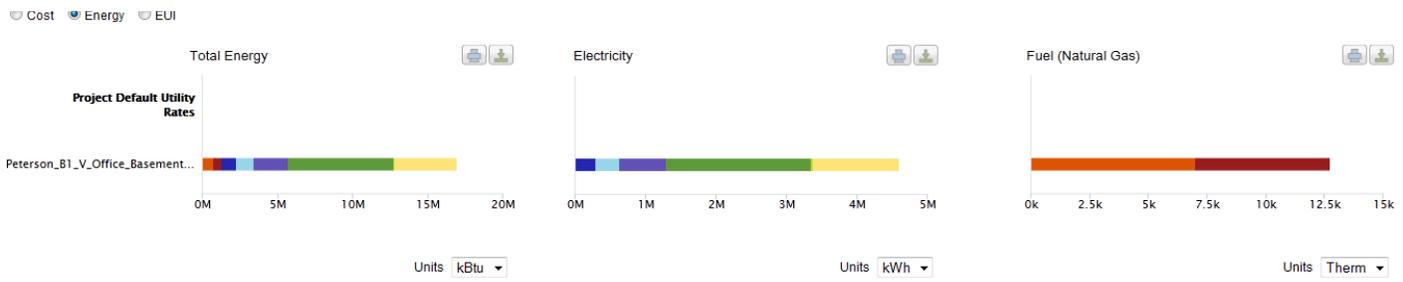

Monthly Data

Display Charts For:

Cost Energy

Chart Sort:

Chronological

Alphabetical

Run Total

Area Lights

Ext Usage

Misc Equip

Space Cooling

Heat Rej

Vent Fans


Pumps Aux

Space Heat

Hot Water


Total Energy

Units: kBTu

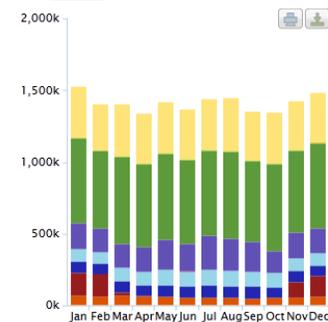

Electricity

Units: kWh

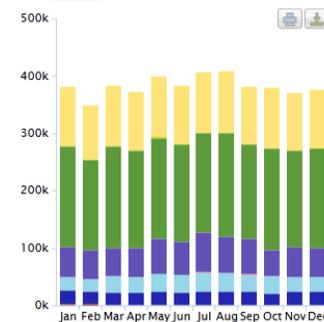

Fuel (Natural Gas)

Units: Therm

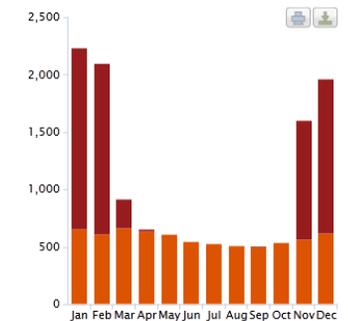


Figure 17-REM Analysis Charts

| Floor Area (ft²) | Energy Use Intensity (kBtu/ft²/year) ? | Electric Cost (/kWh) | Fuel Cost (/Therm) | Total Annual Cost ¹ | | | Total Annual Energy ¹ | | |
|------------------|--|----------------------|--------------------|--------------------------------|-------|---------|----------------------------------|--------------|-------------------------|
| | | | | Electric | Fuel | Energy | Electric (kWh) | Fuel (Therm) | Carbon Emissions (tons) |
| 4,834 | 69.0 | \$0.06 | \$0.66 | \$3,737 | \$799 | \$4,536 | 62,286 | 1,210 | 63.0 |

Energy and Carbon Results
US EPA Energy Star
Water Usage
Photovoltaic Analysis
LEED Daylight
Design Alternatives

1 Base Run

Energy, Carbon and Cost Summary

Annual Energy Cost **\$4,536**
 Lifecycle Cost **\$61,776**

Annual CO₂ Emissions

Electric **56.0 tons**
 Onsite Fuel **7.0 tons**
 Large SUV Equivalent **5.7 SUVs / Year**

Annual Energy

Energy Use Intensity (EUI) **69 kBtu / ft² / year**
 Electric **62,286 kWh**
 Fuel **1,210 Therms**
 Annual Peak Demand **19.7 kW**

Lifecycle Energy

Electric **1,868,595 kW**
 Fuel **36,296 Therms**

Carbon Footprint

Base Run Carbon Neutral Potential ?

| Annual CO ₂ Emissions | tons |
|-------------------------------------|--------------|
| 1 Base Run | 63.0 |
| Onsite Renewable Potential | -94.6 |
| Natural Ventilation Potential | -11.7 |
| Onsite Biofuel Use | -7.0 |
| Net CO₂ Emissions | -50.3 |

Net Large SUV Equivalent: **-4.6 SUVs / Year**

Assumptions **i**

Electric Power Plant Sources in Your Region

| | |
|---------------|------|
| Fossil | 83 % |
| Nuclear | 15 % |
| Hydroelectric | 0 % |
| Renewable | 2 % |
| Other | N/A |

Assumptions **i**

REM Analysis Charts (continued)

LEED Daylight [\(more details\)](#)

Percentage of building area with glazing factor over 2%: **64.3% - No LEED Credit**

LEED Water Efficiency [\(more details\)](#)

| | Gal / yr | \$ / yr |
|--------------|---------------|--------------|
| Indoor: | 60,122 | \$366 |
| Outdoor: | 26,100 | \$68 |
| Total | 86,222 | \$433 |

Natural Ventilation Potential

Total Hours Mechanical Cooling Required: 3,777 Hours

Possible Natural Ventilation Hours: 2,749 Hours

Possible Annual Electric Energy Savings: 10,871 kWh

Possible Annual Electric Cost Savings: \$652

Net Hours Mechanical Cooling Required: 1,028 Hours

Assumptions [\(i\)](#)

Photovoltaic Potential [\(more details\)](#)


| | |
|-----------------------------|-------------------------|
| Annual Energy Savings: | 84,976 kWh |
| Total Installed Panel Cost: | \$299,684 |
| Nominal Rated Power: | 60 kW |
| Total Panel Area: | 4,673 ft ² |
| Maximum Payback Period: | 39 years @ \$0.06 / kWh |

Wind Energy Potential

Annual Electric Generation: 2,785 kWh

Assumptions [\(i\)](#)


Annual Electric End Use

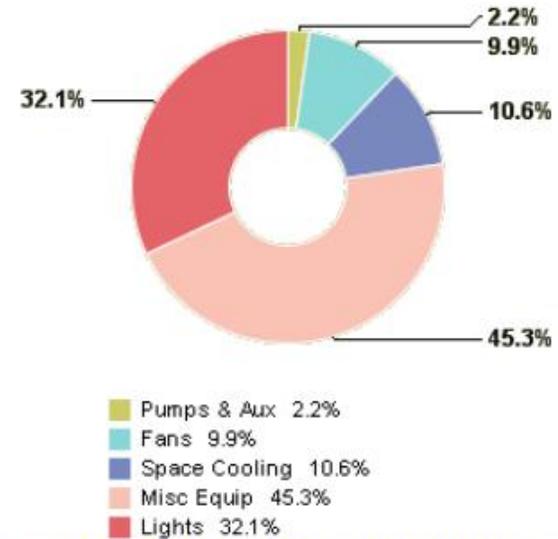

ChartDirector (unregistered) from www.advsofteng.com

[Basic View](#) | [Detailed View](#)

Annual Fuel End Use

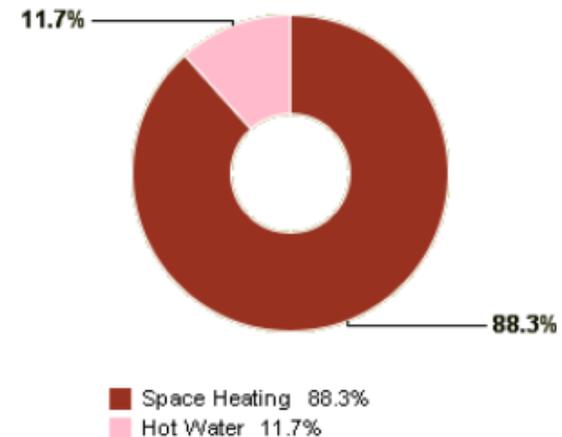

ChartDirector (unregistered) from www.advsofteng.com

[Basic View](#) | [Detailed View](#)

6.0 PERFORMANCE ASSESSMENT

Data collected during the demonstration provides information necessary to assess the effectiveness of Rapid Energy Modeling relative to the performance objectives defined in Table 1. The following discussion provides summary of the analysis in support of the performance objectives.

6.1 OVERALL CORRELATION OF MODELED RESULTS TO METER DATA

These measures quantified the effectiveness of Rapid Energy Modeling to estimate natural gas, electric and overall energy usage of individual buildings within 10% error compared to meter data provided by the installation. Prior case studies that guided establishment of the 10% error targeted traditional commercial office buildings with standard operating hours and usage. DoD buildings in the sample vary widely in their occupancy and usage and a re-established success criteria of $\leq 20\%$ error is a better metric to evaluate forecast accuracy. Mean Bias Error (MBE) and mean absolute percentage error (MAPE) are used to assess forecast performance. Lewis's interpretation of MAPE results (1982) is criteria used to judge the accuracy of the forecast and is summarized in Table 2.

Energy use is a frequently tracked metric for many buildings, yet there are many buildings that do not have meters installed, meters are not functioning and or data is not usable (see list of meter-related issues in Section 8.0). Rapid energy modeling predicts how buildings should be performing (or where buildings are potentially used in non-standard ways), based on their use profile, unique geometry, generalized use schedules and location and construction characteristics for buildings of their type and region. Where model input parameters are not known, many sources are used to define defaults based on CBECS, design tables within ASHRAE/IESNA Standard 90.1-2004, scientific research papers and modeling best practices. This provides a rational baseline of information from which to make asset management decisions.

The models predicted energy usage using Green Building Studio, driven by the DOE 2.2 engine. Meter data received from the installations was reviewed by a third party (ERDC-CERL) prior to comparison with modeled estimates. In some cases, despite verification, subsequent issues were encountered with the meter data that required removal from the study or aspects of the analysis. Of a population of 35 buildings, a total of 23 buildings were included in core analyses. 12 buildings were excluded from core analyses due to:

- Questionable meter data and scaling issues - 3 Earle buildings, 1 JBLM building
- Building occupancy concerns (FLW 1 building; JBLM 1 building)
- Absence of natural gas data (Port Hueneme, 3 buildings; Great Lakes 3 buildings)

The removed buildings were analyzed separately to the extent possible and are summarized in Appendix C.

Electric Results

Overall, the mean absolute percentage error for electric results was 18.12%, representing average accuracy of 81.88% (n=23) (Table 8; Figure 22). Although MAPE of 18.12% is outside of the success criteria described in the performance objectives, stated as $\pm 10\%$, it is still considered a "good" forecast according to criteria established by Lewis (1982). Correlations in energy use curves were evident in most buildings.

Natural Gas Results

Natural gas results for the 23 analyzed buildings had a MAPE of 41.80%, or an absolute average accuracy of 58.20% (Table 7). This is outside of the project's stated success criteria of +/- 10% error, but is considered to be within the criteria of a "reasonable" forecast Lewis (1982), as it is within the range of 21-50%. In general, the models appear to be less accurate in predicting actual natural gas usage than electric usage in DoD buildings. This may be due to errors in modeling results, but the natural gas model results align closer with CBECS natural gas values than the metered natural gas values and may point to other sources of error. Natural gas is much more sensitive to HVAC settings and climate than electricity because natural gas in the energy model is only for:

1. Hot water (very small amount but very sensitive to user operation)
2. Heating (very sensitive to climate and building operation); feedback from personnel indicates that HVAC systems are often operated excessively
3. Reheat (very sensitive to HVAC settings and often set up very poorly)
4. Infiltration
5. Various very large process loads like a pool, cafeteria, or other unique things that are not typically part of a rapid energy model

These issues can be checked fairly easily in buildings and are good candidates for re-commissioning. Overall, metered values are much higher than modeled values, with the exception of a LEED building, and two dorm buildings with questionable occupancy levels.

Energy Use Intensity Results

EUI results had a MAPE of 22.44% (N=23), representing 77.56% absolute average accuracy in EUI predictions (SD=13.48%). This MAPE for the pooled set of buildings is within the stated performance objective criteria of +/- 25% error, and is considered "reasonable" according to established criteria, as it falls between 21%-50% MAPE (Table 7). Absolute error for individual buildings is summarized in Figure 18. The highest energy use, represented by EUI (kBtu/ ft²), was found in a cafeteria, dormitories and a gymnasium (Figure 19 and 20).

In most cases, there was closer alignment of simulation data to CBECS result, and researchers attribute the deviation between the model and meter data to buildings that are performing worse than should be expected based on their attributes.

To further explore the results, analyses were clustered by building use type and plotted against benchmarking results from the CBECS 2003 survey. Examination of this range of buildings improved the findings of the demonstration by allowing visibility of trends within use categories. The various building types included:

- 13 offices
- 5 barracks
- 5 specialty use buildings (fire station, gym, school, auto facility, cafeteria)

Table 7-Summary Data for All Analyzed Buildings (n=23) (See also Appendix B)

| Statistics | Electric | Natural Gas | EUI |
|--------------------------------|----------|-------------|--------|
| Average Accuracy | 81.88% | 58.20% | 77.56% |
| Mean Absolute Percentage Error | 18.12% | 41.80% | 22.44% |

Figure 18-Comparison of Absolute Error Percentages Across Buildings

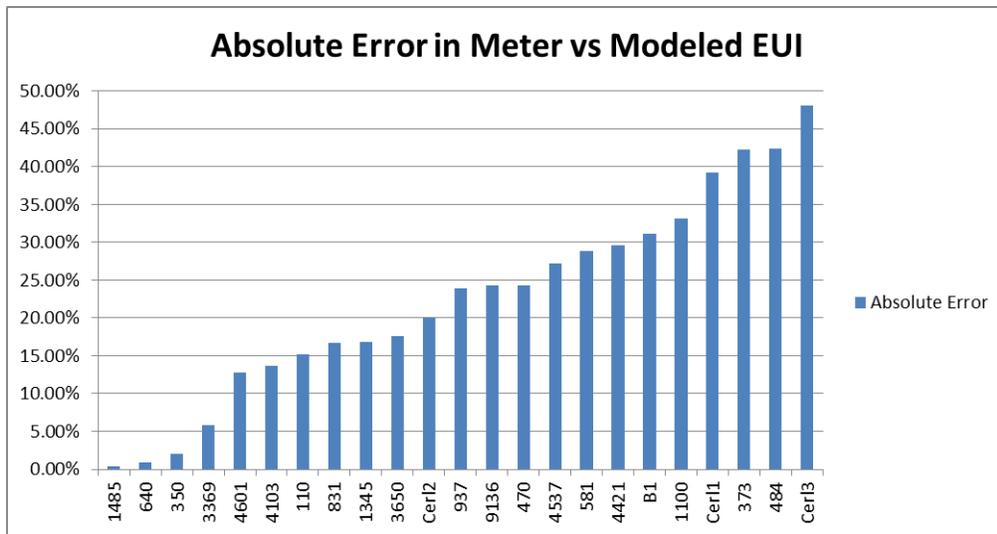


Figure 19-Comparison of Meter and Model Data in Relative kBtu/ ft²


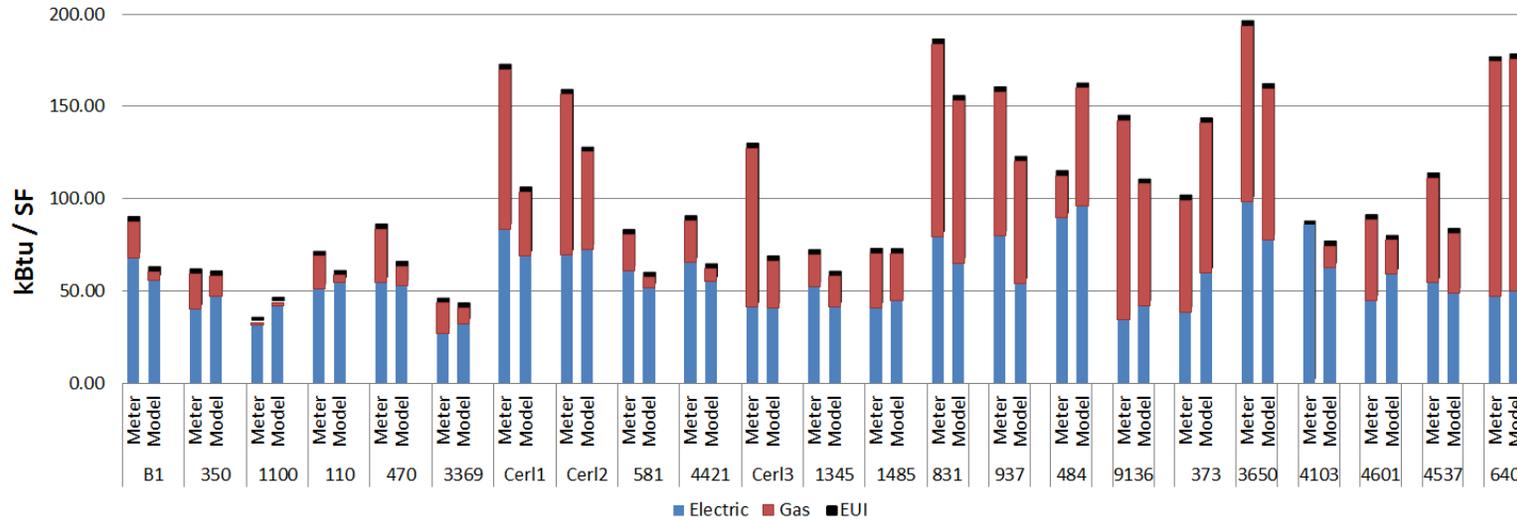


Figure 20-Comparison of Meter and Model Data in Relative kBtu/ ft²

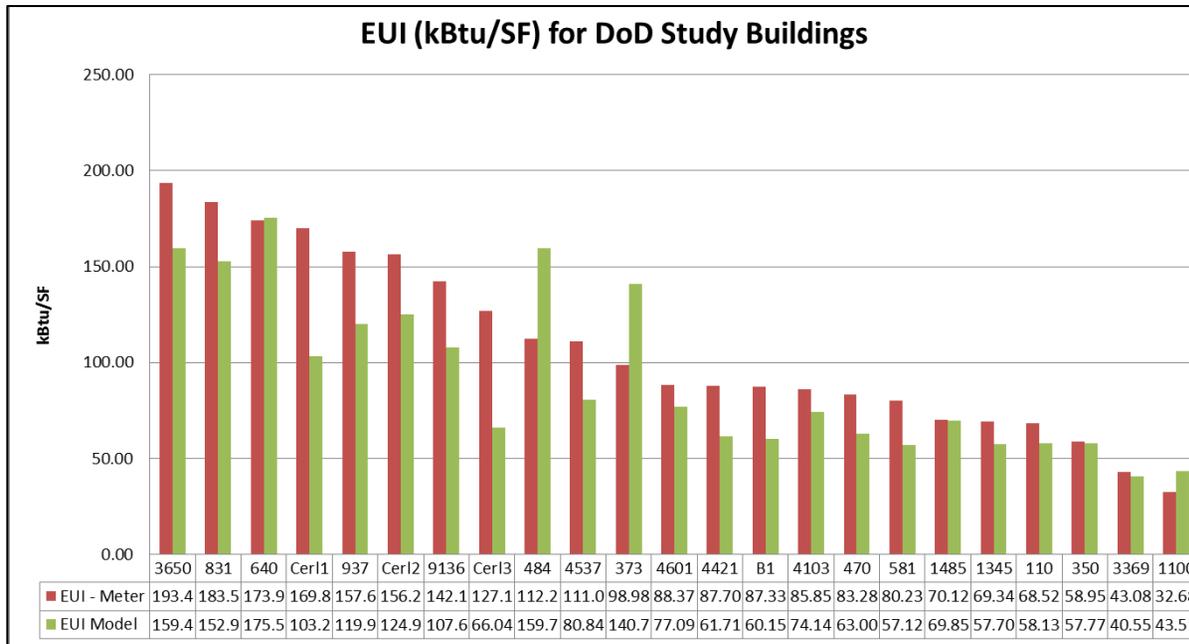

6.1.1 Offices Subset

In total, 13 offices across seven Army, Navy and Air Force locations participated in the core analysis in the study. The offices ranged in size from 4,800 gross square feet to 281,732 gross square feet (Table 8).

Table 8-Office Buildings - Photos

| | |
|--|---|
|  <p>Building 1 – Peterson AFB, CO</p> |  <p>Building 350 – Peterson AFB, CO</p> |
|  <p>Building 3369 – JBLM, WA</p> |  <p>Building 1100 – Port Hueneme, CA</p> |
|  <p>Building 110 – Panama City, FL</p> |  <p>Building 470 – Fort Leonard Wood, MO</p> |
|  <p>Building 4421 – Seymour AFB, NC</p> |  <p>Building 581 – Panama City, FL</p> |
|  <p>CERL 1 – ERDC-CERL, Champaign, IL</p> |  <p>CERL 2 – ERDC-CERL, Champaign, IL</p> |
|  <p>CERL 3 – ERDC-CERL, Champaign, IL</p> |  <p>Building 1485, Peterson AFB, CO</p> |
|  <p>Building 1345, Peterson AFB, CO</p> | |

The offices overall averaged 85.70% in accuracy when comparing modeled estimates for electric data to electric meter data, representing average MAPE of 14.30%, considered a good forecast based on criteria proposed by Lewis (1982). While electric modeling results for offices aligned closely with actual metered usage, natural gas models for offices were on average only 49.48% accurate, with a MAPE of 50.52%, which is considered a reasonable forecast, but is on the cusp of being considered inaccurate (MAPE $\geq 51\%$).

Energy surveys were revisited to investigate buildings where modeled estimates were more than 20% different than meter data. For the office electric data, only Naval building 1100 in Port Hueneme (33.83% error) and Office Building 1345 at Peterson (-21.33% error) were outside of this threshold (Table 10; Figure 25). The energy model for Building 1100 estimated electricity usage at higher levels that were indicated by the building meters for this building (Figure 21 and 22). Port Hueneme was the only installation that could not identify their HVAC systems, so researchers used general descriptions and observations to attempt the appropriate HVAC selection. It is possible that that modeled heating and cooling days are not in alignment. Building 1345 is a small bank building, and the energy model underestimated energy usage. The modeled and metered electric data are well aligned in trend profiles and usage from May – September, however in October – April metered there were amplitude differences and usage was higher than predicted by the model (Figure 26). This difference could be related to seasonal weather conditions for the year.

Only three buildings were $\geq 80\%$ accurate for natural gas estimates and those included: Port Hueneme 1100 and the two smallest buildings, 1345 and 1485 at Peterson AFB (Table 9; Figure 21). The office buildings demonstrated correlation in trend profile shape, but had significant amplitude differences, with the building consuming more natural gas than predicted by the model.

In all cases, with the exception of Building 1100, building natural gas meter and EUI data is higher than what is predicted in the models. While the possibility exists that differences could be attributed to natural gas use related calculations in the models, it should be noted that in general, building natural gas usage and EUI were also significantly higher than CBECS values. Researchers attribute the deviation between the model, meter, and CBECS results to buildings that are performing worse than should be expected based on their location and attributes.

Figure 21-Percent Deviation - Model vs. Meter Data (Offices)


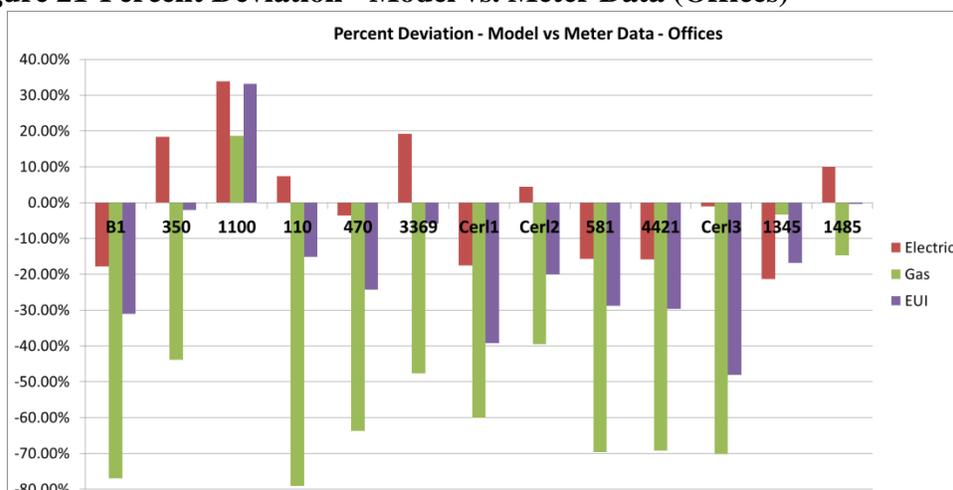



Table 9-Summary Data for Offices

| Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI (kBtu/SF) | Accuracy Model Vs Meter - Absolute (EUI) |
|---------------------------------|-------------------------|------------|---|-------|----------------|----------------------|--|---|------------------|------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| B1 | Office | Air Force | 281,732 | CO | 5,590,418 | 4,593,182 | -17.84% | 82.16% | 5524 | 1270.54 | -77.00% | 23.00% | 87.33 | 60.15 | -31.12% | 68.88% |
| 350 | Office | Air Force | 148,801 | CO | 1,728,137 | 2,046,233 | 18.41% | 81.59% | 2873.363 | 1611.969 | -43.90% | 56.10% | 58.95 | 57.77 | -2.00% | 98.00% |
| 1100 | Office | Navy | 120,925 | CA | 1,105,292 | 1,479,161 | 33.83% | 66.17% | 179.1 | 212.5311 | 18.67% | 81.33% | 32.68 | 43.51 | 33.14% | 66.86% |
| 110 | Office | Navy | 119,050 | FL | 1,768,200 | 1,897,648 | 7.32% | 92.68% | 2122.8 | 443.871 | -79.09% | 20.91% | 68.52 | 58.13 | -15.17% | 84.83% |
| 470 | Office | Army | 101,565 | MO | 1,621,858 | 1,564,214 | -3.55% | 96.45% | 2922.467 | 1060.139 | -63.72% | 36.28% | 83.28 | 63.00 | -24.35% | 75.65% |
| 3369 | Office | Joint Base | 59,578 | WA | 469,930 | 560,350 | 19.24% | 80.76% | 962.9 | 503.6395 | -47.70% | 52.30% | 43.08 | 40.55 | -5.87% | 94.13% |
| Cer1 | Office | Army | 52,739 | IL | 1,288,807 | 1,062,475 | -17.56% | 82.44% | 4560.38 | 1820.617 | -60.08% | 39.92% | 169.88 | 103.28 | -39.20% | 60.80% |
| Cer2 | Office | Army | 48,301 | IL | 979,952 | 1,022,858 | 4.38% | 95.62% | 4200.35 | 2543.372 | -39.45% | 60.55% | 156.21 | 124.93 | -20.02% | 79.98% |
| 581 | Office | Navy | 40,287 | FL | 716,700 | 604,483 | -15.66% | 84.34% | 786.1 | 238.2419 | -69.69% | 30.31% | 80.23 | 57.12 | -28.80% | 71.20% |
| 4421 | Office | Air Force | 37,088 | NC | 706,325 | 594,687 | -15.81% | 84.19% | 842 | 259.2037 | -69.22% | 30.78% | 87.70 | 61.71 | -29.63% | 70.37% |
| Cer3 | Office | Army | 23,639 | IL | 282,577 | 279,563 | -1.07% | 98.93% | 2040.17 | 606.9196 | -70.25% | 29.75% | 127.10 | 66.04 | -48.04% | 51.96% |
| 1345 | Office - Bank | Air Force | 7,772 | CO | 118,197 | 92,989 | -21.33% | 78.67% | 135.53 | 131.0553 | -3.30% | 96.70% | 69.34 | 57.70 | -16.79% | 83.21% |
| 1485 | Office - Bank | Air Force | 4,834 | CO | 57,680 | 63,413 | 9.94% | 90.06% | 142.1 | 121.2382 | -14.68% | 85.32% | 70.12 | 69.85 | -0.38% | 99.62% |
| Summary Data for Offices | | | | | | | Average Accuracy | 85.70% | | | Average Accuracy | 49.48% | | | Average Accuracy | 77.34% |
| | | | | | | | Mean Absolute Percentage Error (MAPE) | 14.30% | | | MAPE | 50.52% | | | MAPE | 22.66% |
| | | | | | | | STDEV | 8.93% | | | STDEV | 25.15% | | | STDEV | 14.41% |
| | | | | | | | CoV | 10.41 | | | CoV | 50.84 | | | CoV | 18.63 |
| | | | | | | | MFE | 2.01 | | | MFE | 18.81 | | | MFE | 21 |
| | | | | | | | MAD | 7.21 | | | MAD | 18.85 | | | MAD | 22 |
| | | | | | | | MSE | 70.28 | | | MSE | 684.38 | | | MSE | 913.06 |


Figure 22-Monthly Natural Gas and Electric Charts - Offices

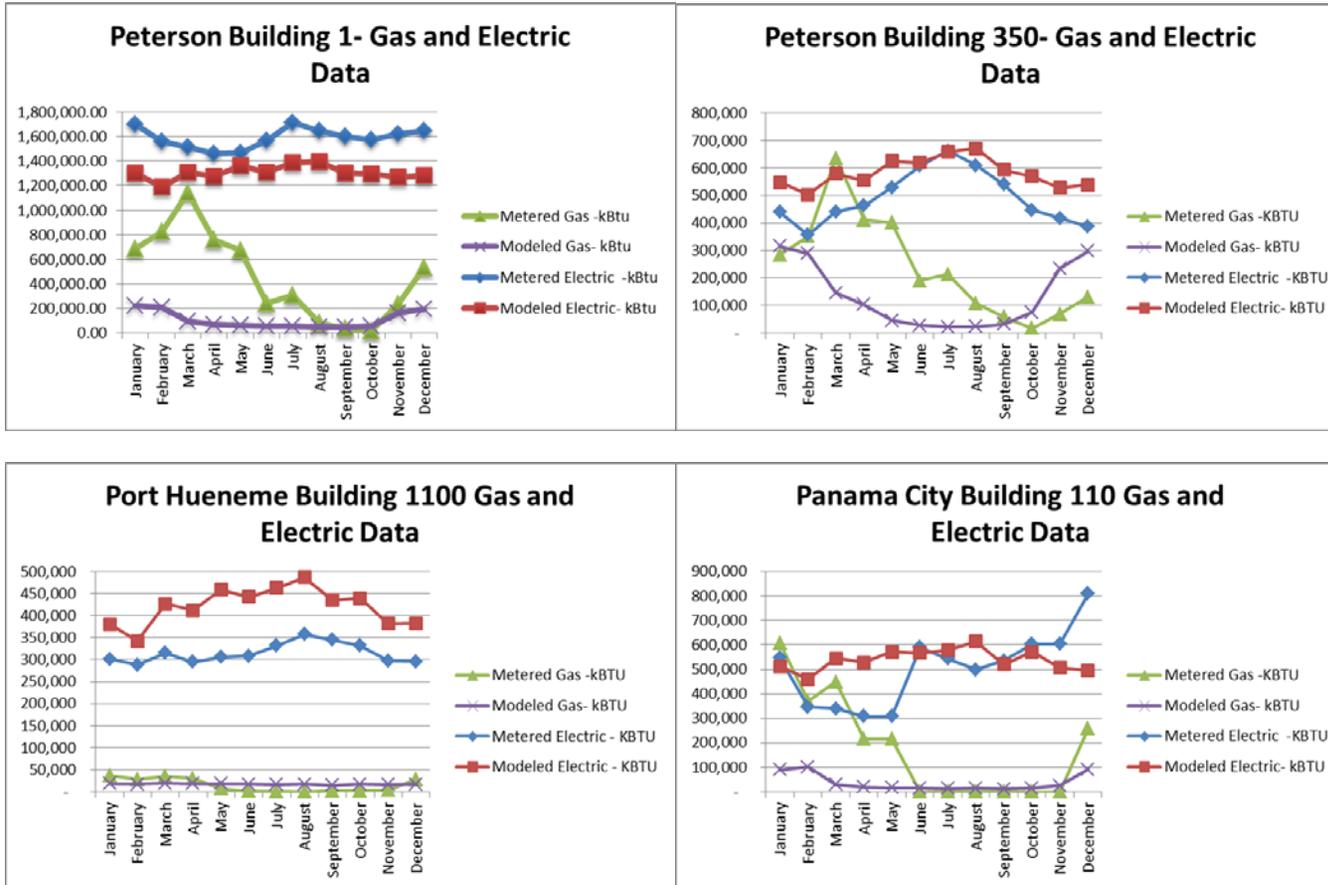


**Fort Leonard Wood Building 470 Gas
Electric Data**

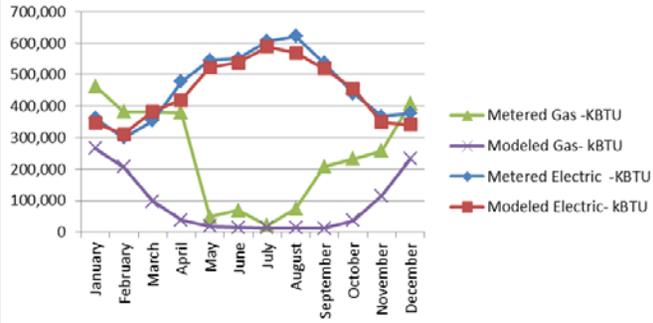


JBLM Building 3369 Gas and Electric Data

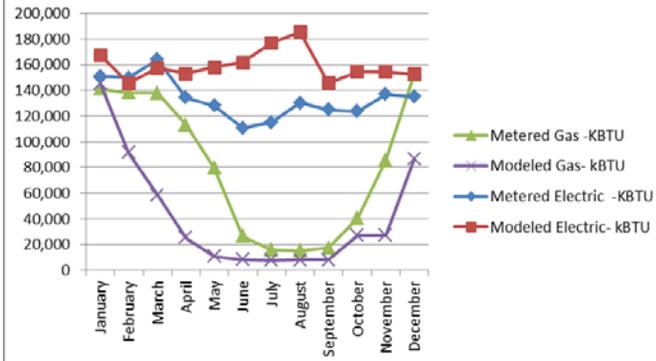


CERL Building 1 Gas and Electric Data

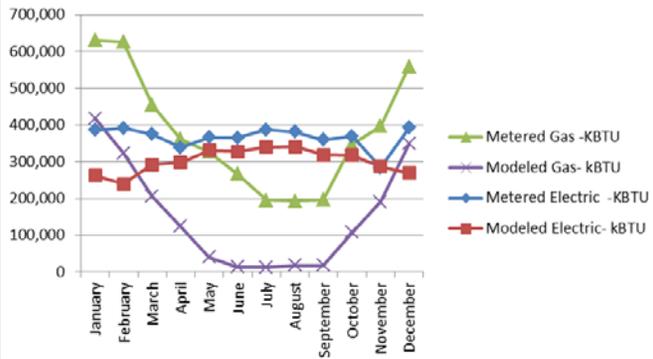


CERL Building 2 Gas and Electric Data

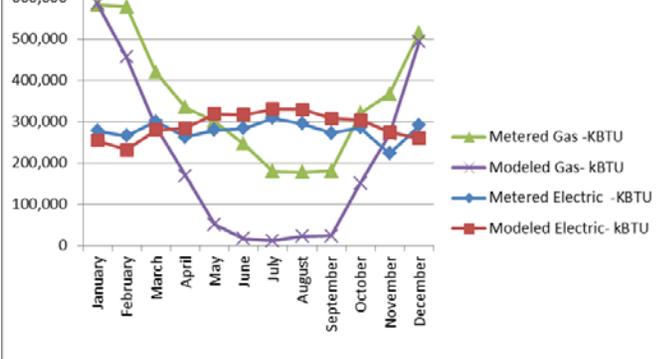


CERL Building 3 Gas and Electric Data

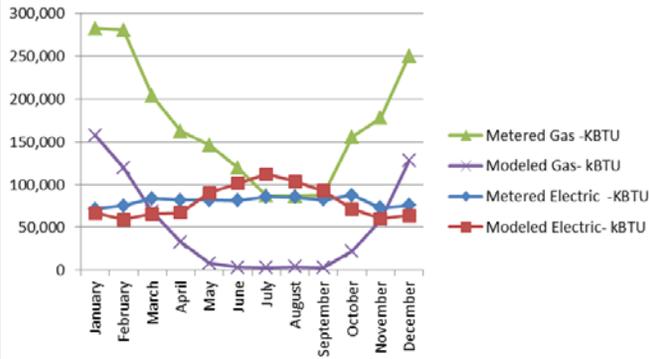


Panama City Building 581 Gas and Electric Data

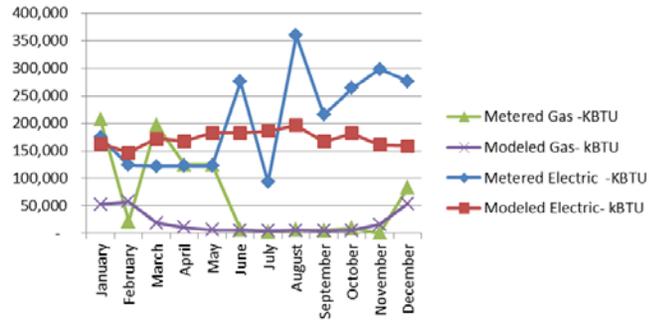


Seymour Building 4421 Gas and Electric Data

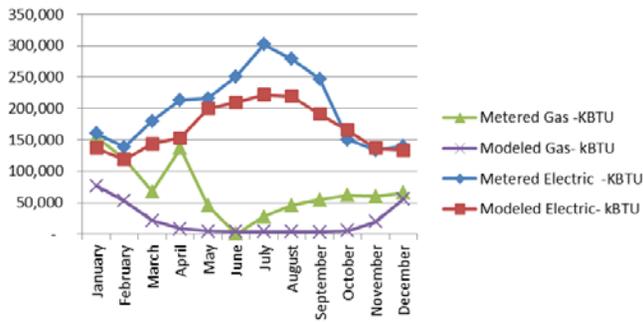

Peterson Building 1345 Gas and Electric Data

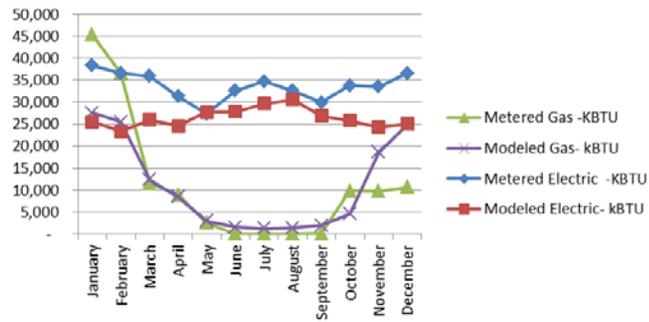

Peterson Building 1485 Gas and Electric Data

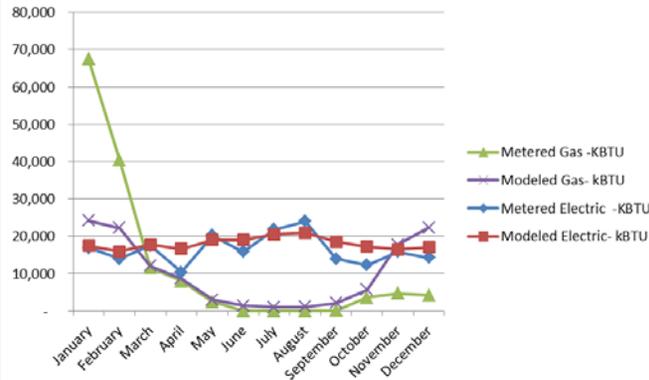

Overall, modeled and metered electric results aligned relatively well with CBECS 2003 benchmarking results for office building (Table 10, Figure 23). MAPE for Electric meter data compared to CBECS was 30.13% (69.87% average accuracy).

Natural gas meter data deviated greatly from CBECS with MAPE of 122.44% (-22.44% accuracy), while model data was closer aligned to CBECS with MAPE = 42.05% (57.95% accuracy).

The Rapid Energy Modeling workflow seems reasonably accurate for estimating overall EUI for DoD office buildings. Overall, of 13 offices sampled the MAPE was 22.66%, or an average of 77.34% accurate. Three office buildings (350, 3369 and 1485) were within 90% accuracy and an additional three (110, CERL 2, and 1345) were within 80% accuracy. With the exception of Building 1100 in Port Hueneme, all other office buildings had EUI meter data that was higher than predicted EUI for each building.

Conclusion

Overall, the REM workflow appears to be a good method for predicting electric usage and a reasonable method for EUI predictions for DoD office buildings when looking at mean absolute percentage errors for the pooled set of office buildings.


The high variability in natural gas results for individual buildings and overall mean absolute percentage error for the pooled set of office buildings needs further investigation. DoD office buildings are consuming significantly more natural gas and have higher EUI values than predicted by the models and compared to similar buildings in the CBECS database.

Energy use curves and trend profiles provide insight on seasonal variations, deviations and correlations for the buildings. Deviations are likely attributed to faulty meter readings, weather anomalies, or operational and mechanical issues at the individual building level. Next steps should include working with individual building managers to investigate operations, system configurations and settings and to attempt to elucidate understanding around spikes in usage or other anomalies in the meter data. In some cases, there may be issues with the meter data itself and there is also a possibility that the meter data was submitted for a weather year that was atypical.

Table 10-Comparison of Office Meter and Model Data to CBECS

| Building Number | Metered Electric - kBTU / SF | Modeled Electric- kBTU /SF | CBECS Electric kBTU / SF | ELECTRIC <u>Meter</u> Difference from CBECS | ELECTRIC <u>Model</u> Difference from CBECS | Metered Gas -KBTU / SF | Modeled Gas- kBTU / SF | CBECS Gas KBTU/SF | GAS Meter Difference from CBECS- | GAS Model Difference from CBECS | Total Metered kBtu/SF | Total Modeled kBTU /SF | CBECS Total KBTU /SF | Meter Difference from CBECS | Model Difference from CBECS |
|-----------------|------------------------------|----------------------------|--------------------------|---|---|------------------------|------------------------|-------------------|----------------------------------|---------------------------------|-----------------------|------------------------|----------------------|-----------------------------|-----------------------------|
| B1 | 67.72 | 55.64 | 89.39 | -24.24% | -37.75% | 19.61 | 4.51 | 50.39 | -61.09% | -91.05% | 87.33 | 60.15 | 139.78 | -37.52% | -56.97% |
| 350 | 39.64 | 46.93 | 61.30 | -35.34% | -23.44% | 19.31 | 10.83 | 16.61 | 16.26% | -34.78% | 58.95 | 57.77 | 77.91 | -24.34% | -25.85% |
| 1100 | 31.20 | 41.75 | 48.63 | -35.85% | -14.15% | 1.48 | 1.76 | 8.13 | -81.78% | -78.38% | 32.68 | 43.51 | 56.76 | -42.43% | -23.35% |
| 110 | 50.69 | 54.40 | 64.32 | -21.19% | -15.42% | 17.83 | 3.73 | 3.08 | 478.93% | 21.05% | 68.52 | 58.13 | 67.40 | 1.67% | -13.75% |
| 470 | 54.50 | 52.56 | 71.75 | -24.04% | -26.74% | 28.77 | 10.44 | 21.26 | 35.35% | -50.90% | 83.28 | 63.00 | 93.01 | -10.47% | -32.26% |
| 3369 | 26.92 | 32.10 | 72.39 | -62.81% | -55.66% | 16.16 | 8.45 | 35.58 | -54.58% | -76.24% | 43.08 | 40.55 | 107.97 | -60.10% | -62.44% |
| Cer11 | 83.41 | 68.76 | 60.52 | 37.81% | 13.61% | 86.47 | 34.52 | 35.02 | 146.92% | -1.42% | 169.88 | 103.28 | 95.54 | 77.81% | 8.10% |
| Cer12 | 69.24 | 72.28 | 60.52 | 14.42% | 19.43% | 86.96 | 52.66 | 35.02 | 148.32% | 50.36% | 156.21 | 124.93 | 95.54 | 63.50% | 30.77% |
| 581 | 60.72 | 51.21 | 69.88 | -13.11% | -26.72% | 19.51 | 5.91 | 5.80 | 236.42% | 1.96% | 80.23 | 57.12 | 75.68 | 6.01% | -24.52% |
| 4421 | 65.00 | 54.73 | 42.93 | 51.41% | 27.48% | 22.70 | 6.99 | 9.38 | 142.04% | -25.49% | 87.70 | 61.71 | 52.31 | 67.66% | 17.98% |
| Cer13 | 40.80 | 40.36 | 49.47 | -17.53% | -18.41% | 86.31 | 25.67 | 38.76 | 122.67% | -33.76% | 127.10 | 66.04 | 88.23 | 44.06% | -25.15% |
| 1345 | 51.91 | 40.84 | 63.41 | -18.14% | -35.60% | 17.44 | 16.86 | 35.33 | -50.64% | -52.27% | 69.34 | 57.70 | 98.74 | -29.77% | -41.57% |
| 1485 | 40.72 | 44.77 | 63.41 | -35.78% | -29.39% | 29.40 | 25.08 | 35.33 | -16.80% | -29.01% | 70.12 | 69.85 | 98.74 | -28.98% | -29.26% |
| | | | MAPE (absolute) | 30.13% | 26.45% | | MAPE (absolute) | | 122.44% | 42.05% | | MAPE (absolute) | | 38.02% | 30.15% |
| | | | Average Accuracy | 69.87% | 73.55% | | Average Accuracy | | -22.44% | 57.95% | | Average Accuracy | | 61.98% | 69.85% |

Figure 23-Comparison of Office Meter and Model Data to CBECS

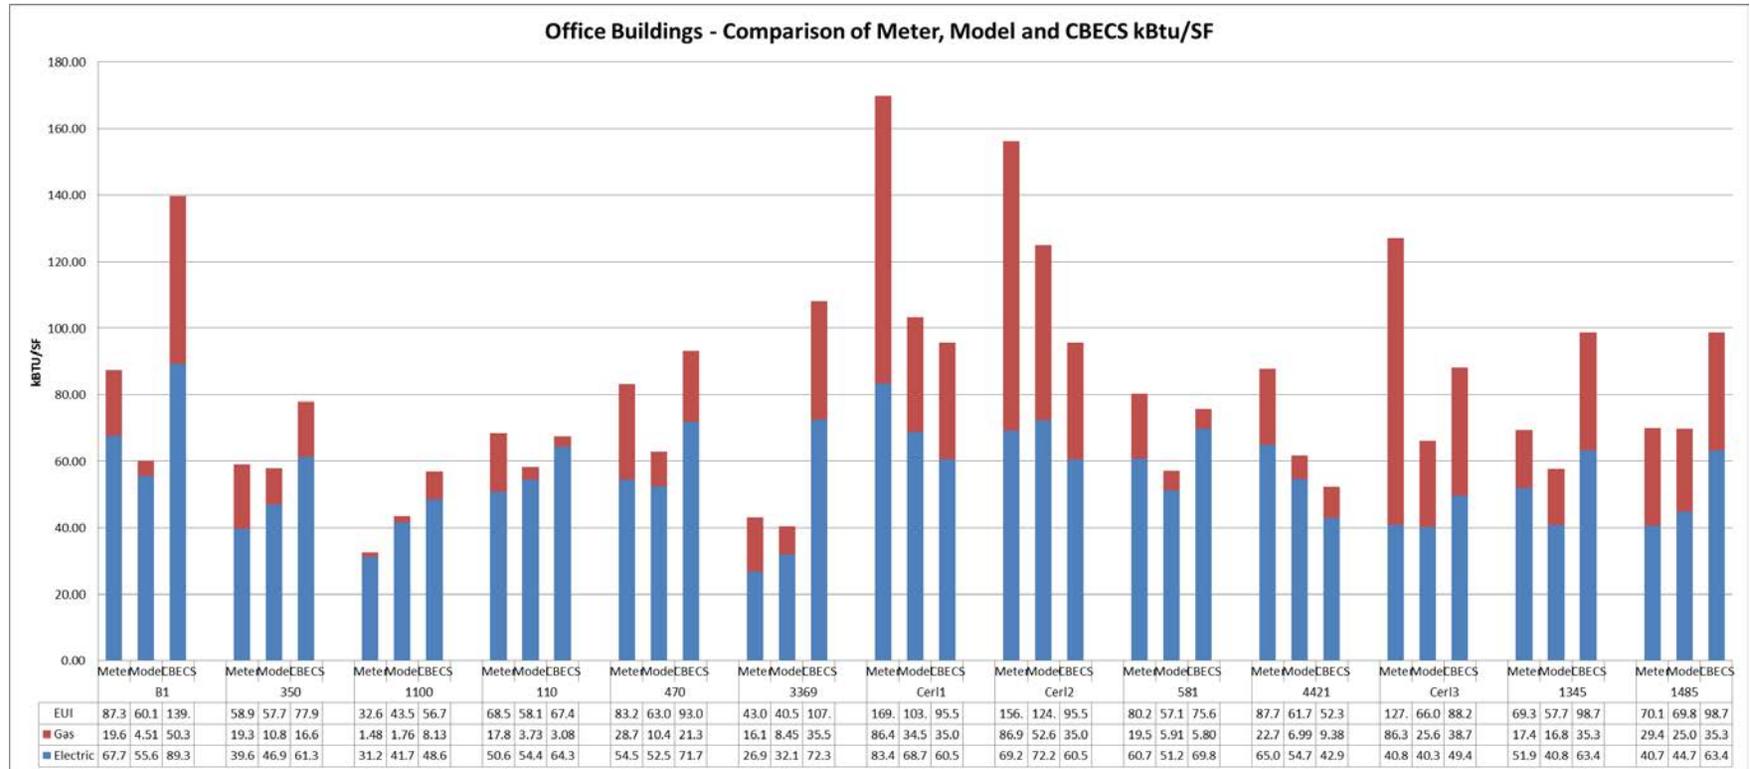

6.1.2 Barracks Subset

Of 23 buildings analyzed, five were dormitories ranging in size from 25,349 GSF to 96,130 GSF. There were an additional 4 dormitories sampled that were not included in core analysis due to questionable meter data.

Table 11-Barracks Buildings - Photos


| | |
|---|--|
|  <p>Building 9136 – JBLM, WA</p> |  <p>Building 484 – Panama City, FL</p> |
|  <p>Building 831 – Fort Leonard Wood, MO</p> |  <p>Building 937 – Fort Leonard Wood, MO</p> |
|  <p>Building 373 – Portsmouth, ME</p> | |

Overall, dormitory electric estimates were on average 73.25% accurate when compared to meter data (MAPE = 26.75%). While this is outside of the +/- 10% success criteria established in performance objectives, it is considered a reasonable forecast according to Lewis (1982) (Table 2). Modeled natural gas predictions averaged 56.66% accuracy, including an outlier of 179% error at Panama City Building 484, where the model predicted much higher gas usage than was evident when examining meter data. With this outlier removed, natural gas accuracy averaged 73.93% with a mean absolute percentage error of 26.07% (Table 12).

Table 12-Summary Data for Barracks

| Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI (kBtu/SF) | Accuracy Model Vs Meter - Absolute (EUI) |
|---------------------------|-------------------------|------------|---|-------|----------------|----------------------|---|---|------------------|----------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| 831 | Barracks | Army | 40,840 | MO | 948,960 | 777,496 | -18.07% | 81.93% | 4257.628 | 3593.201 | -15.61% | 84.39% | 183.56 | 152.96 | -16.67% | 83.33% |
| 937 | Barracks | Army | 55,724 | MO | 1,296,922 | 880,220 | -32.13% | 67.87% | 4359.926 | 3680.78 | -15.58% | 84.42% | 157.68 | 119.97 | -23.92% | 76.08% |
| 484 | Barracks | Navy | 96,130 | FL | 2,513,700 | 2,693,241 | 7.14% | 92.86% | 2208.8 | 6162.982 | 179.02% | 79.02% | 112.22 | 159.73 | 42.33% | 57.67% |
| 9136 | Barracks | Joint Base | 25,349 | WA | 255,349 | 310,415 | 21.56% | 78.44% | 2732.8 | 1669.32 | -38.92% | 61.08% | 142.19 | 107.65 | -24.29% | 75.71% |
| 373 | Barracks | Navy | 76,282 | ME | 858,400 | 1,329,284 | 54.86% | 45.14% | 4,621 | 6200.039 | 34.17% | 65.83% | 98.98 | 140.75 | 42.20% | 57.80% |
| Summary Data for Barracks | | | | | | | | Avg Accuracy | 73.25% | Average w. outlier removed | | 73.93% | Avg Accuracy | | 70.12% | |
| | | | | | | | | MAPE | 26.75% | | | 26.07% | | | MAPE | 29.88% |
| | | | | | | | | STDEV | 18.07% | | | 12.25% | | | STDEV | 11.71% |
| | | | | | | | | CoV | 24.67 | | | 189.12 | | | CoV | 16.69 |
| | | | | | | | | MFE | 0.999 | | | 12.43 | | | MFE | 2.71 |
| | | | | | | | | MAD | 14.94 | | | 22.78 | | | MAD | 38.42 |
| | | | | | | | | MSE | 279.24 | | | 650.45 | | | MSE | 1510.58 |


Figure 24-Percent Deviation - Model vs. Metered Electric, Natural Gas and EUI for Barracks

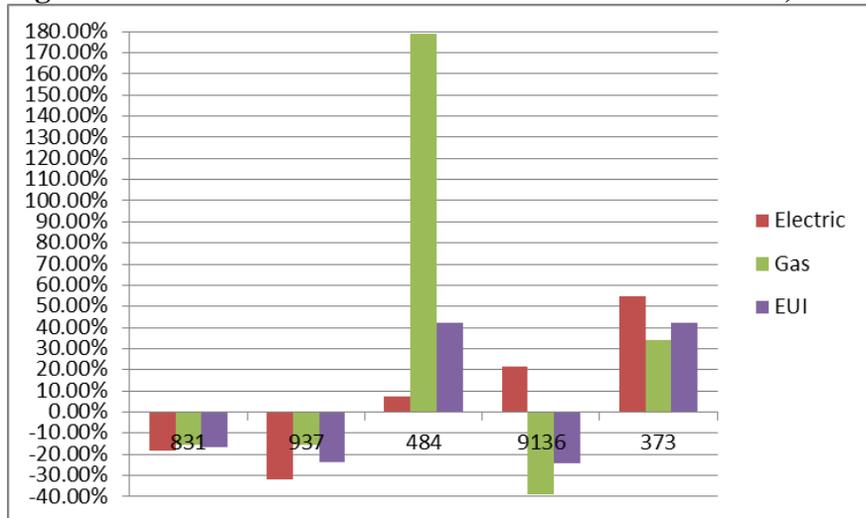

Dorm 484 in Panama City, Florida was the most accurate at 92.86% annually (7.14% MBE) for electric predictions; however there was a high degree of monthly variation between modeled monthly electric data and metered data. Site observations in January 2013 indicated that this large building structure does not operate at full occupancy, which is assumed by the model and when fully occupied may actually use more energy than what is indicated as peak consumption in the model (Figure 28).

Dorm 484 had the largest deviation (179%) between modeled and metered natural gas usage amongst dorms despite having the most accurate electric estimates. The data may indicate an issue with the meter data or very low occupancy in all or a large portion of the building. While onsite, researchers noted that building 484 appeared mostly vacant and functioned more as a hotel as opposed to traditional barracks and that HVAC and hot water systems may be operating at significantly reduced levels due to low occupancy. However it is important to note that natural gas is only 21% of relative consumption for this building, and electric consumption, which accounted for 79% of relative consumption, had a MBE of only 7.14%. With the exception of spikes in February and May, natural gas usage is very low, averaging only 30.88 kBtu per ft², when other dorms averaged between 60-100 kBtu / ft² for natural gas usage. Further research should attempt to identify reasoning behind the low metered natural gas usage for this building (Figure 25).

Figure 25-Dorm 484 Panama City, Florida - Electric and Natural Gas Data

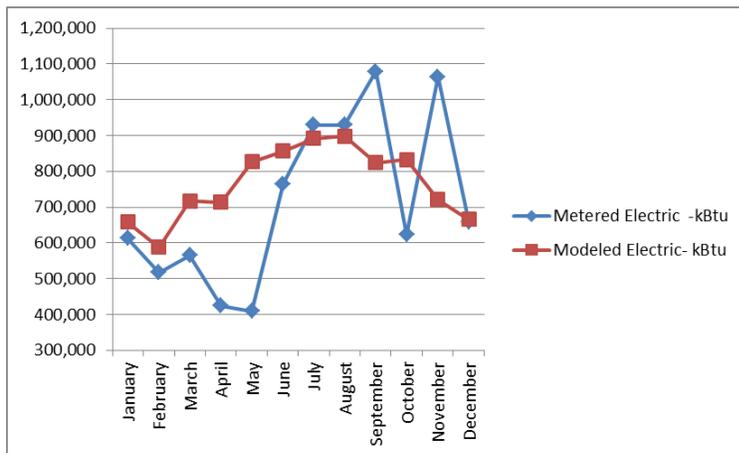


Dorm 373 at Portsmouth in Maine had the greatest deviation compared to the meter data at only 45.14% accurate. Green Building Studio estimated electric usage at a MBE of 54.86% higher than meter data readings. This difference is likely due to occupancy variations in the dorm due to troop deployments or renovations. Monthly energy results indicate periods in May, September and November where usage drops drastically (Figure 26) and this should be investigated further.

These types of occupancy variations are not something that REM is designed to account for, and show one of the primary limitations of the technique. It should be said that even if the tool could account for these variations, it is very unlikely that the input data on occupancy would be available to feed into the energy model.



Dorm 373 was 65.83% accurate in estimate natural gas usage (MBE = 34.17%) with trend profiles that were well aligned in shape but with higher modeled natural gas usage throughout the majority of the year. These differences could be attributed to occupancy issues related to troop deployments or model assumption of 24/7 schedules for dormitories which may not apply to this building.

Figure 26-Dorm 373 Portsmouth Naval Base – Electric and Natural Gas Data

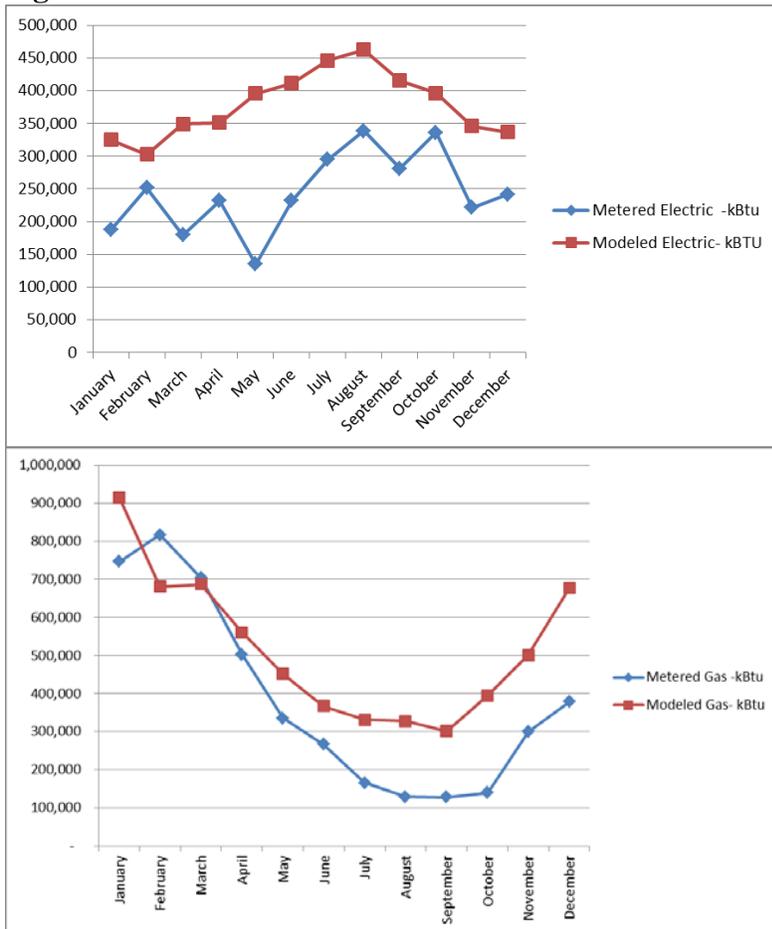

Building 831 at Fort Leonard Wood was 81.93% accuracy for modeled electric predictions compared to meter data (MBE = 18.07%) While Building 831 demonstrated a high degree of accuracy when comparing annual modeled estimates to meter data, monthly estimates showed high variation. It is possible that this building has electrical loads that are higher in summer months due to higher cooling use than was estimated in the model, or high plug loads due to use of personal electronics in dormitory rooms Building 831 model demonstrated 84.39% accuracy for natural gas usage estimates (MBE = 15.61%) and Building 937 at 84.42% accuracy (Table 12 above). Building 831 had an odd natural gas spike in September which could account for the difference, otherwise the overall trend between meter and modeled natural gas usage was well aligned (Figure 27).



Figure 27-Dorm 831 Fort Leonard Wood - Electrical and Natural Gas Data

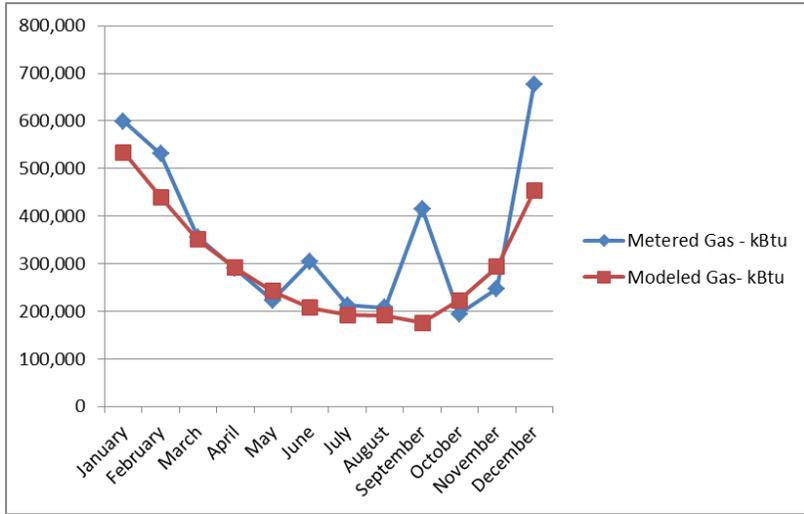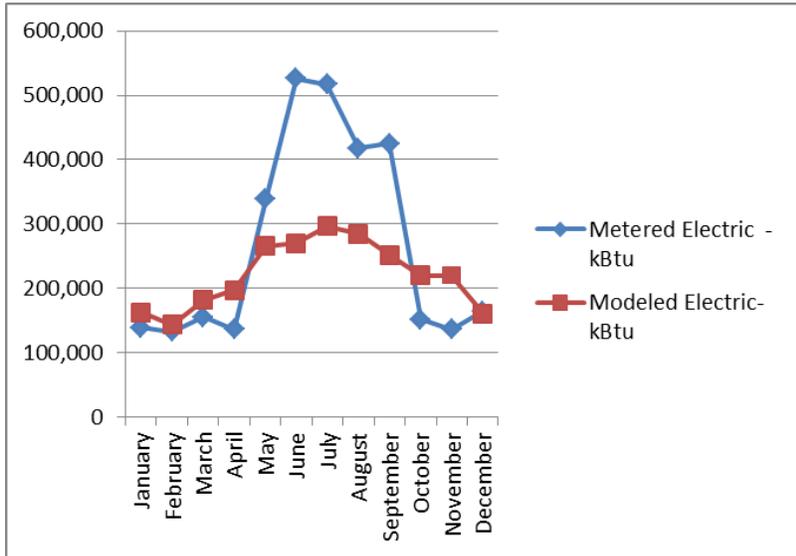

Dorm 937 at Fort Leonard Wood was 67.87% accurate for annual electrical with a MBE - 21.13%. The model and meter data had similar electrical trends for the year with no extreme spikes or drops; however metered usage was significantly higher than modeled estimates from April through September (Figure 28). Natural gas model accuracy was 84.42% with a MBE of - 15.58%. The natural gas trend profile for Dorm 937 was well aligned with the exception of a sharp spike in natural gas meter data in March and higher natural gas usage in October – December (Figure 28).



Typically these spike variations from normal building energy use patterns represent great opportunities to understand how to reduce energy use through better building management or retro-commissioning.

Figure 28-Dorm 937 Fort Leonard Wood- Electrical and Natural Gas Data

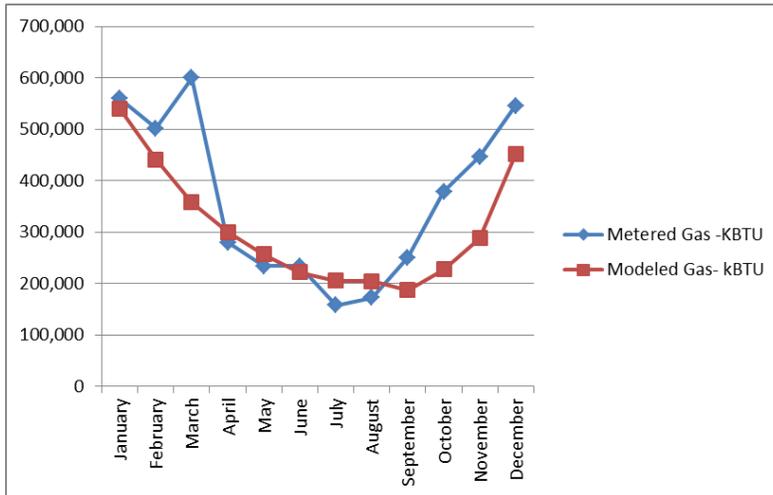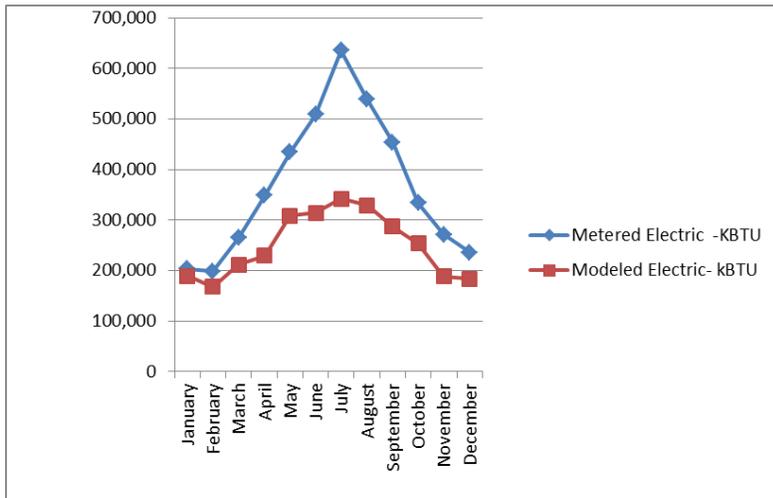

Dorm 9136 at Joint Base Lewis McChord in Washington was 78.44% accurate for electrical use compared to meter data, but had higher modeled electric data than metered data. Dorm 9136 at JBLM was 61.08% accurate in estimating natural gas usage with the energy model compared to meter data. Overall the trend between model and meter natural gas data is well aligned throughout the majority of the year; however usage is significantly higher than modeled usage from February through May and November through December (Figure 29).


Figure 29-Dorm 9136 Joint Base Lewis McChord - Electric and Natural Gas Data

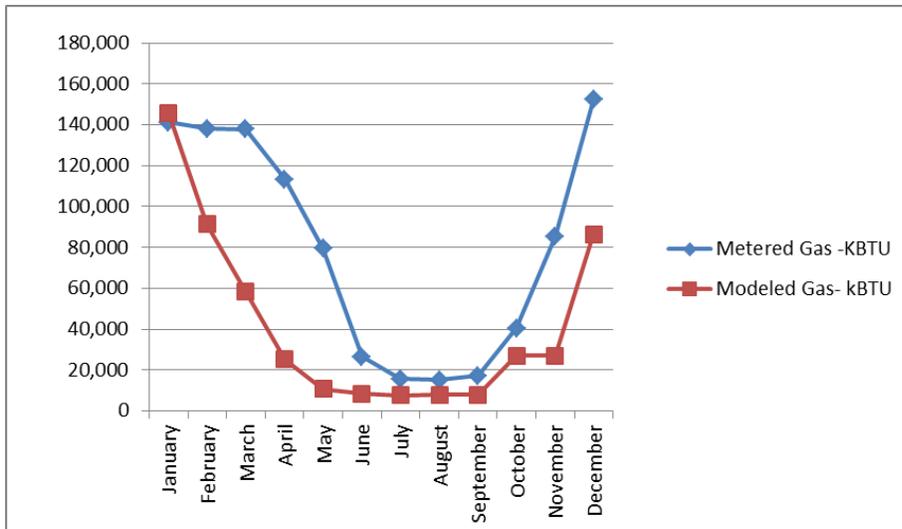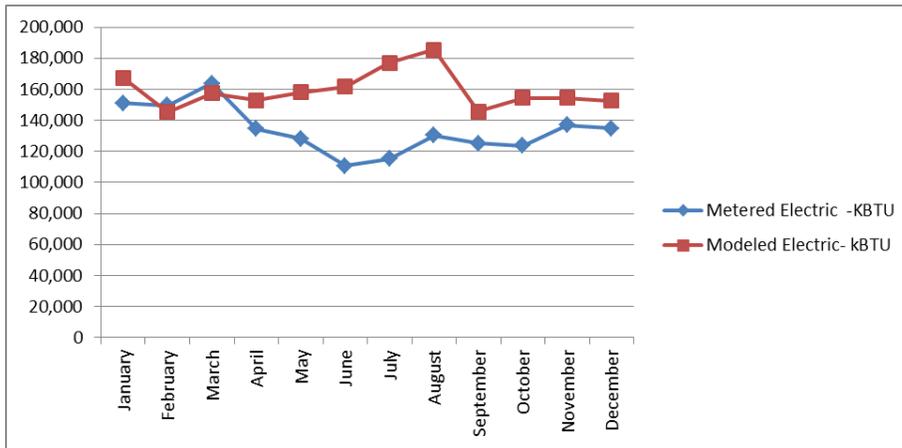

Overall, when all 5 barracks were aggregated, energy model predictions were on average 70.12% accurate with a MAPE of 29.88% for EUI predictions. The highest accuracy was with barracks 831, 937 and 9136 which were all >78% accurate. Dorms 484 and 373 were assumed to be 100% occupied throughout the year, and this is not a reasonable assumption for these particular buildings upon reviewing the meter data. Similarly, barracks that were excluded from analysis also had occupancy concerns that were even more dramatic.

Comparisons of Barracks buildings to CBECS data is summarized in Figure 30. CBECS data for dorms was not useful for comparisons due the small sample of dorms in the 2003 CBECS survey. As a result CBECS values are based on larger criteria of “lodging” within each climate zone in order to have sample sizes >10 for CBECS values. Additionally, since the 2003 survey, we have seen an explosion in the use of personal devices such as laptops and tablets, associated increases in plug loads would not have been observed in 2003.

Figure 30-Comparisons of Meter and Model EUI to CBECS for Barracks

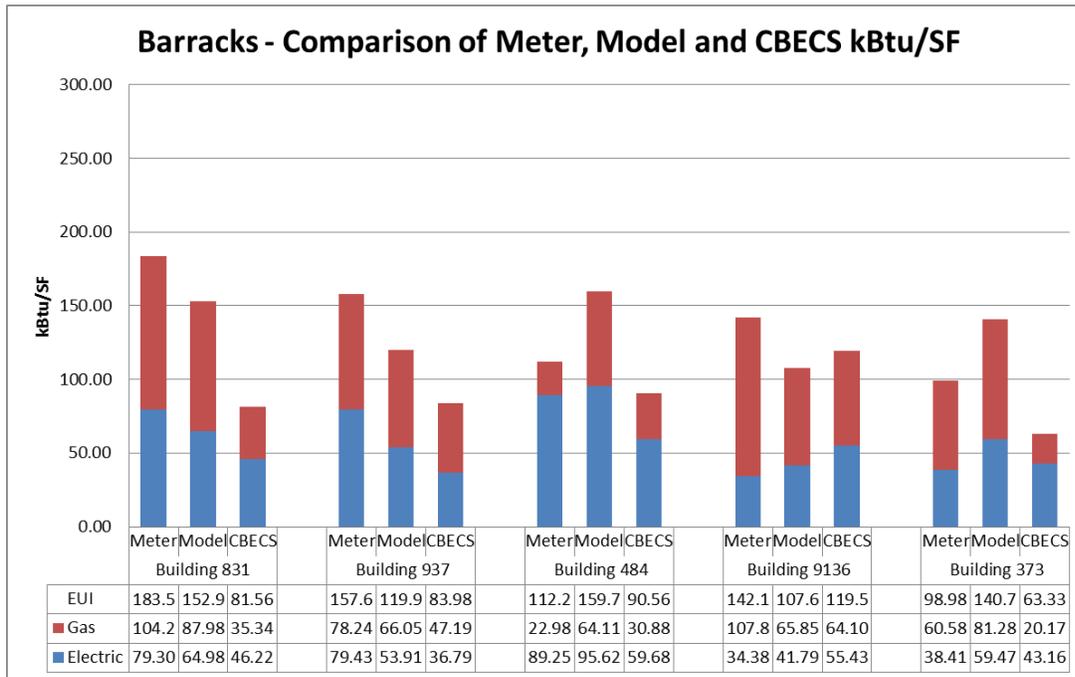

Conclusion

The REM workflow is a reasonable approach to predicting electric, natural gas and EUI in barracks buildings that have consistent occupancy throughout the year. Variable occupancy can skew the data significantly.

If barracks buildings are going to be utilized in REM workflows, users should understand that the energy models assume 100% occupancy. Reduced occupancy levels can be varied in GBS (i.e. 75% occupancy, 50% occupancy); however seasonality of reduced occupancy cannot be accounted for in the building energy model. Given the highly variable nature of DoD barracks and lack of available information on occupancy levels through the year, the REM workflow for barracks may not be ideal, unless users are comfortable with the assumptions described above.

6.1.3 Specialty Use Buildings Subset

In addition to offices and barracks, researchers sampled five specialty use buildings including a dining cafeteria, school, fire station, automotive facility and a gym. All buildings were under 45,000 GSF and were located at Seymour Air Force Base, with the exception of one gym in Fort Leonard Wood, MO.

Table 13-Specialty Use Buildings - Photos

| | |
|---|--|
|  <p>Building 3650 – Cafeteria- Seymour AFB – North Carolina</p> |  <p>Building 4103- School – Seymour AFB– North Carolina</p> |
|  <p>Building 4537- Automotive Facility - Seymour AFB– North Carolina</p> |  <p>Building 4601 – Firestation – Seymour AFB – North Carolina</p> |
|  <p>Building 640 – Gym- Fort Leonard Wood, MO</p> | |

Overall, energy models for these aggregate specialty use buildings were an average of 80.58% accurate for electricity estimates, with a MAPE of 15.72%, indicative of a good forecast. Energy models were an average of 70.80% accurate for natural gas predictions, with a MAPE of 29.20%, indicating a reasonable forecast. Overall, specialty use building energy models were an average of 85.58% accurate for predicting EUI with a MAPE of 14.42%, signifying a good forecast (Table 14).

Figure 31-Mean Absolute Error in Specialty Use Buildings


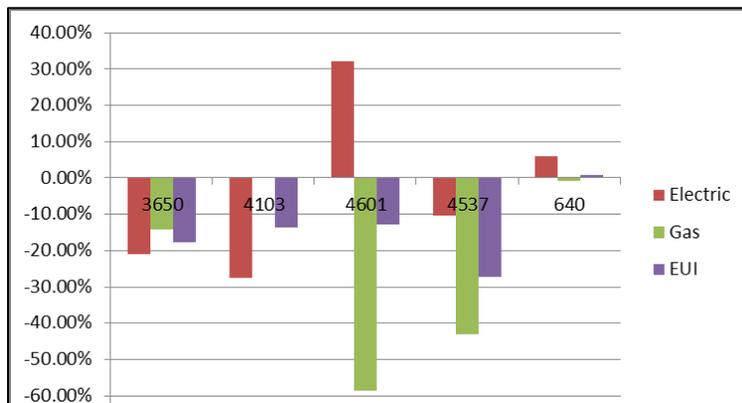


Table 14-Summary Data for Specialty Use Buildings

| Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI (kBtu/SF) | Accuracy Model Vs Meter - Absolute (EUI) |
|---|-------------------------|-----------|---|-------|----------------|----------------------|---|---|------------------|------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| 3650 | Cafeteria | Air Force | 28,013 | NC | 805,718 | 636,028 | -21.06% | 78.94% | 2669.9 | 2294.736 | -14.05% | 85.95% | 193.47 | 159.41 | -17.61% | 82.39% |
| 4103 | School | Air Force | 25,851 | NC | 650,258 | 470,667 | -27.62% | 72.38% | 0 | 310.1262 | | | 85.85 | 74.14 | -13.64% | 86.36% |
| 4601 | Firestation | Air Force | 43,187 | NC | 564,493 | 746,343 | 32.21% | 67.79% | 1,890 | 781.9529 | -58.63% | 41.37% | 88.37 | 77.09 | -12.77% | 87.23% |
| 4537 | Automotive Facility | Air Force | 38,700 | NC | 613,119 | 549,983 | -10.30% | 89.70% | 2,203 | 1251.493 | -43.19% | 56.81% | 111.00 | 80.84 | -27.17% | 72.83% |
| 640 | Gym | Army | 20,889 | MO | 287,682 | 304,660 | 5.90% | 94.10% | 2652.367 | 2627.316 | -0.94% | 99.06% | 173.98 | 175.55 | 0.91% | 99.09% |
| Summary Data for Speciality Use Buildings | | | | | | | Avg Accuracy | 80.58% | | | Avg Accuracy | 70.80% | | | Avg Accuracy | 85.58% |
| | | | | | | | MAPE | 19.42% | | | MAPE | 29.20% | | | MAPE | 14.42% |
| | | | | | | | STDEV | 11.18% | | | STDEV | 26.39% | | | STDEV | 9.47% |
| | | | | | | | CoV | 13.87 | | | CoV | 37.28 | | | CoV | 11.06 |
| | | | | | | | MFE | 6.56 | | | MFE | 10.57 | | | MFE | 17.13 |
| | | | | | | | MAD | 13.42 | | | MAD | 15.37 | | | MAD | 17.76 |

The energy model for Building 3650 (a dining cafeteria) was approximately 78.94% accurate (-21.06% MBE) for model predictions of electricity usage and 85.95% accurate for natural gas predictions (-14.05% MBE) (Figure 31). The electric trend profile was well aligned in shape and tightly aligned in values during the months of May, June and July. There was a sharp unexplained dip in metered electricity usage in August, followed by an increase in September. Natural gas model data for building 3650 aligns well with the meter data profile, with the exception of a deviation during the month of December when model estimates are significantly higher.


Figure 32-Cafeteria 3650, Seymour Air Force Base

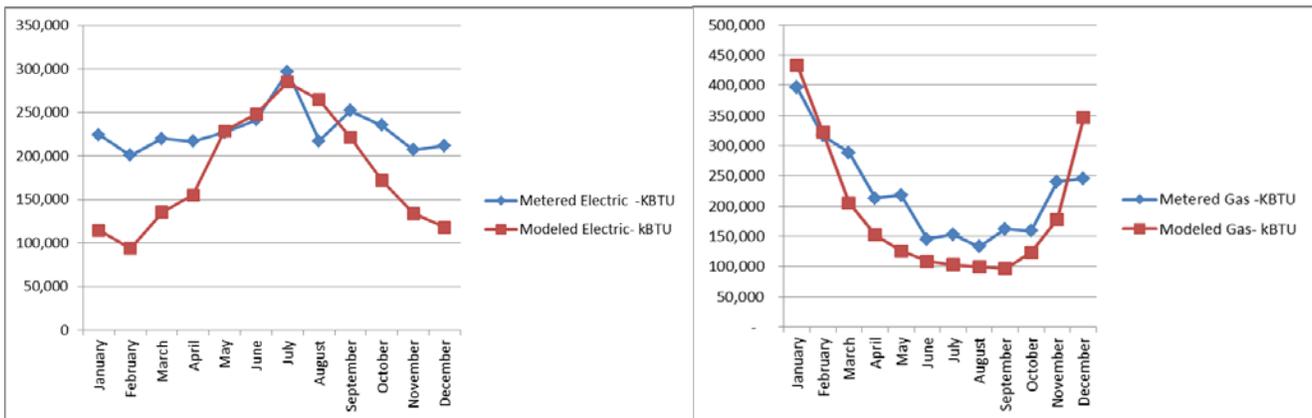

Building 4103 is an all-electric school at Seymour Air Force Base. Electric estimates are 72.38% accurate (-27.62% MBE) compared to meter data and 86.36% accurate for overall EUI estimates compared to metered EUI (-13.64% MBE).


Green Building Studio models did not pick up the fact that the building was all electric and while recognized the electric HVAC, modeled some minor natural gas usage associated with hot water heating. Close correlation with overall EUI may be attributed to removal of HVAC gas use related calculations. Electric meter data was consistently higher than modeled electric data; however the trend profiles are in alignment with the exception of sharp increases in metered usage in July and August, perhaps due to space cooling (Figure 33).

Figure 33-School Building 4103, Seymour Air Force Base

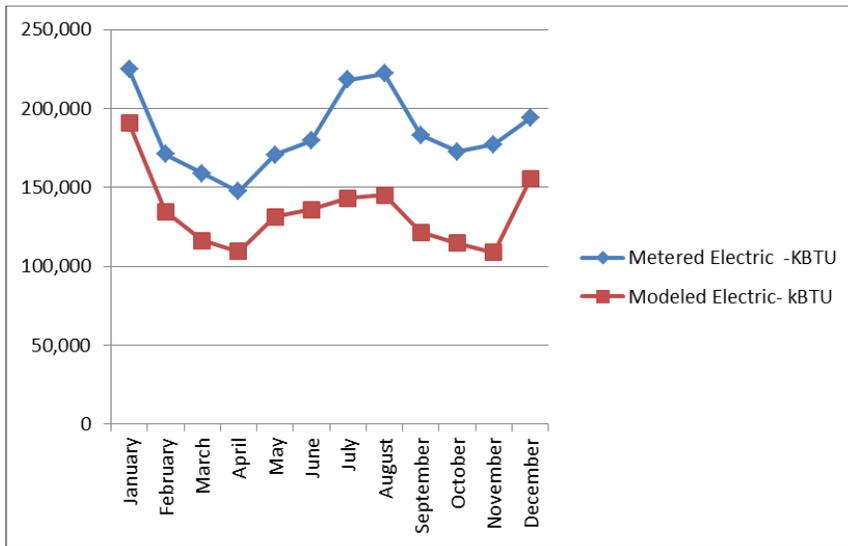


Building 4537 is an automotive facility at Seymour Air Force base. The building energy model was approximately 89.70% accurate for electric usage predictions (-10.3% MBE). The trend profile was well aligned in shape throughout the year. The model did not successfully predict gas usage, with only 56.81 % accuracy, and a MBE of -43.19%. The trend profile aligned in shape throughout the year, however metered gas usage was significantly higher than modeled usage in December, January and February. These extreme differences between predicted and actual gas values in the winter months negatively affected accuracy, as all other months were closely aligned (Figure 34).

Figure 34-Automotive Facility 4537, Seymour Air Force Base

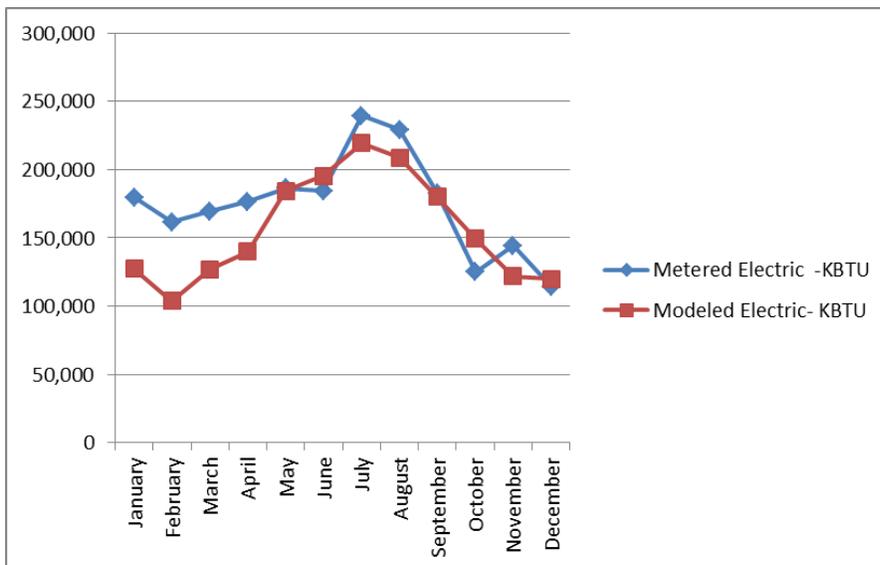


Automotive Facility 4537, Seymour Air Force Base

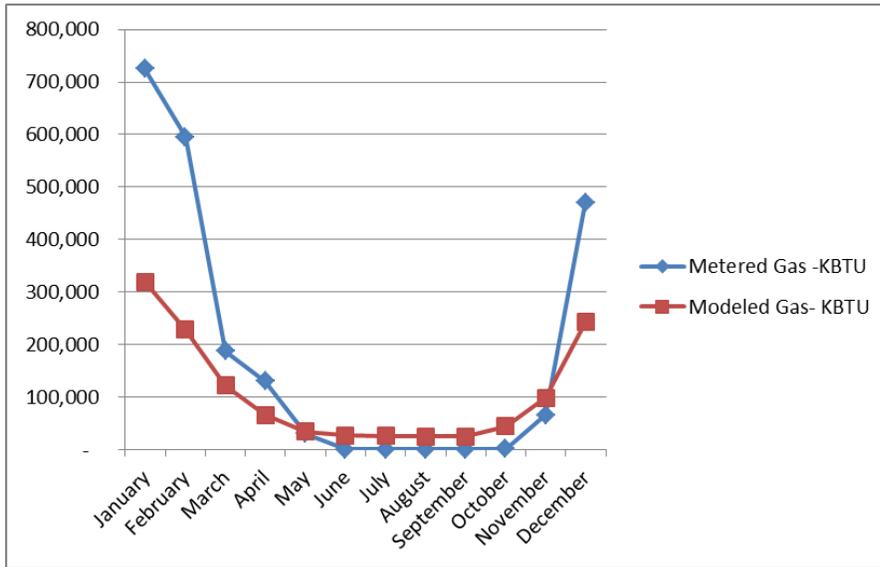


Building 640 is a gym at Fort Leonard Wood, MO. The building energy model was approximately 94.10% accurate for electric usage predictions (5.9% MBE). The trend profile was well aligned in shape throughout the year. The model did successfully predict natural gas usage, with only 56.81 % accuracy, and a MBE of -43.19%. The trend profile aligned in shape throughout the year, however metered natural gas usage was significantly higher than modeled usage in December, January and February. These extreme differences between predicted and actual gas values in the winter months negatively affected accuracy, as all other months were closely aligned (Figure 35).

Figure 35-Gym Building 640, Fort Leonard Wood

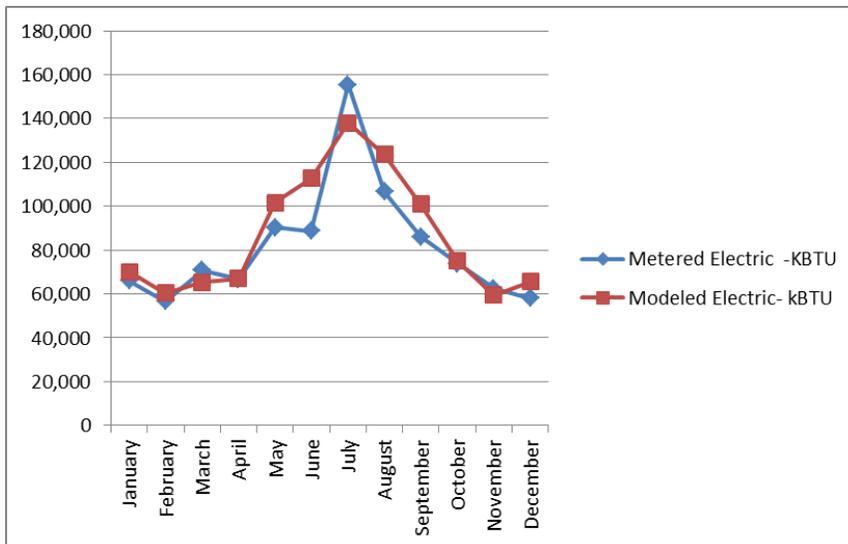


Gym Building 640, Fort Leonard Wood

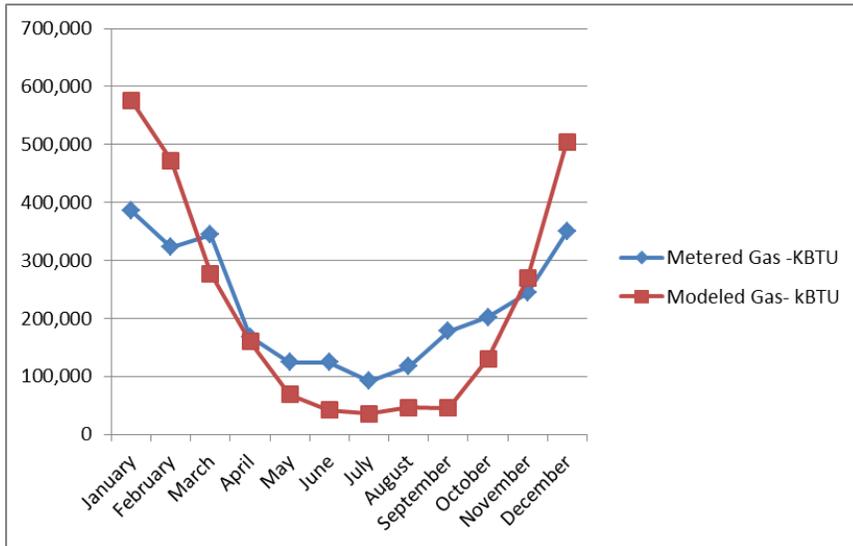

Given the specialized building types in this subset, and the limited number of building types in the CBECS database, comparison to CBECS is likely unreliable for these buildings (Figure 36).

Figure 36-Comparisons of Meter and Model EUI to CBECS for Specialty Use Buildings

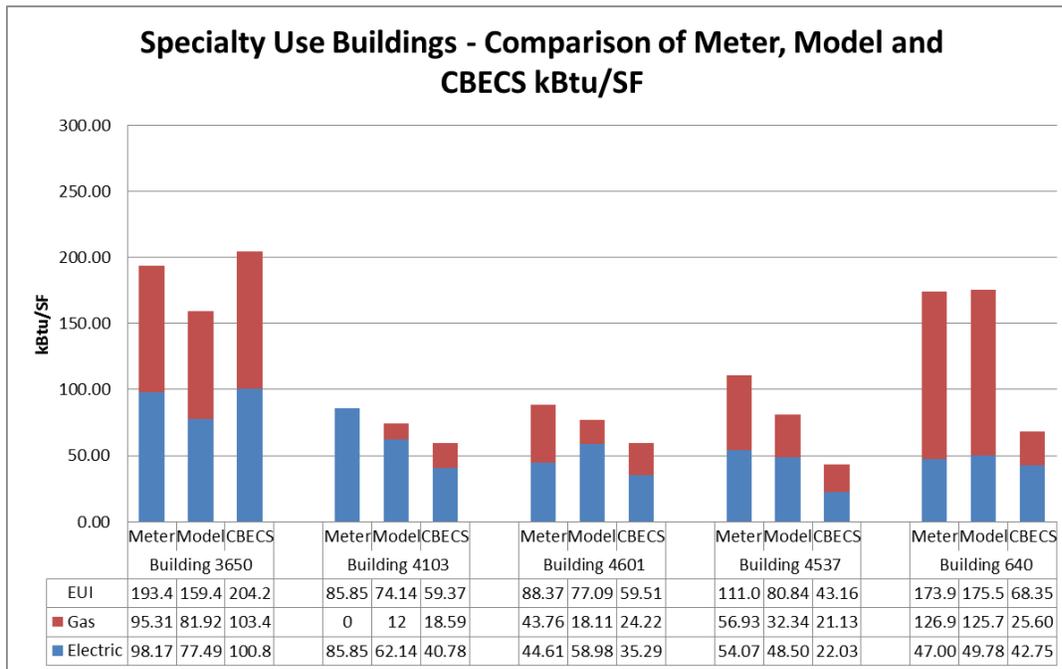

Conclusion

The REM workflow was a good methodology for forecasting electric and EUI for specialty use buildings based on mean absolute percentage error (MAPE) values between 11-20%. Further, there were close correlations in trend profiles in monthly data charts. The workflow was reasonable at predicting natural gas usage in specialty use buildings as indicated by MAPE value of 29.2%.

6.2 VARIANCE IN MONTHLY CONSUMPTION (BILLING HISTORY)

The calibrated simulation approach in this study involves use of the Green Building Studio program and DOE 2.2 engine to model energy use of existing buildings in pre-retrofit conditions and then checked against actual measured values. Researchers compared monthly utility costs between the simulated energy values and actual (metered) energy values using utility rates provided by installation POCs. Utility rates and usage were used as a proxy for utility bills, with the assumption that tariffs are included in the rates provided. Researchers calculated the Coefficient of Variation of the Root Mean Squared Error (CVRMSE) for each building. Additionally, for comparison CVRMSE was calculated using energy consumption as opposed to energy costs.

Buildings were not modeled again, refined or recalibrated to get within 15% of CVRMSE, rather the data is presented as a picture of how baseline models performed relative to measured values and can allow identification of which buildings are closest to acceptable calibration thresholds guided by under the ASHRAE Guideline 14-2002.

Three building models were within 15% of CVRMSE for billing including Building 1 at Peterson AFB, Building 470 at Fort Leonard Wood, and CERL Building 2. Two additional buildings were within 20% CVRMSE for billing data, including Peterson AFB Building 350 (18.73% CVRMSE) and Building 4601 at Seymour AFB (18.84% CVRMSE). Only one building, 4103 at Seymour AFB was within 20% CVRMSE for energy usage. The five buildings within 20% CVRMSE for billing were used to explore ECMs through Design Alternatives in Green Building Studio.

Table 15-CVRMSE Data

| BUILDING - State | Cost per therm | Cost per kWh | Total Cost % Difference | CVRMSE Monthly Billing | CVRMSE Monthly Energy Usage |
|------------------|----------------|--------------|-------------------------|------------------------|-----------------------------|
| B1 - CO | \$0.66 | \$0.06 | -23.73% | 10.39% | 34.49% |
| 350 - CO | \$0.66 | \$0.06 | 8.64% | 18.73% | 28.94% |
| 1100- CA | \$1.53 | \$0.20 | 33.64% | 34.87% | 34.94% |
| 110 - FL | \$0.70 | \$0.10 | 0.50% | 27.23% | 33.87% |
| 470 - MO | \$0.89 | \$0.09 | -12.61% | 14.47% | 28.00% |
| 3369 - WA | \$1.08 | \$0.04 | -4.60% | 21.62% | 22.35% |
| Cer1 - IL | \$0.84 | \$0.07 | -30.83% | 32.33% | 40.25% |
| Cer2 - IL | \$0.84 | \$0.07 | -11.17% | 12.60% | 21.92% |

| | | | | | |
|--------------------------------|--------|--------|---------|---------------|---------------|
| 581- FL | \$0.70 | \$0.10 | -19.58% | 39.81% | 41.06% |
| 4421 - NC | \$0.85 | \$0.07 | -22.82% | 26.71% | 33.90% |
| Cerl3 - IL | \$0.84 | \$0.07 | -34.33% | 37.66% | 50.19% |
| 1345- CO | \$0.66 | \$0.06 | -19.28% | 24.66% | 27.86% |
| 1485 - CO | \$0.66 | \$0.06 | 4.62% | 31.89% | 54.82% |
| Offices | | | | 25.61% | 34.82% |
| 831 - MO | \$0.89 | \$0.09 | -17.31% | 37.12% | 31.65% |
| 937 - MO | \$0.89 | \$0.09 | -28.02% | 31.21% | 26.09% |
| 484- FL | \$0.70 | \$0.10 | 17.29% | 30.57% | 59.24% |
| 9136- WA | \$1.08 | \$0.04 | -23.37% | 54.27% | 55.20% |
| 373 - ME | \$1.32 | \$0.09 | 45.67% | 48.96% | 46.63% |
| Barracks | | | | 40.43% | 43.76% |
| 3650 - NC | \$0.85 | \$0.07 | -18.99% | 23.08% | 21.09% |
| 4103- NC | \$0.85 | \$0.07 | -21.58% | 23.34% | 16.78% |
| 4601- NC | \$0.85 | \$0.07 | 5.13% | 18.84% | 24.83% |
| 4537- NC | \$0.85 | \$0.07 | -20.60% | 39.32% | 55.21% |
| 640- MO | \$0.89 | \$0.09 | 2.65% | 22.44% | 33.80% |
| Specialty Use Buildings | | | | 25.40% | 30.34% |
| Aggregated | | | | 25.55% | 33.57% |

6.3 TESTING THE REM PROCESS FOR DESIGN ALTERNATIVES TO MODEL POTENTIAL ENERGY SAVINGS

A subset of 5 buildings was selected based upon falling within 20% CVRMSE for monthly utility costs and design alternatives for energy conservation were explored for these buildings. PES analyses tables and charts automatically generated in Green Building Studio guided researchers in assessing Energy Conservation Measures.


Estimated Savings from ECMs is expressed as:

- *Metered energy saved = Metered baseline (kWh, therms, kBtu) – ECMpost (kWh, therms, kBtu)*
- *Modeled energy saved = Modeled baserun (kWh, therms, kBtu) – ECMpost (kWh, therms, kBtu)*
- *Metered Cost savings = Metered baseline \$ – ECMpost \$*
- *Modeled Cost savings = Modeled baserun \$ – ECMpost \$*

6.3.1 Design Alternatives - CERL Building 2

For CERL Building 2, an office in Champaign, IL had a CVRMSE value of 12.6%. PES analyses indicated that the highest energy savings could be gained by modifying wall construction, HVAC type, and plug load and lighting efficiency (Figure 37).

Figure 37-Potential Energy Savings Chart for CERL Building 2

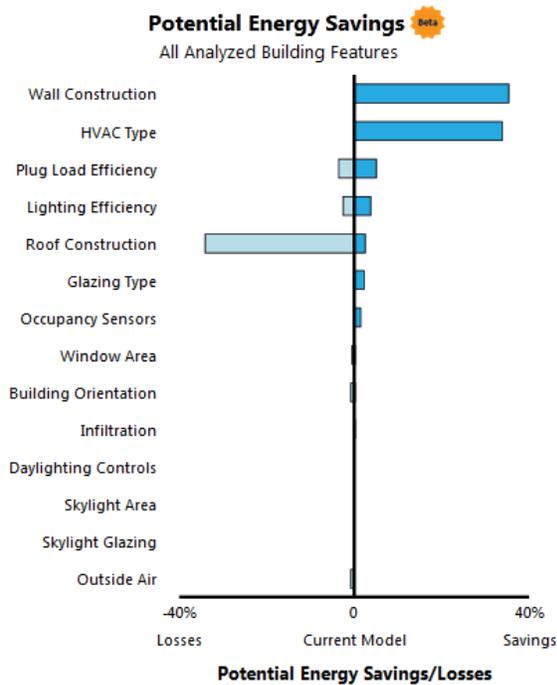

A basic package set of measures explored upgrading the HVAC system while utilizing the infrastructure of the existing 4 pipe fan coil system, reducing lighting power density (LPD) and equipment power density (EPD) by 10% and installing occupancy sensors and daylighting controls (in red in Figure 38).

Figure 38-Basic Package Upgrades for CERL B2

| General | | Lighting | | | |
|---------------------------------------|---|-------------------------------|--|---------------|--|
| Rotation | 0 | Lighting Efficiency | LPD 10% less than base run | | |
| HVAC | 4-Pipe FC, 0.59 kW/ton Chlr, 85% Boiler, VSD pump | Lighting Control | Occupancy/Daylighting sensors & controls | | |
| Outside Air Flow Per Person Value | default | Equipment Power Density Value | Default | | |
| Infiltration | No Reduction | Light Power Density Value | Default | | |
| InfiltrationValue | Default | Equipment Efficiency | EPD 10% less than base run | | |
| Outside Air Flow Per Floor Area Value | 0 CFM/sqft | Number of People | Default | | |
| Outside Air Change Per Hour Value | 0 ACH | Occupancy | No change | | |
| Outside Air Flow Per Person | No change | Daylighting Control | On | | |
| Outside Air Flow Per Floor Area | No change | Occupancy Sensor | On | | |
| | | | | | |
| Roof | Northern Walls | Southern Walls | Western Walls | Eastern Walls | |
| Construction | Construction | Construction | Construction | Construction | |
| No Change | No Change | No Change | No Change | No Change | |
| | Glazing Type | Glazing Type | Glazing Type | Glazing Type | |
| | No Change | No Change | No Change | No Change | |
| | Glass Amount | Glass Amount | Glass Amount | Glass Amount | |
| | No change | No change | No change | No change | |

Basereun HVAC:
 1999 ASHRAE
 90.1. 4-Pipe FC
 0.639kW/ton
 Chlr/80% Boiler

An advanced package included all measures included in the basic package, and also included addition of insulation to the massive brick walls which was the number one recommended improvement, but also potentially the most costly.

Figure 39-Advanced Package Upgrades for CERL B3

| General | | Lighting |
|---|--|--|
| Rotation | | Lighting Efficiency |
| 0 | | LPD 10% less than base run |
| HVAC | | Lighting Control |
| 4-Pipe FC, 0.59 kW/ton Chlr, 85% Boiler, VSD pump | | Occupancy/Daylighting sensors & controls |
| Outside Air Flow Per Person Value | | Equipment Power Density Value |
| default | | Default |
| Infiltration | | Light Power Density Value |
| No Reduction | | Default |
| InfiltrationValue | | Equipment Efficiency |
| Default | | EPD 10% less than base run |
| Outside Air Flow Per Floor Area Value | | Number of People |
| 0 CFM/sqft | | Default |
| Outside Air Change Per Hour Value | | Occupancy |
| 0 ACH | | No change |
| Outside Air Flow Per Person | | Daylighting Control |
| No change | | On |
| Outside Air Flow Per Floor Area | | Occupancy Sensor |
| No change | | On |

Baserun HVAC:
 1999 ASHRAE
 90.1. 4-Pipe FC
 0.639kW/ton
 Chlr/80% Boiler

Baserun walls:
 High Mass, No
 Insulation

| Roof | Northern Walls | Southern Walls | Western Walls | Eastern Walls |
|--------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|
| Construction | Construction | Construction | Construction | Construction |
| No Change | Massive Wall with High Insulation |
| | Glazing Type | Glazing Type | Glazing Type | Glazing Type |
| | No Change | No Change | No Change | No Change |
| | Glass Amount | Glass Amount | Glass Amount | Glass Amount |
| | No change | No change | No change | No change |

The basic package set of measures yielded energy savings of 27.02% and \$20,723 cost savings compared to metered energy usage, and 8.75% compared to modeled usage and \$9,636 in costs savings compared to the modeled baserun.

Adding wall insulation under the Advanced Package yielded an additional 26% energy savings (53.25% total savings) and an additional \$19,080 (\$39,803 total) in annual cost savings compared to the metered baseline. Differences seen between modeled and metered savings are due to energy usage differences between the runs, even though they fall within 15% CVRMSE calibration criteria.

Table 16-Design Alternatives Packages for Energy Savings – CERL B2

| RUN | | EUI - kBtu/ ft² | Cost Electric at .066 / kWh | Cost Fuel at .84/therm | Cost Energy | Electric kWh | Electric KBTU | Fuel | Fuel KBTU | TOTAL KBTU | Carbon Emissions (tons) |
|--|---------------|--------------------|--------------------------------------|------------------------------|----------------|-----------------|------------------|---------|--------------|---------------|-------------------------------|
| CERL 2 Metered Baseline | | 156.2 | 64,677 | 35,283 | 99,960 | 979,952 | 3,344,576 | 42003.5 | 4,200,350 | 7,544,926 | |
| CERL 2 Modeled Baserun | | 124.9 | 67,509 | 21,364 | 88,873 | 1,022,858 | 3,491,013 | 25,434 | 2,543,372 | 6,034,384 | 1,061.10 |
| ECM Basic Package | | 114 | 58,312 | 20,925 | 79,237 | 883,510 | 3,015,420 | 24,911 | 2,491,100 | 5,506,520 | 914.1 |
| ECM Advanced Package | | 73 | 53,969 | 6,187 | 60,156 | 817,712 | 2,790,851 | 7,366 | 736,600 | 3,527,451 | 741.4 |
| Basic Package Savings -Modeled Baserun | Savings | 11 | \$9,197 | \$439 | \$9,636 | 139,348 | 475,593 | 523 | 52,272 | 527,865 | 147 |
| | % Decrease | 8.75% | 13.62% | 2.06% | 10.84% | 13.62% | | 2.06% | | | 13.85% |
| Advanced package savings -Modeled Baserun | Savings | 52 | \$13,540 | \$15,177 | \$28,716 | 205,146 | 700,162 | 18,068 | 1,806,772 | 2,506,933 | 320 |
| | % Decrease | 41.55% | 20.06% | 71.04% | 32.31% | 20.06% | | 71.04% | | | 30.13% |
| Basic Package Savings -Metered Baseline | Savings | 42 | \$6,365 | \$14,358 | \$20,723 | 96,442 | 329,157 | 17,093 | 1,709,250 | 2,038,407 | |
| | % Decrease | 27.02% | 9.84% | 40.69% | 20.73% | 9.84% | | 40.69% | | | |
| Advanced Package Savings -Metered Baseline | Savings | 83 | \$10,708 | \$29,096 | \$39,803 | 162,240 | 553,725 | 34,638 | 3,463,750 | 4,017,475 | |
| | % Decrease | 53.25% | 16.56% | 82.46% | 39.82% | 16.56% | | 82.46% | | | |
| ADVANCED PACKAGE produced additional savings of: | | 26.25% | 6.71% | 41.77 | 19.09% | | | | | | |
| ADVANCED PACKAGE Annual Cost Savings of: | | | \$4343 | \$14,738 | \$19,080 | | | | | | |

6.3.2 Design Alternatives – Building 1, Peterson AFB

Peterson B1, an office in Colorado Springs, CO had a CVRMSE of 10.39%. A basic package guided by Potential Energy Savings Results (Figure 40), explored measures including reducing LPD and EPD by 10% each and adding occupancy and daylighting sensors and controls.

Figure 40-Potential Energy Savings Chart for Building 1 – Peterson AFB

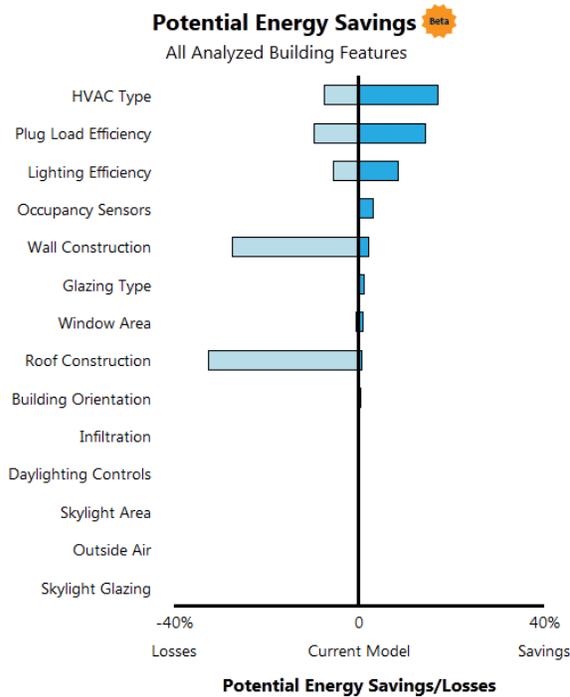


Figure 41-Basic Package Design Alternative Measures

| | |
|-------------------------------|--|
| Lighting Efficiency | Lighting Control |
| LPD 10% less than base run | Occupancy/Daylighting sensors & controls |
| Equipment Power Density Value | Equipment Efficiency |
| Default | EPD 10% less than base run |
| Light Power Density Value | Number of People |
| Default | Default |
| Equipment Efficiency | Occupancy |
| EPD 10% less than base run | No change |
| Number of People | Daylighting Control |
| Default | On |
| Occupancy | Occupancy Sensor |
| No change | On |

There were no high priority envelope measures indicated by the Potential Energy Savings Chart, thus an advanced package explored basic package measures and also included a HVAC change to premium efficiency VAV with reheat.

Figure 42-Advanced Package Design Alternative Measures

| General | | Lighting | | |
|--|---|---|---|---|
| Rotation 0 HVAC Premium Eff. VAV w/ Reheat, >300 ton (7.5 COP) Outside Air Flow Per Person Value default Infiltration No Reduction InfiltrationValue Default Outside Air Flow Per Floor Area Value 0 CFM/sqft Outside Air Change Per Hour Value 0 ACH Outside Air Flow Per Person No change | | <div style="border: 1px solid black; padding: 5px; display: inline-block;"> HVAC Base Run: VAV - HW Heat, 0.59 kW/ton Chlr, 85% Boiler, VSD </div> | | |
| | | Lighting Efficiency LPD 10% less than base run Lighting Control Occupancy/Daylighting sensors & controls Equipment Power Density Value Default Light Power Density Value Default Equipment Efficiency EPD 10% less than base run Number of People Default Occupancy No change Daylighting Control On | | |
| Roof | Northern Walls | Southern Walls | Western Walls | Eastern Walls |
| Construction No Change | Construction No Change Glazing Type No Change Glass Amount No change | Construction No Change Glazing Type No Change Glass Amount No change | Construction No Change Glazing Type No Change Glass Amount No change | Construction No Change Glazing Type No Change Glass Amount No change |

Lighting, equipment and control improvements yielded a 40% improvement in EUI over metered baseline values and a 12.81 % improvement over EUI from the modeled baserun. Annual cost savings were \$105,000 from the metered baseline, and \$17,727 from the modeled baserun. This discrepancy is linked to differences between metered and modeled energy estimates, despite CVRMSE values within 15%.

With HVAC improvements added to the improvements identified, facility owners may realize an additional \$28,828 in annual cost savings (\$134,463 total) and 1.95% improvement in EUI (41.95% total) over metered values.


Table 17-Design Alternatives Packages for Energy Savings – Peterson B1

| RUN | EUI - kBtu/ ft² | Cost Electric at .06 /kWh | Cost Fuel at .66 kWh | Cost Energy | Electric kWh | Electric KBTU | Fuel - therms | Fuel KBTU | TOTAL KBTU | Carbon Emissions (tons) | |
|--|------------------------------|---------------------------|----------------------|-------------|--------------|---------------|---------------|-----------|------------|-------------------------|--------|
| Peterson 1 Metered Baseline | 87.3 | \$335,425 | \$36,458 | \$371,883 | 5,590,418 | 19,080,097 | 55240 | 5,524,000 | 24,604,097 | | |
| Peterson 1 Modeled Baseline | 60.1 | \$275,591 | \$8,386 | \$283,976 | 4,593,182 | 15,676,531 | 12,705 | 1,270,540 | 16,947,071 | 4206.6 | |
| ECM Basic Package | 50.7 | \$229,115 | \$8,305 | \$237,421 | 3,818,588 | 13,032,841 | 12,584 | 1,258,400 | 14,291,241 | 3368.7 | |
| ECM Basic Package - no HVAC | 52.4 | \$233,013 | \$9,935 | \$242,948 | 3,883,549 | 13,254,553 | 15,053 | 1,505,300 | 14,759,853 | 3453.1 | |
| Basic Package - NO HVAC - Modeled Baserun | Savings from Original Run | 8 | \$42,578 | -\$1,549 | \$41,029 | 709,633 | 2,421,978 | -2,348 | -234,760 | 2,187,219 | 754 |
| | % Decrease from Original Run | 12.81% | 15.45% | -18.48% | 14.45% | 15.45% | | | | | 17.91% |
| Advanced Package Savings - Modeled Baserun | Savings from Original Run | 9 | \$46,476 | \$80 | \$46,556 | 774,594 | 2,643,690 | 121 | 12,140 | 2,655,830 | 838 |
| | % Decrease from Original Run | 15.64% | 16.86% | 0.96% | 16.39% | 16.86% | | | | | 19.92% |
| Basic Package - NO HVAC - Metered Baseline | Savings from Original Run | 35 | \$102,412 | \$26,523 | \$128,936 | 1,706,869 | 5,825,544 | 40,187 | 4,018,700 | 9,844,244 | |
| | % Decrease from Original Run | 40.00% | 30.53% | 72.75% | 34.67% | 30.53% | | | | | |
| Advanced Package Savings - Metered Baseline | Savings from Original Run | 37 | \$106,310 | \$28,153 | \$134,463 | 1,771,830 | 6,047,256 | 42,656 | 4,265,600 | 10,312,856 | |
| | % Decrease from Original Run | 41.95% | 31.69% | 77.22% | 36.16% | 31.69% | | | | | |
| Adding HVAC produced additional savings of: | | 1.95% | 1.16% | 4.47% | 1.49% | 1.16% | | | | | |
| Additional Annual Cost Savings of: | | | \$3,898 | \$1,630 | \$5,527 | | | | | | |

6.3.3 Design Alternatives for Fort Leonard Wood- Building 470

Office building number 470 at Fort Leonard Wood, MO had a CVRMSE value of 14.47% between simulated and metered monthly cost data. PES analyses indicated that greatest savings may be gained from upgrading HVAC, upgrading glazing, altering window area and improving plug load efficiency and lighting efficiency (Figure 43).

Figure 43-Potential Energy Savings for Fort Leonard Wood – Building 470

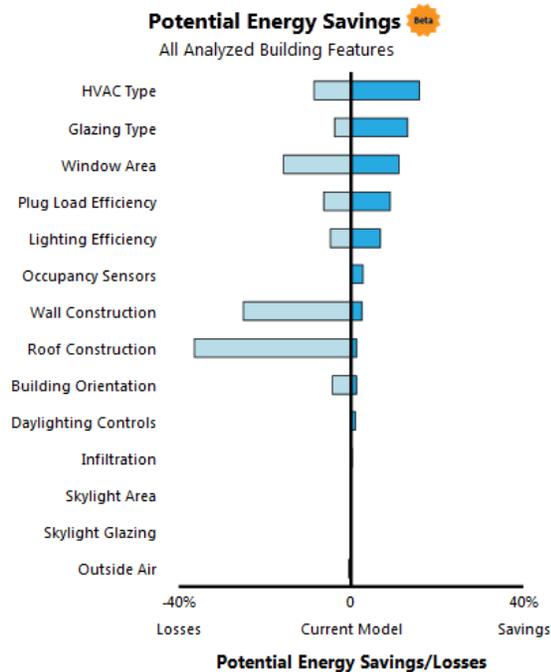

It was determined that changing window area was impractical and that was removed from consideration. Researchers thus investigated a basic package that included 10% improvement to equipment and lighting efficiency, daylighting and occupancy controls and HVAC equipment improvements (Figure 45). Researchers selected an 11.3 EER packaged VAV system which offers a slight improvement in efficiency over the current system, but does not require an overhaul of the existing HVAC infrastructure. Existing windows are double-pane, thus upgrades to these windows were considered as an Advanced Package item. Given that two identified improvements, HVAC and Window glazing have been upgraded in the building relatively recently, these were assessed iteratively in addition to basic package measures as moderate and advanced packages (Figures 45 and 46).

Exploration of design alternatives indicated that the basic package of ECMs including lighting efficiency, equipment efficiency and control improvements yielded a 31.79% improvement in EUI and cost of \$73,067 over metered baseline values, a 9.7% improvement in EUI and \$13,763 in savings from the modeled baserun (Table 18). Adding HVAC improvements decreased EUI by an additional 6.24% and resulted in an additional \$9,506 in cost savings (\$82,573 total) above the basic package reductions for the metered baseline. The combination of HVAC

improvements and window upgrades beyond the basic measures yielded a total 45.84% improvement in EUI and an estimated total annual cost savings of \$90,420.

Figure 44-Basic Package Improvements – Building 470

| General | Lighting |
|---|--|
| Rotation 0 | Lighting Efficiency LPD 10% less than base run |
| HVAC No Change | Lighting Control Occupancy/Daylighting sensors & controls |
| Outside Air Flow Per Person Value default | Equipment Power Density Value Default |
| Infiltration No Reduction | Light Power Density Value Default |
| InfiltrationValue Default | Equipment Efficiency EPD 10% less than base run |
| Outside Air Flow Per Floor Area Value 0 CFM/sqft | Number of People Default |
| Outside Air Change Per Hour Value 0 ACH | Occupancy No change |
| Outside Air Flow Per Person No change | Daylighting Control On |
| Outside Air Flow Per Floor Area No change | Occupancy Sensor On |

Figure 45-Moderate Package Improvements– Building 470

| General | Lighting |
|---|--|
| Rotation 0 | Lighting Efficiency LPD 10% less than base run |
| HVAC 11.3 EER Packaged VAV, 84.8% boiler heating | Lighting Control Occupancy/Daylighting sensors & controls |
| Outside Air Flow Per Person Value default | Equipment Power Density Value Default |
| Infiltration No Reduction | Light Power Density Value Default |
| InfiltrationValue Default | Equipment Efficiency EPD 10% less than base run |
| Outside Air Flow Per Floor Area Value 0 CFM/sqft | Number of People Default |
| Outside Air Change Per Hour Value 0 ACH | Occupancy No change |
| Outside Air Flow Per Person No change | Daylighting Control On |
| Outside Air Flow Per Floor Area No change | Occupancy Sensor On |

HVAC
Baserun:
VAV>150<300
Ton 5.55 COP
Chiller, 80%
Blr, No Econ

Assumed

Figure 46-Advanced Package Improvements– Building 470

| General | Lighting |
|---|--|
| Rotation 0 | Lighting Efficiency LPD 10% less than base run |
| HVAC 11.3 EER Packaged VAV, 84.8% boiler heating | Lighting Control Occupancy/Daylighting sensors & controls |
| Outside Air Flow Per Person Value default | Equipment Power Density Value Default |
| Infiltration No Reduction | Light Power Density Value Default |
| InfiltrationValue Default | Equipment Efficiency EPD 10% less than base run |
| Outside Air Flow Per Floor Area Value 0 CFM/sqft | Number of People Default |
| Outside Air Change Per Hour Value 0 ACH | Occupancy No change |
| Outside Air Flow Per Person No change | Daylighting Control On |
| Outside Air Flow Per Floor Area No change | Occupancy Sensor On |

| Roof | Northern Walls | Southern Walls | Western Walls | Eastern Walls |
|---------------------------|--------------------------------------|--------------------------------------|--------------------------------------|--------------------------------------|
| Construction No Change | Construction No Change | Construction No Change | Construction No Change | Construction No Change |
| | Glazing Type Insulated Grey Low-e |
| | Glass Amount No change | Glass Amount No change | Glass Amount No change | Glass Amount No change |

Table 18-Design Alternatives Packages for Energy Savings – Fort Leonard Wood, B470

| RUN | EUI - kBtu/ft ² | Cost Electric at .09/kWh | Cost Fuel at .89/therm | Cost Energy | Electric kWh | Electric KBTU | Fuel | Fuel KBTU | TOTAL KBTU | Carbon Emissions (tons) | |
|--|----------------------------|--------------------------|------------------------|-------------------|-------------------|-------------------|-----------|-----------|------------|-------------------------|--------|
| Metered Baseline | 83.3 | \$145,967 | \$26,010 | \$171,977 | 1,621,858 | 5,535,402 | 29224.67 | 2,922,467 | 8,457,869 | | |
| Modeled Baseline | 62.9 | \$140,779 | \$9,435 | \$150,214 | 1,564,214 | 5,338,661 | 10,601 | 1,060,139 | 6,398,799 | 1,468.30 | |
| ECM Basic Package | 56.8 | \$88,118 | \$120,161 | \$10,792 | \$130,953 | 4,556,778 | 12,126 | 1,212,600 | 5,769,378 | 1230.1 | |
| ECM Advanced Package -with HVAC improvement | 51.6 | \$79,283 | \$108,113 | \$10,121 | \$118,234 | 4,099,883 | 11,372 | 1,137,200 | 5,237,083 | 1081.4 | |
| ECM Advanced with HVAC and Windows | 45.1 | \$76,085 | \$103,752 | \$5,472 | \$109,224 | 3,934,523 | 6,148 | 614,800 | 4,549,323 | 1001.5 | |
| Basic Package Savings - Modeled Baseline | Savings from Original Run | 6 | \$20,618 | -\$1,357 | \$19,261 | 229,090 | 781,882 | -1,525 | -152,461 | 629,421 | 238 |
| | % Savings | 9.70% | 14.65% | -14.38% | 12.82% | 14.65% | | -14.38% | | 9.84% | 16.22% |
| Moderate package savings with HVAC - Modeled Baseline | Savings from Original Run | 11 | \$32,666 | -\$686 | \$31,980 | 362,959 | 1,238,777 | -771 | -77,061 | 1,161,716 | 387 |
| | % Savings | 17.97% | 23.20% | -7.27% | 21.29% | 23.20% | | -7.27% | | 18.16% | 26.35% |
| Advanced Package Savings with Basic Measures, HVAC and Windows - Modeled Baseline | Savings from Original Run | 18 | \$37,027 | \$3,964 | \$40,990 | 411,409 | 1,404,137 | 4,453 | 445,339 | 1,849,476 | 467 |
| | % Savings | 28.30% | 26.30% | 42.01% | 27.29% | 26.30% | | 42.01% | | 28.90% | 31.79% |
| Basic Package Savings -Metered Baseline | Savings from Original Run | 26 | \$25,806 | \$15,218 | \$41,024 | 286,734 | 978,623 | 17,099 | 1,709,867 | 2,688,490 | |
| | % Savings | 31.79% | 17.68% | 58.51% | 23.85% | 17.68% | | 58.51% | | 31.79% | |
| Moderate Package Savings with HVAC - Metered Baseline | Savings from Original Run | 32 | \$37,854 | \$15,889 | \$53,743 | 420,603 | 1,435,518 | 17,853 | 1,785,267 | 3,220,785 | |
| | % Savings | 38.04% | 25.93% | 61.09% | 31.25% | 25.93% | | 61.09% | | 38.08% | |
| Advanced Package Savings with Basic Measures, HVAC and Windows - Metered Baseline | Savings from Original Run | 38 | \$42,215 | \$20,538 | \$62,753 | 469,053 | 1,600,878 | 23,077 | 2,307,667 | 3,908,545 | |
| | % Savings | 45.84% | 28.92% | 78.96% | 36.49% | 28.92% | | 78.96% | | 46.21% | |
| Compared to Metered Baseline, Adding HVAC to ECM package produced additional savings of: | | 6.24% | 6.05% | 8.25% | 2.58% | 7.40% | | | | | |
| Additional Annual Cost Savings of: | | | \$8,835 | \$12,048 | \$671 | \$12,719 | | | | | |
| Adding HVAC and Windows to Basic Package | | 14.05% | 8.24% | 11.24% | 20.46% | 12.63% | | | | | |
| Additional Annual Cost Savings of: | | | \$12,033 | \$16,408.7 | \$5,320.42 | \$21,729.1 | | | | | |

6.3.4 Design Alternatives for Building 350- Peterson AFB

Office building 350 at Peterson AFB had a CVRMSE value of 18.37%. The potential energy savings chart (Figure 47) reveal that the biggest savings can come from alterations to glazing type, plug load efficiency, window area, lighting efficiency and HVAC type.

It was determined that changes to window area are not feasible and that existing windows are double pane and tinted, although not the latest in window design. Therefore researchers explored a basic package of measures that investigated reduction in plug load and lighting power density by 10% each plus the addition of occupancy sensors (Figure 48). The PES analysis indicated that HVAC upgrades presented low opportunity for energy savings, particularly since it would involve under floor air distribution and significant modifications to the existing infrastructure. HVAC upgrades were therefore not explored for this building.

Figure 47-Potential Energy Savings Chart for Peterson B 350

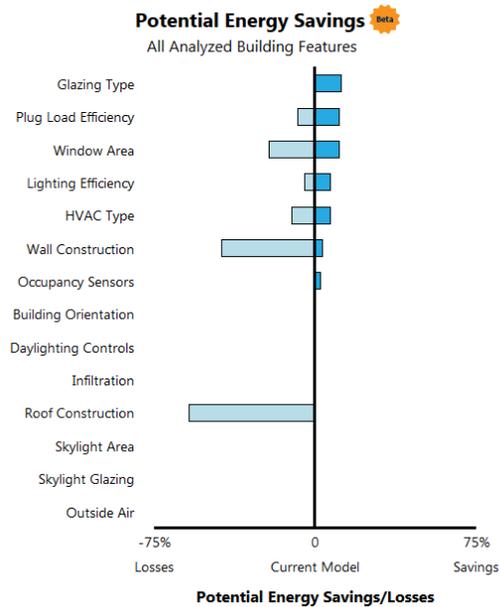


Figure 48-Basic Package Improvements B350

| Lighting | |
|-------------------------------|--|
| Lighting Efficiency | LPD 10% less than base run |
| Lighting Control | Occupancy/Daylighting sensors & controls |
| Equipment Power Density Value | Default |
| Light Power Density Value | Default |
| Equipment Efficiency | EPD 10% less than base run |
| Number of People | Default |
| Occupancy | No change |
| Daylighting Control | Off |
| Occupancy Sensor | On |

Table 19-Design Alternatives Packages for Energy Savings – Peterson AFB, Building 350

| RUN | | EUI - kBtu/ft ² | Cost Electric at .06/kWh | Cost Fuel at .66/therm | Annual Cost - Energy | Electric kWh | Electric kBtu | Fuel Therms | Fuel kBtu | TOTAL kBtu | Carbon Emissions (tons) |
|--|---------------------------|----------------------------|--------------------------|------------------------|----------------------|--------------|---------------|-------------|-----------|------------|-------------------------|
| Metered Baseline | | 58.9 | \$103,688 | \$18,964 | \$122,652 | 1,728,137 | 5,898,132 | 28733 | 2,873,363 | 8,771,495 | |
| Modeled Baserun | | 61.4 | \$122,774 | \$10,639 | \$133,413 | 2,046,233 | 6,983,793 | 16,120 | 1,611,969 | 8,595,762 | 1,933.80 |
| ECM Basic Package | | 56.8 | \$102,492 | \$12,254 | \$114,747 | 1,708,206 | 5,830,107 | 18,567 | 1,856,700 | 7,686,807 | 1583.5 |
| Basic Package Savings - Modeled Baserun | Savings from Original Run | 5 | \$20,282 | -\$1,615 | \$18,666 | 338,027 | 1,153,685 | -2,447 | -244,731 | 908,955 | 350 |
| | Percent Savings | 7.49% | 16.52% | -15.18% | 13.99% | 16.52% | | 15.18% | | 10.57% | 18.11% |
| Basic Package Savings - Metered Baseline | Savings from Original Run | 2 | \$1,196 | \$6,710 | \$7,906 | 19,931 | 68,025 | 10,167 | 1,016,663 | 1,084,688 | |
| | Percent Savings | 3.64% | 1.15% | 35.38% | 6.45% | 1.15% | | 35.38% | | 12.37% | |

Exploration of basic measures within Green Building Studio Design Alternatives revealed that improving LPD by 10 % and EPD by 10%, plus adding occupancy sensors is estimated to improve EUI by 3.64% and reduce energy costs by \$7,906 annually compared to metered data for the building. Improvements compared to the modeled baserun indicated an improvement of 7.49% for EUI, and annual cost savings of \$18,666 (Table 19).

6.3.5 Design Alternatives for Seymour AFB Building 4601

Building 4601 is a fire station at Seymour Air Force base in North Carolina and had a CVRMSE value of 18.84%. The Potential Energy Savings chart indicated that the highest energy savings can come from upgrades to HVAC type, wall construction, glazing type, lighting power density, equipment power density and window area (Figure 49). The HVAC system that indicated improvement was an under floor air distribution system, which was not considered feasible for this building.

A basic package of measures explored 10% improvement to lighting efficiency (LPD 10% less than base run), 10% improvement to equipment efficiency (EPD 10% less than base run) and the addition of occupancy sensors (though they showed only marginal savings on the Potential Energy Savings chart. Window glazing could be improved from dual pane (baseline) to reflective, insulated, low E windows in a design alternative (Figure 50). Exploration of basic measures within Green Building Studio Design Alternatives helped improve EUI by 8.40% against the modeled baserun and 20.11% compared to the metered baseline. Advanced package upgrades yielded a modeled savings of 14.88% and 25.77% against the metered baseline (Table 20).

Figure 49-Potential Energy Savings Chart for Seymour AFB Building 4601

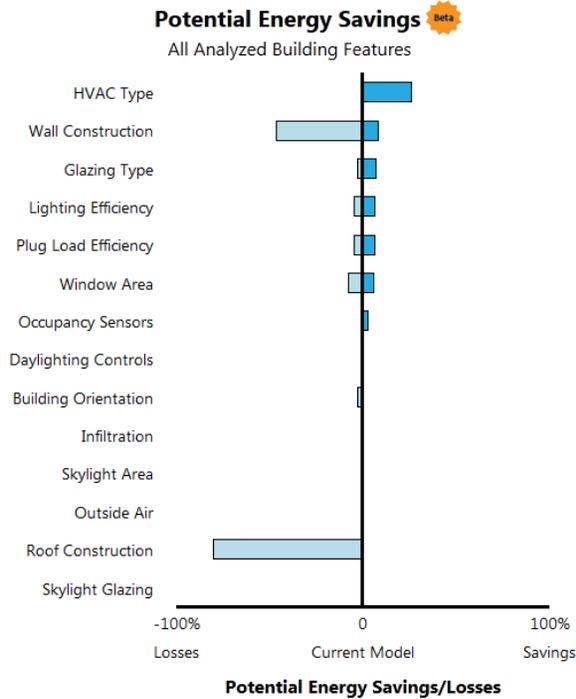


Figure 50-Basic Package Improvements – Building 4601

| Lighting |
|--|
| Lighting Efficiency |
| LPD 10% less than base run |
| Lighting Control |
| Occupancy/Daylighting sensors & controls |
| Equipment Power Density Value |
| Default |
| Light Power Density Value |
| Default |
| Equipment Efficiency |
| EPD 10% less than base run |
| Number of People |
| Default |
| Occupancy |
| No change |
| Daylighting Control |
| Off |
| Occupancy Sensor |
| On |

Figure 51-Advanced Package Improvements – Building 4601

| General | | Lighting | | |
|---------------------------------------|--------------|-------------------------------|--|--|
| Rotation | 0 | Lighting Efficiency | LPD 10% less than base run | |
| HVAC | No Change | Lighting Control | Occupancy/Daylighting sensors & controls | |
| Outside Air Flow Per Person Value | default | Equipment Power Density Value | Default | |
| Infiltration | No Reduction | Light Power Density Value | Default | |
| Infiltration Value | Default | Equipment Efficiency | EPD 10% less than base run | |
| Outside Air Flow Per Floor Area Value | | Number of People | | |

| Roof | Northern Walls | Southern Walls | Western Walls | Eastern Walls |
|--------------|----------------------|----------------------|----------------------|----------------------|
| Construction | Construction | Construction | Construction | Construction |
| No Change | No Change | No Change | No Change | No Change |
| | Glazing Type | Glazing Type | Glazing Type | Glazing Type |
| | Insulated Grey Low-e | Insulated Grey Low-e | Insulated Grey Low-e | Insulated Grey Low-e |
| | Glass Amount | Glass Amount | Glass Amount | Glass Amount |
| | No change | No change | No change | No change |

Table 20-Design Alternatives Packages for Energy Savings– Seymour AFB Building 4601


| RUN | | EUI - kBtu/FT² | Cost Electric at .07/kWh | Cost Fuel at .85/therm | Cost Energy- Annual | Electric kWh | Electric KBTU | Fuel | Fuel KBTU | TOTAL KBTU | Carbon Emissions (tons) |
|--|------------------------------------|-------------------|--------------------------------|------------------------------|---------------------------|-----------------|------------------|-------------|-----------|---------------|-------------------------------|
| Metered Baseline | | 88.4 | \$39,515 | \$16,069 | \$55,583 | 564,493 | 1,926,615 | 18904.51271 | 1,890,000 | 3,816,615 | |
| Modeled Baserun | | 77.1 | \$52,244 | \$6,647 | \$58,891 | 746,343 | 2,547,270 | 7,820 | 781,953 | 3,329,223 | 716.60 |
| ECM Basic Package | | 70.6 | \$44,722 | \$7,390 | \$52,112 | 638,890 | 2,180,532 | 8,694 | 869,400 | 3,049,932 | 605.8 |
| ECM Advanced Package -with Window Improvement | | 65.6 | \$42,501 | \$6,457 | \$48,958 | 607,156 | 2,072,223 | 7,597 | 759,700 | 2,831,923 | 565.2 |
| Basic Package Savings -Modeled Baserun | Savings from Original Run | 6 | \$7,522 | -\$743 | \$6,778 | 107,453 | 366,739 | -874 | -87,447 | 279,292 | 111 |
| | Percent Savings | 8.40% | 14.40% | -11.18% | 11.51% | 14.40% | | -11.18% | | 8.39% | 15.46% |
| Advanced package savings -Modeled Baserun | Savings from Original Run | 11 | \$9,743 | \$189 | \$9,932 | 139,187 | 475,047 | 223 | 22,253 | 497,300 | 151 |
| | Percent Savings | 14.88% | 18.65% | 2.85% | 16.87% | 18.65% | | 2.85% | | 14.94% | 21.13% |
| Basic Package Savings -Metered Baseline | Savings from Original Run | 18 | -\$5,208 | \$8,679 | \$3,471 | -74,397 | -253,917 | 10,211 | 1,020,600 | 766,683 | |
| | Percent Savings | 20.11% | -13.18% | 54.01% | 6.24% | -13.18% | | 54.01% | | 20.09% | |
| Advanced Package Savings with Windows VS Metered Baseline | Savings from Original Run | 23 | -\$2,986 | \$9,611 | \$6,625 | -42,663 | -145,609 | 11,308 | 1,130,300 | 984,691 | |
| | Percent Savings | 25.77% | -7.56% | 59.81% | 11.92% | -7.56% | | 59.81% | | 25.80% | |
| Compared to Metered Baseline, Adding Window Improvements to ECM package produced additional savings of: | | 5.66% | 5.62% | 5.80% | 5.67% | | | | | | |
| Additional Annual Cost Savings of: | | | \$2,221 | \$932 | \$3,154 | | | | | | |

6.4 TIME AND COST TO ENERGY MODEL

While constructing BIM models, researchers documented the time required for model creation and energy analysis and compared time required for each workflow. These time-based tests were completed after a significant period of testing and workflow refinement. The Revit-based workflow required an average of 27.54 minutes (SD=6.75). This included time required for creation of FormIt mass models in the field, model enhancements in Revit, and energy analysis in Revit. The Vasari based workflow required an average of 17.81 minutes (SD=5.87), including integrated energy analysis natively in Vasari.

Buildings that required more time were often more complex in shape, with open courtyards or drill decks, such as dormitory building 484 in Panama City, FL (Figure 52). This building required 45 minutes to model and run energy analysis using the FormIt to Revit workflow and 35 minutes to model and run analysis with the Vasari workflow. Green Building Studio analyses required an average of 7 additional minutes for each design alternative or set of design alternatives investigated, regardless of whether the XML was recreated in Revit or Vasari.

Figure 52-Building Model

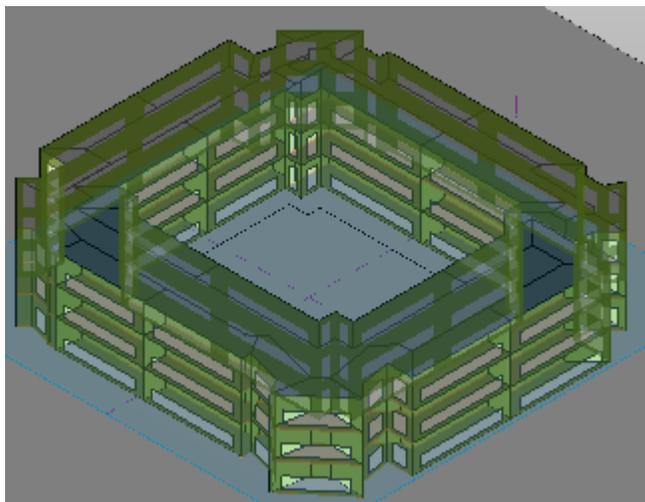

Given the data above, it can be reasonably assumed that conceptual energy models and analysis can be executed in one hour or less. It should be noted that this assumes that no travel is required, and does not include time required for installation personnel to answer questions regarding building construction and operations (the average time required for this aspect is 2 hours unless assumptions are derived from satellite photos and building knowledge instead of building documentation).

Existing methods employed by the DoD to measure energy consumption and building performance has historically been limited to benchmarking or energy audits. While benchmarking methods (such as Energy Star® Portfolio Manager or CBECS) are quick, they do not identify specific opportunities for energy-saving opportunities in buildings and are often imprecise because they are not customized to the building and are thus prone to significant error. They too, are subject to the problems with access to and availability of quality data.

Traditional energy audits might be more accurate and customized than benchmarking, but are labor intensive, expensive, and time-consuming and require a high level of expertise, therefore are not scalable across the DoD portfolio.

Three levels of energy audits are typically used: walkthrough (ASHRAE Level 1), general (ASHRAE Level 2), and investment grade (ASHRAE Level 3). Requirements for each of these levels can often lack detail and it is generally acknowledged that the levels do not have distinct boundaries (Shapiro, 2009). In general, however- audit levels may include the following:

| | |
|----------------|---|
| Level 1 | <ul style="list-style-type: none"> • Rapid assessment of building energy systems by doing a building walkthrough • Building energy benchmarking using benchmarking tools such as Energy Star® or CBECS • High-level definition of opportunities for energy conservation • Time: 1-2 days; Cost: \$500-\$700 per day (CROTON) |
| Level 2 | <ul style="list-style-type: none"> • Usually follows a Level 1 audit • Detailed building survey of systems and operations • Breakdown of energy source and end use • Identification of energy conservation measures • Range of savings for the energy conservation measures • Identification of Operational Discrepancies • Outlining priorities for limited resources, next steps, and identification of ECMs that require additional data collection and analysis (ASHRAE Level-3) • Time: 3-10 days; Cost: \$500-\$700 per day (CROTON) or \$1,500-\$7,000 per building |
| Level 3 | <ul style="list-style-type: none"> • Usually follows a Level 2 audit • Focuses on whole-building computer simulation • Computer program is used to model the way the building would respond to changes in the energy systems and installation of ECMs • Requires longer term data collection and analysis using data loggers • Whole-building computer simulation calibrated with field data • Bid-level construction cost estimating • Investment-grade, decision-making support • Time: 10-50 days; Cost: \$500-\$700 per day (CROTON) |

Researchers investigated whether Rapid Energy would allow buildings to be evaluated within a shorter time and smaller budget than budget. While REM processes include the many of the benefits of Levels 1-3 energy audits, the workflow does not provide a direct match to one particular audit type, but is a closer match to the outputs of an ASHRAE Level 2 audit, with added benefits of computer simulation of a Level 3 audit.

Using the 23 buildings within the ESTCP data set, ASHRAE Level 2 audits of these buildings could cost \$179,673 based on an audit cost of \$.12 / ft² (Baechler et al., 2011).

With an assumed time requirement of three hours per building which would include survey collection, modeling, and energy analysis, and using the hourly rate of \$100 per hour as a proxy for DoD energy manager time, trained DoD staff can create energy models for approximately \$300 per building or approximately .005 per ft², representing significant cost savings (96.17%) at a total of \$6,900 for the 23 buildings and time savings (96.25%) compared to auditing approaches (Table 21).

It should be noted that researchers are not recommending replacement of ASHRAE audits for DoD facilities, however given the time, expense and expertise required for ASHRAE audits, REM approaches can be used at early stages of energy analysis to determine which buildings are: poorly performing, the best candidates for retrofits and may present the best potential opportunities for energy savings, with the added benefit of computer simulation and modeled comparison of energy conservation measures.

Table 21-Comparison of REM and Level 2 Cost and Time Savings

| | | |
|--|---|----------------|
| Assuming Cost of .12 / sf for Level 2 Audit | Level 2 Audits for 23 sample buildings would cost \$179,673 | |
| Assuming time required for L2 Audits 3-10 days | | |
| Est Cost for REM at 100/hr; 3 hr per building ; 23 buildings | \$6,900.00 | \$.0046 per sf |
| Cost Savings per SF over L2 Audits | 96.17% | |
| Time Savings Low End (hours) | 87.50% | |
| Time Savings High End (hours) | 96.25% | |

6.5 QUALITATIVE PERFORMANCE OBJECTIVES

6.5.1 Ease of learning technology, ease of use and expertise required

Autodesk has recently begun technology transfer associated with the ESTCP Rapid Energy Modeling Demonstration Project. Researchers have assembled a training curriculum that includes a webinar, hands-on demonstration and free optional enrollment in an advanced certificate program.

Webinar

Researchers have developed curriculum to be opened to DoD personnel on November 11th. The webinar is broken out into sections that include: Rapid Energy Modeling Introduction and Benefits, Modeling Methodologies using FormIt, Vasari and Revit, and Green Building Studio. The webinar includes annotated videos with step by step instructions on how to create the models. A trial run of the webinar indicates that it can be delivered in 2.5 hours. The webinar will be made available to DoD personnel via the web. Webinar notes and accompanying videos will also be available online.

Hands-On Training

Researchers will complete online hands-on training for a minimum of five DoD staff. To date, training has occurred with three staff and has been completed by one staff member. The training involved a two hour meeting with:

- 15 minute overview of basic Rapid Energy Modeling concepts, data input requirements, and an overview of ESTCP results
- 15 minute demo of model creation and energy analysis in Vasari, driven by Autodesk staff
- 30 minute segment where controls are passed to DoD installation staff and they re-create model, energy analysis and reports in Vasari
- 20 minute segment on Green Building Studio capabilities for design alternatives and PES analysis; Autodesk and DoD staff share and alternate computer controls
- Remainder of time for questions and contingency in the event of technical issues

Barriers to facilitating this training have arisen due to the sequester, the Government shutdown, network restrictions, travel restrictions, web-conferencing restrictions and software access restrictions. Researchers are currently investigating how to optimize web-based training for DoD staff given these constraints.

The one participant to complete training to date has been able to re-create their first simple building model and generate an energy report in 30 minutes using instructor prompts, provided curriculum and a sample data set. At the Autodesk University annual conference in December 2013, 60 participants from diverse sectors were trained on REM and completed an energy model a 75 minute hands-on lab.

Workflow Options and Ease of Use

Given the diversity of user profiles, goals, availability of building information and time, there are multiple workflows to select from, based on end goals, systems, access and user profiles.

Table 22-Comparison of Technologies Used

| Program | System & Access | Functionality and Output | Limitations | User Profile |
|---------------|---|---|---|---|
| FormIt | App for iOS and Android tablets currently; browser version in beta. | Can be used to create geo-referenced and scaled conceptual building models using satellite images. Can be used at building site or in the office. Models can be brought into Revit or Vasari for further customization and energy analysis. | Requires a tablet (desktop browser version currently in beta) Does not currently have integrated energy analysis, reporting, or communication with Green Building Studio and the DOE 2 engine (feature is currently in development). | User who wants flexibility to create rapid mass models in the field or office using a tablet User who wants to build model using auto scaled image, rather than manually scaling satellite image in Revit and building entire model in Revit Requires minimal |

| | | | | practice / expertise |
|------------------------------|--|---|---|---|
| Revit | Windows desktop software from Autodesk. Part of ELA for many Army, Navy and Air Force buildings | <p>Can be used for conceptual mass models and conceptual energy analysis</p> <p>Can also be used to create detailed BIM models with building elements, interior spaces, zones, wall, window, floor constructions with unique thermal properties, as well as MEP.</p> <p>Communicates with GBS and also runs energy analysis natively in Revit.</p> <p>Export of energy data as XML or energy report PDF</p> | <p>Does not have integrated satellite mapping cannot create geo-referenced and scaled conceptual building models using satellite images without specialized add ins.</p> <p>Requires scaling of satellite image, jpg file or import of .rvt file from FormIt or Vasari.</p> <p>Number of features and views not used in REM workflows that may could confuse new users.</p> | Revit has more functionality than FormIt or Vasari and may require more time, training and a higher level of expertise from the end-user |
| Vasari | <p>Currently available for free beta windows desktop trail at AutodeskVasari.com</p> <p>Considered a lightweight version of Revit for energy modeling and analysis</p> <p>Many capabilities are in process of migration to FormIt browser-based version.</p> | <p>Can be used for rapid creation of conceptual mass models and energy analysis</p> <p>Can be used to create geo-referenced and scaled conceptual building models using satellite images.</p> <p>Communicates with GBS and also runs energy analysis natively in Vasari.</p> <p>Export of energy data as XML or energy report PDF</p> | Cannot create detailed BIM models but mass models (.rvt files) can be brought into Revit if detailed models are desired at some point. | <p>Simple and streamlined program for introduction to REM workflows.</p> <p>User can take utilize knowledge in Revit once basic skills are learned.</p> |
| Green Building Studio | Autodesk subscription service, required for energy analysis in Revit and but not required for | Backend performing energy analysis in Vasari and Revit | Detailed energy analysis can be done in eQuest or EnergyPlus where | Interface takes user training and practice to navigate |

| | | | | |
|--|---|--|--|---|
| | energy analysis in Vasari Driven by DOE 2.2 engine; defaults designated by ASHRAE standards and other industry sources | Web service provides additional capabilities for customization of utility rates, PES analysis, equipment and systems customization, design alternatives, renewable energy potential, exploration of data tables and other enhancements Export of energy data as XML, VRML, DOE-2, and EnergyPlus. | there is more control over equipment and schedules | successfully Extensive documentation and user help on Autodesk wikipedia 30 day free trial and free subscription for students and educators |
|--|---|--|--|---|

6.5.2 User Satisfaction

Survey results are pending completion of webinar and hands-on training sessions. The three personnel who have received training to date have expressed a high degree of satisfaction with results from ESTCP for their installation, the ease and speed of the workflow, and content in reports and Green Building Studio dashboards.

There is intrigue around the ability to produce rapid coarse models with acceptable results that will allow staff to do comparative runs and quickly answer questions about which parameter has the most influence on the building, such as the roof, walls, windows, etc. Staff have communicated that REM is a good way to answer questions that are often explored by DoD energy managers when initially contemplating upgrades.

6.5.3 Ability to Scale Across DoD

DoD staff will be trained using webinars and written curriculum produced during the ESTCP project. As added value, DoD staff who participated in the ESTCP demonstration have been invited to enroll in the [Autodesk Building Performance Analysis \(BPA\) Certificate Program](#) under a group specifically for DoD installation staff.

The program is a no-cost, online self-paced program that will help improve knowledge of building science fundamentals and for BPA. Content of the program includes eight modules involving tutorials, quizzes and software exercises.

Completion of this advanced training may take between 20-25 hours and upon completion, participants will receive a certificate and badge.

6.6 PERFORMANCE OBJECTIVE CONCLUSIONS

REM offers a rapid, scalable and transferrable methodology with good to reasonable levels of accuracy for predicting electricity, natural gas and EUI consumption in DoD buildings. Electric results were consistently higher in accuracy than gas or EUI results and researchers recommend further exploration around gas results. The project's performance metrics provided insight on accuracy and deviations, however the correlation of energy use curves and building use categories provide greater insight on accuracy of results and on variations throughout the year. Deviations observed between meter and modeled data can be used to identify which buildings are not operating as expected and should be prioritized for further investigation and considered for retrofits.

The REM workflows allow DoD facility managers and energy managers to quickly create building models based on limited information and quickly generate reports and answer questions related to building energy consumption. Additionally, using the PES chart and automatic simulations, staff can quickly see sensitivity of the building to changes in parameters, and the comparative value of modifications to HVAC, roof, walls, windows, lighting, equipment etc.

The workflow allows DoD to answer questions related to which energy conservation measures (ECMs), including combinations of measures can result in potential energy savings. The REM workflow is easy to learn and DoD facility managers can generally begin creating energy models and interpreting results after 3 hours of instruction. REM workflows can help scale energy analysis throughout the DoD at a pace that is significantly faster than ASHRAE audits that require significant expense and expertise. REM results can help DoD make informed decisions about which buildings are using the most energy, can benefit most from energy retrofits, and may be the most practical to meter and audit. This technology can also allow the DoD to meet existing energy auditing and energy management reporting requirements including EISA 2007.

Initial cultural indications are that this method is well received at the installations. While the technology is new, this process utilizes a category software tools that are familiar to installation facility asset managers (Google Earth and CAD/BIM software). The learning curve for this technology is measured in hours, and the startup fees are low. This provides support that this technology can be used in production at the installations and move beyond its current prototype status. A continuation of our technology transfer activities; with installation site visits, web presentations, in person conference presentations and collaboration with CERL and USACE CAD BIM Technology Center and other DoD energy management branches can help provide and understanding of how this technology may be applied and expand its use.

7.0 COST ASSESSMENT

Cost estimates are organized into high and low range estimates for a given site. The high range estimates assume computer hardware and would be purchased. This assumed hardware purchase is not mandatory as existing installation laptop/desktop computers can be used for the REM solution. The high range estimate also assumes software will be purchased specifically for this task. This may not be necessary as the Air Force, Navy and the Army Corps of Engineers have existing enterprise software licenses for most software titles used for REM. The software titles not covered in the enterprise agreements are available as free software downloads. The low range

cost estimates assume the utilization of existing installation hardware and the use of the existing enterprise licensed (or free) software.

7.1 COST MODEL

The REM cost model consists of the following cost element components:

Table 23-REM Cost Model

| Cost Elements (Unit One) | Data Tracked During the Demonstration | Estimated Costs for Installation | Unit Measure |
|--|--|---|-------------------------|
| Hardware capital costs* | Typical Laptop/Desktop cost during demonstration period | \$1,350 | Per user |
| Software Costs** | COTS software fees during project demonstration | \$4,590 | Per Installation |
| Software Installation Costs | Time/Labor to install/downloaded software | \$200 | Per user |
| Operational Costs | Level of effort to model building, add operational attributes and produce energy model and reports | \$300 | Per building |
| Software Maintenance | Frequency of available software upgrades | \$600 | Yearly |
| Operator Training | Length of time for training session (1day) | \$500 | Per user |
| * Assuming no existing desktop or laptop hardware | | | |
| ** Assuming no access to existing Department of Defense Enterprise Software Licenses | | | |

Life Cycle Cost Elements

Hardware Cost Element: Existing mid-tier current computer hardware either laptop or desktop can be used for the application of this technology. A four year refresh cycle is assumed on the hardware components. This hardware is needed to run the application software and to provide access to satellite imagery of the studied buildings.

Software Cost Element: Software to process the Rapid Energy Modeling data are include the list below. No single installation will need all software listed and requirements will vary depending on the context of each installation.

Software Installation Costs: This project is primarily a software based activity with no installation of energy equipment hardware as part of the project or eventual deployment of this technology at the installations. Installation costs include the time to download and/or install the software. Satellite imagery used in this study is from free public image sources.

Software Consumable: The life cycle costs of this system will include annual software subscription fees. These fees typically are 15% of the initial purchase price of the software and are required each year that the software is utilized. These are needed to keep up with current capabilities and to maintain compatibility with all participating software.

Data Consumable: Satellite Imagery: free imagery was used for this project and proved capable for the task. The imagery is used to capture the building footprint as well as other building attributes for the REM process.

Operator Training Cost: 1 day of training per user. This training has proved effective over the web and does not require travel for the installation POC to receive the training. The training is needed to understand the operation of the software, the data collecting requirements and the data hand-offs for the REM workflow.

Life-Cycle Cost Time Frame: The lifecycle cost timeframe is four years for this project estimate.

Up Front Set Up Costs - Per Installation (High Range)

| | |
|-----------------------|----------------|
| Hardware* | \$1,350 |
| Software ** | \$4,590 |
| Software Installation | \$200 |
| Software Subscription | \$600 |
| Operator Training | \$500 |
| | ----- |
| | \$7,240 |

Up Front Set Up Costs - Per Installation (Low Range)

| | |
|-----------------------|----------------|
| Hardware* | \$0 |
| Software ** | \$0 |
| Software Installation | \$200 |
| Software Subscription | \$600 |
| Operator Training | \$500 |
| | ----- |
| | \$1,300 |

The operational costs after the up-front expenditures would be \$300 per building modeled with this process multiplied by the number of buildings studied at an installation.

Operational Scaling Considerations

Our enterprise cost model is assuming one set of REM tools per installation at 185 installations as a full deployment of this technology (Table 24).

7.2 COST DRIVERS

The hardware costs and the software costs for this project are well known and reasonably predictable. The major costs have been variable costs - of collecting the operational attributes of the buildings, modeling and analyzing buildings and creating ECMs. This may well prove to be the case with a larger population of sites. Some installations have this operational information readily available. At other locations this information is in disparate sources that make collecting the information more challenging and potentially increasing costs. In these cases were this information cannot be obtained cost effectively (or at all) default ASHRAE settings are used to cap data collection costs. An additional cost driver is the number of buildings studied with the REM methodology. This is a linear progression with the per-building REM modeling costs outlined in section 7.1.

Site specific and regional issues may come into play through the interaction of the installation POC with the IT department at each installation. The installation of new software titles may require IT participation. The process to add new software titles vary per agency and per location. This is a potential cost variable to consider when deploying this technology. DoD Enterprise-wide life cycle costs for REM components are summarized in Table 24.

7.3 COST ANALYSIS AND COMPARISON

REM utilizes recently available digital 3D modeling technologies. The REM approach does not conform precisely to existing energy assessment methods making direct comparisons challenging but in the end productive. Also as there is no energy efficiency equipment installed at the installation with this demonstration project some of the life cycle cost methods are difficult to fit to this project.

A useful approach in forming a life cycle cost understanding of this technology is to compare REM to ASHRAE Energy Audits. While REM and energy audits approach the subject matter from different viewpoints with substantive differences in methodology, there is a significant overlap in the data produced, accomplishing similar asset management objectives and in the overall desired outcomes.

REM Per-Building Operational Costs Compared to ASHRAE Audits

Reported costs for detailed energy audits may vary from \$0.12 up to \$0.503 per square foot, depending on the size and complexity of the building (Baechler et al., 2011). For the purposes of this study, researchers used the low-range estimate. In this study of 23 buildings comprising 1,497,275 ft² of conditioned space was modeled. This yields a low-end cost of \$179,673 using the value of \$0.12 per ft². to conduct a Level 2 audit on the population of the studied REM buildings. In comparison, applying the REM process to this population of buildings yielded \$0.005 per ft². for a total cost of \$6,900 to conduct the REM process on the total population of 23 buildings, comprising 1,497,275 gross square feet.

| | | |
|-----------------------------|------------------------------|-----------|
| Typical Level 2 Audit Costs | 1.49m GSF (for this project) | \$179,673 |
| REM Cost | 1.49m GSF (for this project) | \$6,900 |

From this demonstration project the REM process has shown to be useful to in making energy management decisions. The REM process can be accomplished with personnel with less exacting expertise in energy systems, saving personnel cost and increasing the ability to scale. With the number of individuals doing energy assessments, the number of buildings studied can also increase. These characteristics of REM allow this process to be more cost effective then conducting typical Level 2 audits.

REM may also precede the standard energy audit process to act as a triage with justifiable recommendations to select the high priority buildings for more detailed study. With the ability to compare the relative merits of a variety of ECMs the REM process can act as a quick proxy for informing installations where to concentrate BLCC project cost studies and follow-on detailed actions.

Table 24-DoD Enterprise Wide Life Cycle Cost for REM Components

| Life Cycle Cost for REM Components - High Range | Unit Cost | Year 1 Costs | Year 2 Costs | Year 3 Costs | Year 4 Costs | Total Costs |
|--|------------------|---------------------|---------------------|---------------------|---------------------|--------------------|
| Revit Architecture | \$4,590.00 | \$22,950.00 | \$137,700.00 | \$229,500.00 | \$459,000.00 | \$853,740.00 |
| Revit Architecture Subscription | \$575.00 | \$2,875.00 | \$17,250.00 | \$28,750.00 | \$57,500.00 | \$106,950.00 |
| Green Building Studio* | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| Vasari - free download | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| FormIt - free download | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| REM Process Training (1 day) - per student costs | \$500.00 | \$2,500.00 | \$15,000.00 | \$25,000.00 | \$50,000.00 | \$93,000.00 |
| Laptop - minimum system requirements | \$1,350.00 | \$6,750.00 | \$40,500.00 | \$67,500.00 | \$135,000.00 | \$251,100.00 |
| | \$7,015.00 | \$35,075.00 | \$210,450.00 | \$350,750.00 | \$701,500.00 | \$1,297,775.00 |

**Complimentary Service with Revit Architecture Subscription*

| Life Cycle Cost for REM Components - Low Range | Unit Cost | Year 1 Costs | Year 2 Costs | Year 3 Costs | Year 4 Costs | Total Costs |
|---|------------------|---------------------|---------------------|---------------------|---------------------|--------------------|
| Revit Architecture | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| Revit Architecture Subscription | \$575.00 | \$2,875.00 | \$17,250.00 | \$28,750.00 | \$57,500.00 | \$106,950.00 |
| Green Building Studio* | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| Vasari - free download | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| FormIt - free download | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| REM Process Training (1 day) - per student costs | \$500.00 | \$2,500.00 | \$15,000.00 | \$25,000.00 | \$50,000.00 | \$93,000.00 |
| Laptop - minimum system requirements | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 |
| | \$1,075.00 | \$5,375.00 | \$32,250.00 | \$53,750.00 | \$107,500.00 | \$198,875.00 |

**Complimentary Service with Revit Architecture subscription*

| Staffing Assumptions | |
|----------------------------------|-----|
| Number of Staff in Year 1 | 5 |
| No of additional Staff in Year 2 | 30 |
| No of additional Staff in Year 3 | 50 |
| No of additional Staff in Year 4 | 100 |

8.0 IMPLEMENTATION ISSUES

To facilitate the future deployment of this technology the following topics should be considered.

8.1 METER DATA COMPARISONS

There were several issues related to implementation of the project tied to comparison of model estimates to meter data. These are germane in the execution of this demonstration pilot as a blind study, but may be of reduced significance in future deployments of this technology because often the meter data often does not exist or is unusable, and the technical confidence for this approach has been demonstrated by this project.

The results of this project recommend REM as a method to improve DoD building data availability considering the difficulty with the current building energy meter deployments at the Department of Defense. REM also helped identify meters that were not functioning correctly, or were not scaled correctly. While meter comparisons were important for this blind study, these comparisons will be less important in future deployments of this technology. Meter data does not impact the recommendations of ECM directly, as ECM recommendations are not based on meter data being available. If meter data is available it increases the transparency of the energy performance of a building and can supplement the ECM decision process in support of the REM ECM recommendations.

There are numerous concerns with the quality of meter data at DoD buildings, including common issues of zero readings, time gaps, negative readings, large jumps or jumps in usage, and unknown or incorrect scaling of meters. There were also other issues where facility personnel were unaware of how meters were divided amongst building(s), how to access interval data, how to identify or correct meter scaling, and instances where staff inaccurately designated units, or the meter data was not trusted by staff familiar with the building (see Appendix D for summary of meter data issues with individual buildings).

The most common issues included:

- Zero readings (very common)
- Lack of interval data
- Negative readings (meter resets very common)
- Multiple meters on a building, but installation staff unaware of how the usage is divided
- Make-up readings (23rd hour of the day usually)
- Time gaps (power outages, etc.)
- Large usage/EUI spikes and or drops (could be legitimate or indicative of meter issues)
- Duplicate timestamps
- Unknown scaling
- Mislabeled units
- Difficulty obtaining 12 consecutive months of data
- Building meter data not trusted by POCs

A cluster of 12 buildings with data anomalies were removed from analysis due to:

- Meter scaling issues (4 buildings)
- Occupancy related issues (2 buildings)
- Lack of natural gas data that had been identified as available (3 buildings)
- Use of district steam instead of natural gas (3 buildings)

These numerous issues draw attention to the need for DoD to review data from existing meters for anomalies, and for additional and perhaps periodic personnel training as the Advanced Metering Initiative (AMI) continues throughout DoD installations.

Future research using the existing data set should compare current results to meter data after smoothing or removing outlier data.

8.2 SITE SELECTION AND DATA GATHERING

In general, installation personnel seem stressed, and found it difficult to take time to obtain metering data and answer building-related questions.

Several installations known to have individually metered buildings chose not to participate in REM project due to lack of manpower or previous commitments. The government sequester in effect during the study period may be adding to these resource and bandwidth issues.

Surveys to installation points of contact contained numerous energy-related questions that were used to help researchers interpret results, but are not necessary data inputs for the Rapid Energy Modeling workflows. Examples include questions about presence of data centers, number of personnel, the number of computers and servers, and the presence of kitchen or laboratory equipment, etc. Additional questions inquired about any LEED or Energy Star certifications and interior usage percentages in order to identify buildings that were mixed-use. While not factored into the building models this information helped provide context around results. When technology transfer occurs and scales across installations, data requirements can be limited to model inputs – and when unknown, defaults can be used simplifying the process.

In some cases, suspected misinformation was provided in the survey responses, particularly in estimates for window to wall ratios. When these values were unknown or suspected to be incorrect, values were estimated from onsite or aerial images. Software defaults of 40% for window to wall ratio were not used, as this high value is not representative of DoD buildings, which tend to have much lower window to wall ratios than modern commercial buildings.

Another area of uncertainty for some installations was related to existing HVAC systems. Researchers initially asked for general descriptions of HVAC systems but received minimal information with which to make appropriate HVAC system selections in the modeling tools. The initial approach was modified and facility staff was then asked to identify the most appropriate HVAC system from a list. This approach helped pinpoint the best matched HVAC system in the software tools.

Data requirements for the model can be streamlined to the following minimum data requirements:

- **Location and confirmation that building is visible via Google satellite**
- **Building year of construction and major renovation**
- **Building Use Type**
- **Operating Schedule**
- **Gross Floor Area**
- **Building Height** (*whether/not height includes unconditioned attic space or open air, conditioned spaces?*)
- HVAC system type or selection of best fit from Vasari or GBS selection options
- Number of floors (*can be estimated from satellite if unavailable*)
- Floor to floor height (*can be estimated from satellite if unavailable*)
- Percentage window glazing (*can be estimated from satellite/aerial images if unavailable*)
- Percentage skylight glazing (*can be estimated from satellite if unavailable*)
- Exterior wall construction & insulation levels (*can be estimated from satellite/aerial images and year of construction /renovation if unavailable*)
- Roof construction & insulation levels (*can be estimated from satellite and year of construction /renovation if unavailable*)
- Glazing type & skylight types: single pane, dual pane, triple pane; tinted, low-e (*can be estimated based on year of construction /renovation and location if unknown*)
- Documentation of known structural or operational idiosyncrasies

When some model inputs are unknown, assumptions can be made based on year of construction and/or retrofit and satellite images from Google or Bing. It is recommended that users try both Google and Bing, as the two sites often differ dramatically in the level of detail and quality of images provided.

If a user wants to minimize assumptions about a building, they either need knowledge of the building or access to construction documents. Construction documents would also provide the most accurate information on building floor area; however it is understood that accessing and then interpreting these construction documents could take considerable time, depending on the expertise of the user, and the availability of the documents. The use of as-built documentation was initially explored as a method for data capture; this information can be used to define interior zoning, space use types, mechanical/ electrical system design and building envelope design but given the time required, it is better suited to creation of detailed energy models, not rapid energy models.

While many assumptions can be derived from satellite images and on-site visits are not required for the REM workflows, it is helpful to have knowledge of the building, access to building documentation or access to someone with knowledge of the building to help determine model inputs.

8.3 ANALYTICAL MODELING

The analysis platform and workflow do not allow for capturing unregulated/process loads. Types of spaces with high energy consumption have potential to throw off results. Examples may include: labs, data centers or kitchens. And process load types such as exterior lights, elevators, lab equipment, or machine room equipment may also have an effect on end use.

It should also be noted that this REM methodology using the DOE 2.2 engine is not capable of modeling district systems such as steam or chilled water, nor is it capable of modeling multiple HVAC systems, radiant heat, or heat recovery systems.

Sensitivity in the models is derived from limitations in modeling or understanding of the spaces such as attics, basements, atriums, unconditioned spaces, and double height spaces. There may also be impact from exterior obstructions such as overhangs, adjacent buildings and solar shading. There may be impact from roof zones fabric gains and users need to know whether or not they are conditioned areas and treated as part of the overall floor area. Understanding of the operational schedule is also important also useful is an understanding of seasonal variations or periods or non-use, which happens frequently for DoD dormitories.

The building models that most closely followed the building profiles were also the closest in replicating the metered energy use, and it is possible that a better understanding of operating schedules, seasonal variations in usage and of space use diversity could have improved results.

Green Building Studio Development

The recently added Potential Energy Savings (PES) feature within the REM software (Green Building Studio) allows multiple simultaneous energy simulation runs, each varying values for building features. This offers significant benefit in that it automates initial exploration and identification of ECMs, allowing users to quickly see which building parameters have the most influence on energy consumption and the highest opportunity for potential energy savings.

The current ESTCP project used a beta version of the PES tool which ran 50 different building simulations. The production version since released utilizes 37 parameters and tests extreme values against the baseline mode in the initial model. This format can provide teams with a high level understanding of PES the building energy performance to each measured parameter and can provide a great deal of insight on building sensitivity to various parameters of the buildings performance.

Green Building Studio has the capability of analyzing renewable energy potential, including photovoltaic and wind energy and can also calibrate results to specific weather years for which meter data is available. A government satellite blackout in the fall of 2012 prevented researchers from calibrating energy models to the weather year in GBS and manual calibration using external weather data files was outside of the scope of the project. Future research should explore calibration to actual weather for a specific year and document which buildings would be best for renewable energy implementation based on assumed installation costs, available utility rates, modeled geometry and location.

9.0 FUTURE OF RAPID ENERGY MODELING

Rapid Energy Modeling has the potential to help DoD scale energy assessments across the building portfolio, determine which buildings in the portfolio present the best opportunity for retrofits, quickly evaluate relative benefits of energy conservation measures through auto-simulation of potential energy savings, and contribute to energy and cost savings for the DoD.

Future technical studies of REM may prove useful, for instance examining connections to operational asset management and real property databases systems such as U.S. Army Corps of Engineers Builder software, the Military Health Service Defense Medical Logistics Standard Support System (DMLSS) or the Air Force Geo-base system. With these systems; operational, material and geometric attributes of the model may be effectively loaded without operator input, scripting the data loading phase could scale the process exceptionally. With integration to these systems the REM process could prove more efficient by working within the context of the daily activities of the installation and would allow for REM analysis on the entire installation at once (Figure 53). This would allow installations to have EISA type reporting information for the entire energy modeled installation inventory each year, as opposed to 25% annually in currently mandates.

Figure 53-Peterson Air Force Base Concept - Installation Wide Energy Model



Deeper investigations may include applying REM across more climates zones and building types, comparisons of results based on building size and climate zone, or examinations of results when comparing with meter data at intervals vs. no interval data. Studies on the potential improved accuracy of REM when using smoothed meter data, as well as tracking the actual energy savings of simulated ECMs to the actual installed energy conservation hardware over time are all productive areas of future evaluations for this REM technology.

The REM technology appears to be culturally acceptable, it is low cost and allows a much larger population of DoD staff (with less expertise) to gain an understanding of the energy performance of their portion of the DoD building portfolio. These attributes make production deployment and further technical evaluations both good candidates for future actions with REM.

10.0 REFERENCES

Bibliography

Baechler MC. 2011. [A Guide to Energy Audits](#). PNNL-20956, Pacific Northwest National Laboratory, Richland, WA. Prepared for U.S. Department of Energy under Contract DE-AC05-76RL01830.

Chen RJC, Bloomfield P, Cabbage FW (2008). *Comparing Forecasting Models*. Journal of Hospitality & Tourism Research 32(1):3-21.

DOD (2005) Energy Managers Handbook. Retrieved from www.wbdg.org/ccb/DOD/DOD4/dodemhb.pdf

DOE Buildings Energy Data Book. Retrieved from <http://buildingsdatabook.eren.doe.gov.aspx>

Lewis, C. D. (1982). *Industrial and business forecasting methods: A practical guide to exponential smoothing and curve fitting* as cited in Lawrence, KD and Klimberg, RK (2010). *Advances in Business and Management Forecasting*; Emerald Group Publishing

Shapiro, I. (2009, January) *Energy Audits in Large Commercial Office Buildings*. ASHRAE Journal.

Appendix A: Points of Contact

| POINT OF CONTACT Name | ORGANIZATION Name Address | Phone E-mail | Role in Project |
|-----------------------|--|--|------------------|
| John Sullivan | Autodesk; Autodesk, Inc. 111 McInnis Parkway San Rafael, CA 94903 | john.sullivan@autodesk.com ; 301-529-7165 | PI |
| Jennifer Rupnow | Autodesk | jennifer.rupnow@autodesk.com ; 831-295-3444 | Co-PI |
| Vincent Corsello | Autodesk | vincent.corsello@autodesk.com ; 312 502 2249 | Co-PI |
| John Rittling | Autodesk | john.rittling@autodesk.com ; 703-827-7213 | Collaborator |
| Mark Frost | Autodesk | mark.frost@autodesk.com ; 541 399-2986 | Collaborator |
| Aniruddha Deodhar | Autodesk | aniruddha.deodhar@autodesk.com ; 415-356-3242 | Collaborator |
| John Kennedy | Autodesk | john.kennedy@autodesk.com ; 415-507-4739 | Collaborator |
| Trish Shurtz | Autodesk | trish.shurtz@autodesk.com ; 415-5131029 | Collaborator |
| David Scheer | Autodesk | david.scheer@autodesk.com ; 415-513-1935 | Collaborator |
| Carlos Orona | Autodesk | carlos.orona@autodesk.com ; 415-675-8205 | Collaborator |
| Alan Jackson | CASE, Inc.; 401 Broadway Suite 1600 New York, NY 10013 | a.jackson@case-inc.com ; 212-255-5483 | Collaborator |
| Steve Sanderson | CASE, Inc. | s.sanderson@case-inc.com ; 212-255-5483 | Collaborator |
| Annette Stumpf | ERDC-CERL; P. O. Box 9005, Champaign, IL 61826-9005 | Annette.L.Stumpf@usace.army.mil ; 217-373-4492 | Collaborator |
| Dale Herron | ERDC-CERL | Dale.L.Herron@usace.army.mil ; 800-872-2375 | Collaborator |
| Julie Webster | ERDC-CERL | Julie.L.Webster@usace.army.mil ; 800-872-2375 | Collaborator |
| Richard Schneider | ERDC-CERL | Richard.L.Schneider@usace.army.mil ; 800-872-2375 | Collaborator |
| Louise Sabol | DCS; 11 Dupont Cir NW Washington, D.C., DC 20036 | lsabol@dcstrategies.net ; 202-222-0610 | Collaborator |
| Barbara Heller | DCS | bheller@dcstrategies.net ; 202-222-0610 | Collaborator |
| Kesari Mudhagouni | DCS | kmudhagouni@dcstrategies.net ; 202-222-0610 | Collaborator |
| Gil Lurdes | Earle Naval Weapons Station Colts Neck NJ 732-866-2319 | lurdes.gil@navy.mil ; 732-866-2319 | Installation POC |
| Allen Simpson | Fort Leonard Wood; 1334 First Street-Bldg 2222 Fort Leonard Wood, MO 65473-8944 | allen.w.simpson2.civ@mail.mil ; 573-596-0956 | Installation POC |
| Jeannie Elseman | Fort Leonard Wood | jeannie.m.elseman.civ@mail.mil | Installation POC |
| Brian Parker | Fort Leonard Wood | bryan.l.parker.civ@mail.mil ; 573-596-0901 | Installation POC |
| Peter Behrens | Naval Station Great | peter.behrens@navy.mil ; 847-688-2121 | Installation POC |

| | | | |
|------------------|---|--|------------------|
| | Lakes; 2601 Paul Jones St, Great Lakes, IL 60088 | ext 28 | |
| Brian Eckert | Naval Station Great Lakes | brian.eckert@navy.mil ; 847-204-2752 | Installation POC |
| Sakhawat Amin | JBLM; Public works Joint Base Lewis McChord, WA 98433-9500 | sakhawat.amin.ctr@mail.mil ; 253-966-9011 | Installation POC |
| Dave Krohn | JBLM; Public works Joint Base Lewis McChord, WA 98433-9500 | david.a.krohn.civ@mail.mil ; 253-966- 1853 | Installation POC |
| Evelyn Baskin | Panama City; NAVFAC SE, PWD Panama City 101 Vernon Ave, Bldg 126 Panama City, FL 32407 | evelyn.baskin@navy.mil ; 850-230-7176 | Installation POC |
| Randy Pieper | Peterson AFB; 21st CES/CENP Peterson AFB, CO | randall.pieper.ctr@us.af.mil ; 719-556- 9590 | Installation POC |
| Brian Ballweg | Port Hueneme; Naval Facilities Engineering and Expeditionary Warfare Center (NAVFAC EXWC) Building 1100 1100 23rd Ave Port Hueneme, CA 93043 | brian.ballweg@navy.mil ; 805-982-1250 | Installation POC |
| Roberto Valdez | Port Hueneme; Naval Facilities Engineering and Expeditionary Warfare Center (NAVFAC EXWC) Building 1100 1100 23rd Ave Port Hueneme, CA 93043 | roberto.valdes@navy.mil ; 805-982-1704 | Installation POC |
| Lance Mahar | Portsmouth; Building 59/2 Portsmouth Naval Shipyard, PWD Maine | lance.mahar@navy.mil ; 207-438-5980 | Installation POC |
| Elias Schtakleff | Seymour Johnson AFB; 1510 Wright Brothers Ave Goldsboro, NC 27531 | Elias.Schtakleff@seymourjohnson.af.mil ; 919-868-9179 | Installation POC |
| Matthew Latham | Seymour Johnson AFB; 1510 Wright Brothers Ave Goldsboro, NC 27531 | Matthew.Latham@seymourjohnson.af.mil ; 919-722-7443 | Installation POC |

Appendix B: Summary Data- All Viable Buildings: Offices, Barracks, Specialty Use, Combined

| Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI (kBtu/SF) | Accuracy Model Vs Meter - Absolute (EUI) |
|---------------------------------|-------------------------|------------|---|-------|----------------|----------------------|--|---|------------------|------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| B1 | Office | Air Force | 281,732 | CO | 5,590,418 | 4,593,182 | -17.84% | 82.16% | 5524 | 1270.54 | -77.00% | 23.00% | 87.33 | 60.15 | -31.12% | 68.88% |
| 350 | Office | Air Force | 148,801 | CO | 1,728,137 | 2,046,233 | 18.41% | 81.59% | 2873.363 | 1611.969 | -43.90% | 56.10% | 58.95 | 57.77 | -2.00% | 98.00% |
| 1100 | Office | Navy | 120,925 | CA | 1,105,292 | 1,479,161 | 33.83% | 66.17% | 179.1 | 212.5311 | 18.67% | 81.33% | 32.68 | 43.51 | 33.14% | 66.86% |
| 110 | Office | Navy | 119,050 | FL | 1,768,200 | 1,897,648 | 7.32% | 92.68% | 2122.8 | 443.871 | -79.09% | 20.91% | 68.52 | 58.13 | -15.17% | 84.83% |
| 470 | Office | Army | 101,565 | MO | 1,621,858 | 1,564,214 | -3.55% | 96.45% | 2922.467 | 1060.139 | -63.72% | 36.28% | 83.28 | 63.00 | -24.35% | 75.65% |
| 3369 | Office | Joint Base | 59,578 | WA | 469,930 | 560,350 | 19.24% | 80.76% | 962.9 | 503.6395 | -47.70% | 52.30% | 43.08 | 40.55 | -5.87% | 94.13% |
| Cer1 | Office | Army | 52,739 | IL | 1,288,807 | 1,062,475 | -17.56% | 82.44% | 4560.38 | 1820.617 | -60.08% | 39.92% | 169.88 | 103.28 | -39.20% | 60.80% |
| Cer2 | Office | Army | 48,301 | IL | 979,952 | 1,022,858 | 4.38% | 95.62% | 4200.35 | 2543.372 | -39.45% | 60.55% | 156.21 | 124.93 | -20.02% | 79.98% |
| 581 | Office | Navy | 40,287 | FL | 716,700 | 604,483 | -15.66% | 84.34% | 786.1 | 238.2419 | -69.69% | 30.31% | 80.23 | 57.12 | -28.80% | 71.20% |
| 4421 | Office | Air Force | 37,088 | NC | 706,325 | 594,687 | -15.81% | 84.19% | 842 | 259.2037 | -69.22% | 30.78% | 87.70 | 61.71 | -29.63% | 70.37% |
| Cer13 | Office | Army | 23,639 | IL | 282,577 | 279,563 | -1.07% | 98.93% | 2040.17 | 606.9196 | -70.25% | 29.75% | 127.10 | 66.04 | -48.04% | 51.96% |
| 1345 | Office - Bank | Air Force | 7,772 | CO | 118,197 | 92,989 | -21.33% | 78.67% | 135.53 | 131.0553 | -3.30% | 96.70% | 69.34 | 57.70 | -16.79% | 83.21% |
| 1485 | Office - Bank | Air Force | 4,834 | CO | 57,680 | 63,413 | 9.94% | 90.06% | 142.1 | 121.2382 | -14.68% | 85.32% | 70.12 | 69.85 | -0.38% | 99.62% |
| Summary Data for Offices | | | | | | | Average Accuracy | 85.70% | | | Average Accuracy | 49.48% | Average Accuracy | 77.34% | | |
| | | | | | | | Mean Absolute Percentage Error (MAPE) | 14.30% | | | MAPE | 50.52% | MAPE | 22.66% | | |
| | | | | | | | STDEV | 8.93% | | | STDEV | 25.15% | STDEV | 14.41% | | |
| | | | | | | | CoV | 10.41 | | | CoV | 50.84 | CoV | 18.63 | | |
| | | | | | | | MFE | 2.01 | | | MFE | 18.81 | MFE | 21 | | |
| | | | | | | | MAD | 7.21 | | | MAD | 18.85 | MAD | 22 | | |
| | | | | | | | MSE | 70.28 | | | MSE | 684.38 | MSE | 913.06 | | |

| Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI (kBtu/SF) | Accuracy Model Vs Meter - Absolute (EUI) |
|---|-------------------------|------------|---|-------|----------------|----------------------|---|---|------------------|------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| 831 | Barracks | Army | 40,840 | MO | 948,960 | 777,496 | -18.07% | 81.93% | 4257.628 | 3593.201 | -15.61% | 84.39% | 183.56 | 152.96 | -16.67% | 83.33% |
| 937 | Barracks | Army | 55,724 | MO | 1,296,922 | 880,220 | -32.13% | 67.87% | 4359.926 | 3680.78 | -15.58% | 84.42% | 157.68 | 119.97 | -23.92% | 76.08% |
| 484 | Barracks | Navy | 96,130 | FL | 2,513,700 | 2,693,241 | 7.14% | 92.86% | 2208.8 | 6162.982 | 179.02% | 79.02% | 112.22 | 159.73 | 42.33% | 57.67% |
| 9136 | Barracks | Joint Base | 25,349 | WA | 255,349 | 310,415 | 21.56% | 78.44% | 2732.8 | 1669.32 | -38.92% | 61.08% | 142.19 | 107.65 | -24.29% | 75.71% |
| 373 | Barracks | Navy | 76,282 | ME | 858,400 | 1,329,284 | 54.86% | 45.14% | 4,621 | 6200.039 | 34.17% | 65.83% | 98.98 | 140.75 | 42.20% | 57.80% |
| Summary Data for Barracks | | | | | | | Avg Accuracy | 73.25% | | | Average w. outlier removed | 73.93% | | | Avg Accuracy | 70.12% |
| | | | | | | | MAPE | 26.75% | | | MAPE | 26.07% | | | MAPE | 29.88% |
| | | | | | | | STDEV | 18.07% | | | STDEV | 12.25% | | | STDEV | 11.71% |
| | | | | | | | CoV | 24.67 | | | CoV | 189.12 | | | CoV | 16.69 |
| | | | | | | | MFE | 0.999 | | | MFE | 12.43 | | | MFE | 2.71 |
| | | | | | | | MAD | 14.94 | | | MAD | 22.78 | | | MAD | 38.42 |
| | | | | | | | MSE | 279.24 | | | MSE | 650.45 | | | MSE | 1510.58 |
| 3650 | Cafeteria | Air Force | 28,013 | NC | 805,718 | 636,028 | -21.06% | 78.94% | 2669.9 | 2294.736 | -14.05% | 85.95% | 193.47 | 159.41 | -17.61% | 82.39% |
| 4103 | School | Air Force | 25,851 | NC | 650,258 | 470,667 | -27.62% | 72.38% | 0 | 310.1262 | | | 85.85 | 74.14 | -13.64% | 86.36% |
| 4601 | Firestation | Air Force | 43,187 | NC | 564,493 | 746,343 | 32.21% | 67.79% | 1,890 | 781.9529 | -58.63% | 41.37% | 88.37 | 77.09 | -12.77% | 87.23% |
| 4537 | Automotive Facility | Air Force | 38,700 | NC | 613,119 | 549,983 | -10.30% | 89.70% | 2,203 | 1251.493 | -43.19% | 56.81% | 111.00 | 80.84 | -27.17% | 72.83% |
| 640 | Gym | Army | 20,889 | MO | 287,682 | 304,660 | 5.90% | 94.10% | 2652.367 | 2627.316 | -0.94% | 99.06% | 173.98 | 175.55 | 0.91% | 99.09% |
| Summary Data for Speciality Use Buildings | | | | | | | Avg Accuracy | 80.58% | | | Avg Accuracy | 70.80% | | | Avg Accuracy | 85.58% |
| | | | | | | | MAPE | 19.42% | | | MAPE | 29.20% | | | MAPE | 14.42% |
| | | | | | | | STDEV | 11.18% | | | STDEV | 26.39% | | | STDEV | 9.47% |
| | | | | | | | CoV | 13.87 | | | CoV | 37.28 | | | CoV | 11.06 |
| | | | | | | | MFE | 6.56 | | | MFE | 10.57 | | | MFE | 17.13 |
| | | | | | | | MAD | 13.42 | | | MAD | 15.37 | | | MAD | 17.76 |
| Summary Data for All Analyzed Buildings | | | | | | | Electric | | | | Gas | | | | EUI | |
| | | | | | | | Avg Accuracy | 81.88% | | | Avg Accuracy | 58.20% | | | Avg Accuracy | 77.56% |
| | | | | | | | MAPE | 18.12% | | | MAPE | 41.80% | | | MAPE | 22.44% |
| | | | | | | | STDEV | 12.31% | | | STDEV | 24.05% | | | STDEV | 13.48% |
| | | | | | | | CoV | 15.03 | | | CoV | 43.38 | | | CoV | 17.38 |
| | | | | | | | MFE | 2.78 | | | MFE | 13.30 | | | MFE | 16.08 |
| | | | | | | | MAD | 10.24 | | | MAD | 19.75 | | | MAD | 24.92 |
| MSE | 154.12 | MSE | 671.74 | MSE | 989.07 | | | | | | | | | | | |

Appendix C. Buildings Excluded from Core Analyses

| ISSUE | Building Number | Building Type - Modeled | Division | Gross Floor Area- Modeled Conditioned Space | State | kWh From Meter | kWh from Model (GBS) | Mean Bias Error-Model Vs Meter - Electric | Accuracy Model Vs Meter - Absolute (Elec) | MMBTU From Meter | MMBTU From Model (GBS) | Mean Bias Error- Model Vs Meter - Gas | Accuracy Model Vs Meter Absolute (Gas) | Total Metered EUI (kBtu/SF) | Total Modeled EUI (kBtu/SF) | Mean Bias Error- Modeled Vs Metered - EUI | Accuracy Model Vs Meter - Absolute (EUI) |
|------------------------------|-----------------|---|------------|---|-----------------------|----------------|----------------------|---|---|------------------|------------------------|---------------------------------------|--|-----------------------------|-----------------------------|---|--|
| District Steam and Occupancy | GL 800 Series | Barracks | Navy | 366,116 | Great Lakes, IL | 4,171,440 | 9,303,226 | 123.02% | -23.02% | | 41,140 | | | 96.59 | 199.09 | 106.13% | -6.13% |
| District Steam | GL 7103 | Barracks | Navy | 528,130 | Great Lakes, IL | 7,884,549 | 8,953,476 | 13.56% | 86.44% | | 50,717 | | | 74.94 | 153.89 | 105.34% | -5.34% |
| District Steam | GL 7230 | Drill Hall (modeled as Convention Center) | Navy | 64,816 | Great Lakes, IL | 760,680 | 1,071,961 | 40.92% | 59.08% | | 3,588 | | | 206.22 | 111.80 | 45.79% | 54.21% |
| Occupancy; No Gas Data | PH 1444 | Office | Navy | 66,855 | Port Hueneme, CA | 484,693 | 767,677 | 58.38% | 41.62% | | 1219 | | | 24.74 | 57.42 | 132.08% | -32.08% |
| No Gas Data | PH 850 | Office | Navy | 15,859 | Port Hueneme, CA | 129,376 | 172,539 | 33.36% | 66.64% | | 51.19315 | | | 27.84 | 40.36 | 44.96% | 55.04% |
| Scaling | 1236 | Office | Joint Base | 47,564 | Tacoma Area WA | 32,470 | 486,235 | 1397.49% | -1297.49% | 864.5 | 1006.361 | 16.41% | 83.59% | 20.51 | 56.05 | 173.33% | -73.33% |
| Occupancy | 11654 | Barracks | Joint Base | 82,338 | Tacoma area, WA | 346,502 | 978,256 | 182.32% | -82.32% | 1559.71 | 5324.061 | 241.35% | -141.35% | 33.31 | 105.21 | 215.89% | -115.89% |
| Occupancy | 635 | Barracks | Army | 40,947 | Fort Leonard Wood, MO | 317,543 | 790,062 | 148.80% | -48.80% | 3031.25 | 4605.068 | 51.92% | 48.08% | 100.50 | 178.32 | 77.44% | 22.56% |
| Data Center | PH 2 | Office (actually an IT Center) | Navy | 49,424 | Port Hueneme, CA | 2,152,454 | 827,901 | -61.54% | 38.46% | | 158.6228 | | | 148.64 | 60.38 | 59.38% | 40.62% |
| Scaling | C2 | Office | Navy | 19,065.75 | Colts Neck, NJ | 6,700.00 | 234,258.15 | 3396.39% | -3296.39% | 1,018.92 | 459.09 | -54.94% | | 54.64 | 66.01 | 20.81% | 79.19% |
| Scaling | C50 | Automotive Facility | Navy | 26,380 | Colts Neck, NJ | 87,500 | 365,096 | 317.25% | -217.25% | 2123.5 | 238.9984 | -88.75% | 11.25% | 91.82 | 56.30 | 38.69% | 61.31% |
| Scaling | C29 | Cafeteria | Navy | 19,208 | Colts Neck, NJ | 133,400 | 328,806 | 146.48% | -46.48% | 3779.6 | 2168.674 | -42.62% | 57.38% | 220.47 | 171.33 | 22.29% | 77.71% |

Appendix D: Issues Identified with Meter Data at Individual Buildings



| BASE | Building Number | ERDC-CERL Notes- Buildings in RED were removed from core analysis due to: inadequate data, inaccurate or questionable data, lack of natural gas data, or use of district systems |
|---|-----------------|--|
| Peterson AFB Air | 1 | |
| | Bank 1-1485 | Zero gas use Jun-Aug confirmed |
| | Bank 2 -1345 | Zero gas use Jun-Aug confirmed |
| | 2004 | POC says data unreliable (remove) (did not model) |
| | 350 | |
| Panama City Navy | 581 | Summer hi/Spring lo elec (gas opposite) |
| | 485 | Sep 2012 elec peak; scaling issue with this building |
| | 484 | Fall hi/Spring lo elec; May FY10/Jul FY11 gas spikes |
| | 110 | Fall hi/Spring lo elec (gas opposite); May FY10 gas spike |
| Joint Base Lewis-McChord Air and Army | 3369 | odd electric trend |
| | 1236 | Summer/Winter hi; Spring/Fall lo; scaling issue |
| | 9136 | daily meter resets (use monthly); elec & gas trend together (no A/C) |
| | 11654 | odd electric trend; occupancy concerns |
| Port Hueneme, CA Navy | Bldg 2 | Jan'12 elec dip; odd elec trend |
| | Bldg 850 | very low elec reads w/o scaling; somewhat high elec reads w/ scaling; odd elec trend |
| | Bldg 1100 | very low elec reads w/ & w/o scaling, perhaps due to LEED EB remodel |
| | Bldg 1444 | very low elec reads w/ & w/o scaling; trending flat; no gas data |
| ERDC CERL Army | Building 1 | drop in Nov elec use; gas data from one meter for all 3 buildings ; divided by building gross floor area |
| | Building 2 | drop in Nov elec use; gas data from one meter for all 3 buildings ; divided by building gross floor area |
| | Building 3 | flat elec trend; gas data from one meter for all 3 buildings ; divided by building gross floor area |
| Fort Leon. Wood Army | B635 | metered 22 Jun 2012; using partial Jun'12 & Jun'13 elec data; Dec'12 & Apr'13 elec drops; occupancy concerns |
| | B831 | Feb FY11 drop in elec; Apr FY10 drop in elec; Feb'13 gas dip |
| | B640 | Jul'12 elec peak |
| | B470 | 2 elec meters; Apr'12 elec dip; Feb'13 gas dip; gas vol corrector lowered Mar'13 read; use trends for missing/altered data |
| | B937 | Feb'13 gas dip |
| Seymore AFB - North Carolina Air | 4601 | slight uptick of gas Apr 2011 |
| | 4421 | gas spike Apr 2011; gas drop Jun 2011 |
| | 3650 | Jul 2012 elec peak |
| | 4537 | Jul 2012 elec peak |
| | 4103 | fully elec |
| Portsmouth Naval Shipyard (Maine) - Navy | 373 | No FY10 elec to match FY10 gas (do not use); May FY11 elec lo; Jul FY12 gas drop |

| | | |
|---|-----|--|
| Naval Weapons Station Earle (New Jersey) | C29 | Winter elec peak; Odd electrical data perhaps due to scaling; gas maybe ok |
|---|-----|--|



| | | |
|--|--|---|
| Navy | C50 | Spring elec peak; Odd electrical data perhaps due to scaling; gas maybe ok |
| | C2 | Spring elec peak; Odd electrical data perhaps due to scaling; gas maybe ok |
| NAVSTA Great Lakes Navy (not clear how models will work-experimental) | Building 1 - 7230 | Nov/May lo elec reads annually (seasonal AHU/AC switchover?); steam (heat) reads have 2-yr pattern (odd). District Steam |
| | Building 2 - 7103/7104/ 7105 | Jul-Sep/Nov-Dec hi/lo elec reads; flat gas trend (<kitchen only) (ignore sgl lrg spike & drop); Jan-Mar/Sep-Oct hi/lo steam reads; most '11-'12 steam data is errant or estimated |
| | Building 3 – 830, 831, 832, 835, 836, 838, 839 | Jul/Dec hi/lo elec reads; Feb/Oct hi/lo steam reads; some negative steam data |

Appendix E: Modeled End Use Breakdowns and Potential Energy Savings Charts



Peterson – Building 1 Modeled End Use Breakdowns and Potential Energy Savings Charts

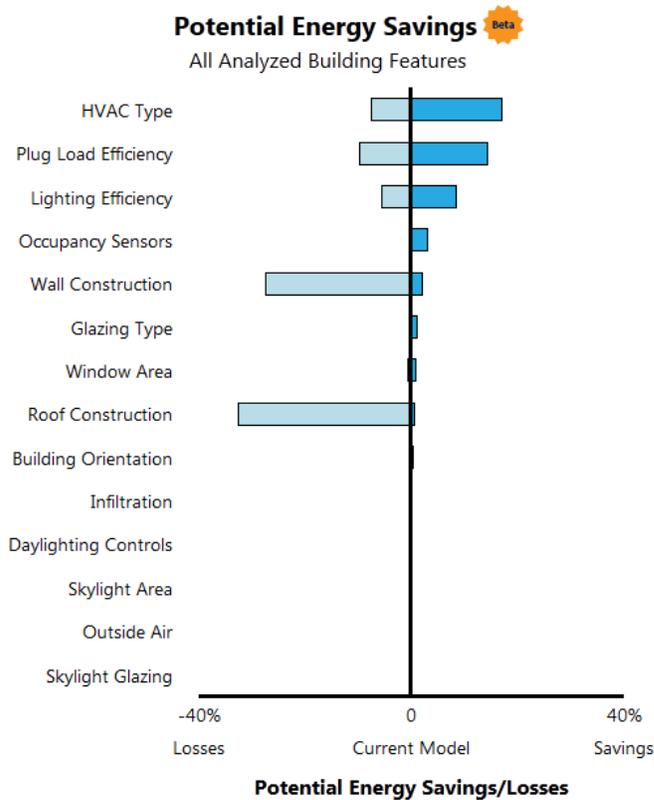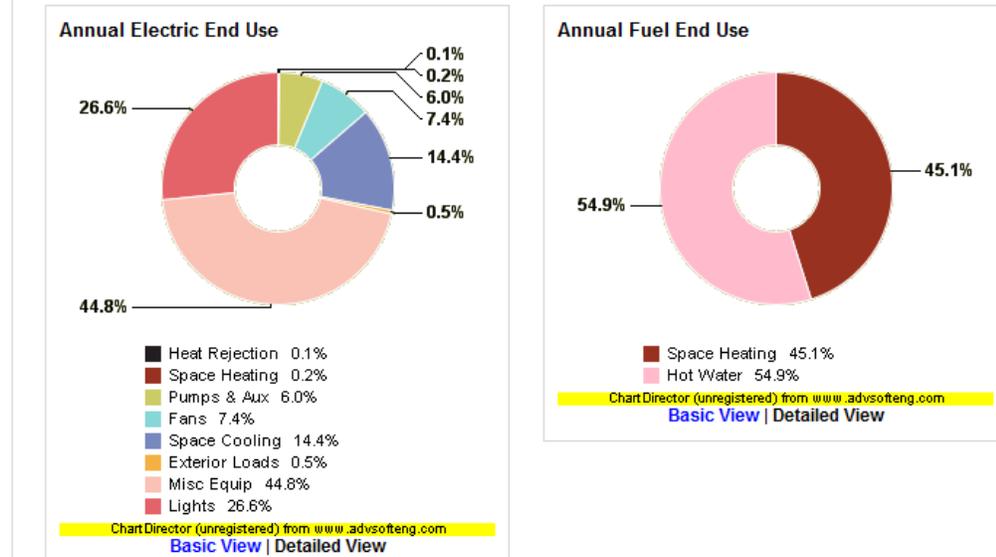

Peterson 350 Modeled End Use Breakdowns and Potential Energy Savings Charts

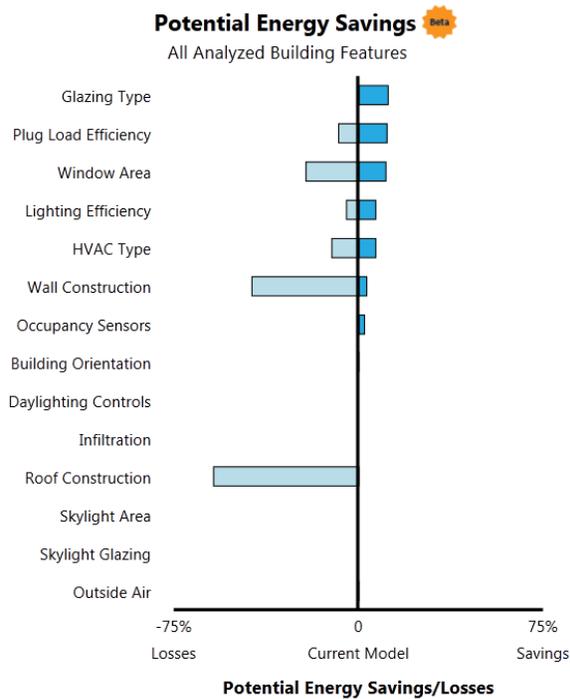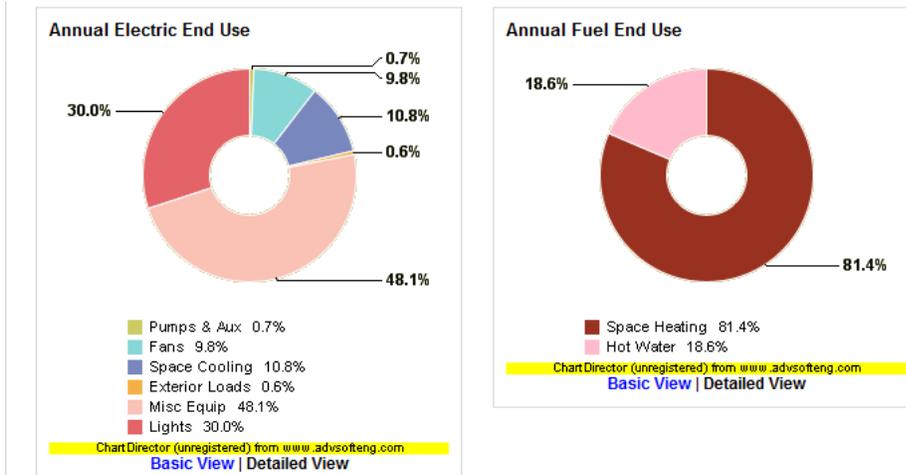


Peterson 1485 Modeled End Use Breakdowns and Potential Energy Savings Charts

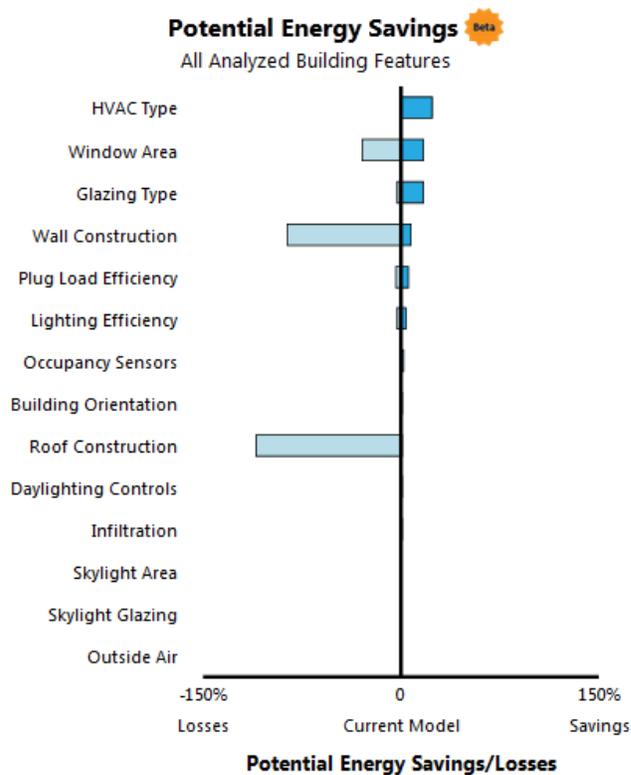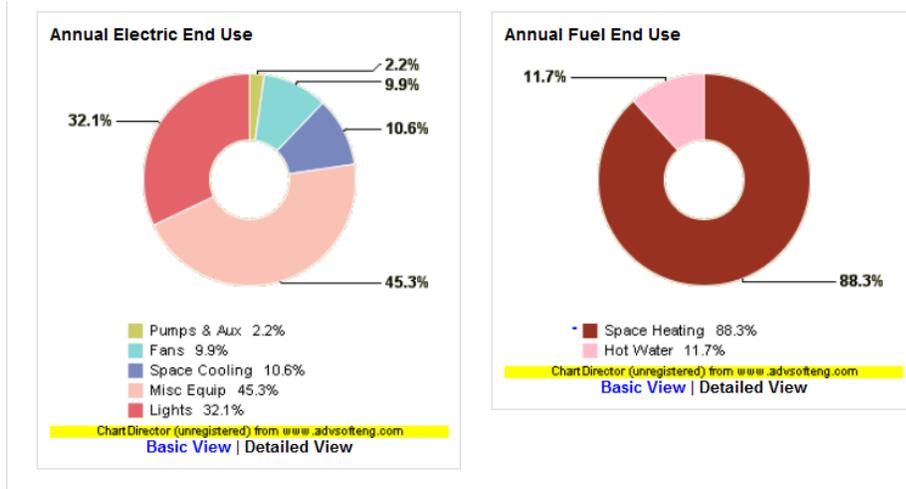


Peterson 1345 Modeled End Use Breakdowns and Potential Energy Savings Charts

Annual Electric End Use

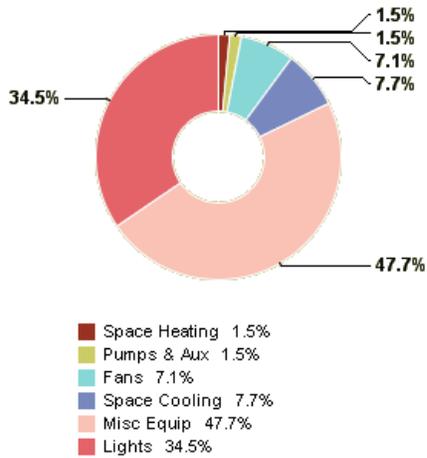

ChartDirector (unregistered) from www.advsofteng.com
[Basic View](#) | [Detailed View](#)


Annual Fuel End Use

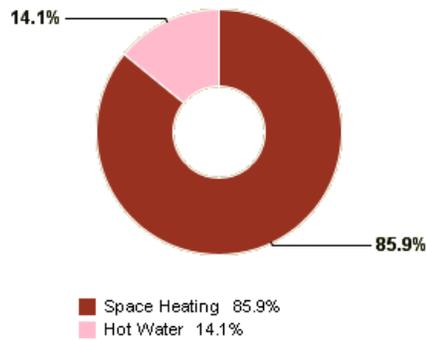




ChartDirector (unregistered) from www.advsofteng.com
[Basic View](#) | [Detailed View](#)

Potential Energy Savings Beta




All Analyzed Building Features

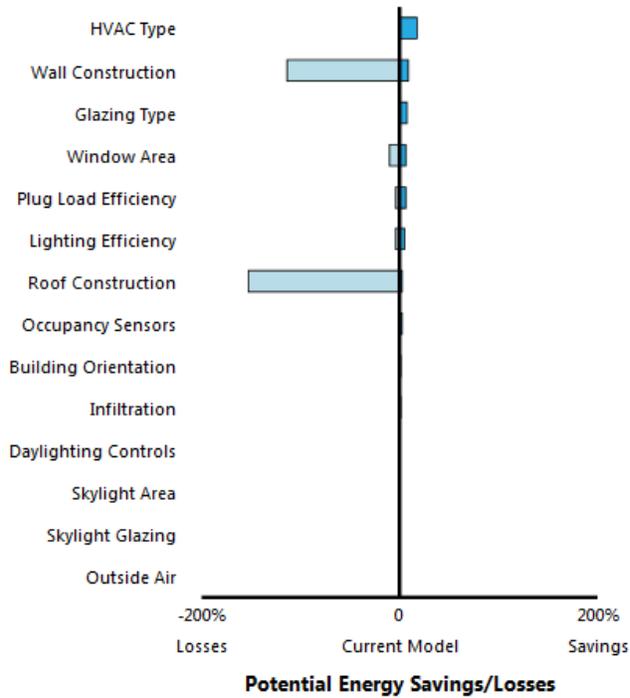




Fort Leonard Wood 831 Modeled End Use Breakdowns and Potential Energy Savings Charts

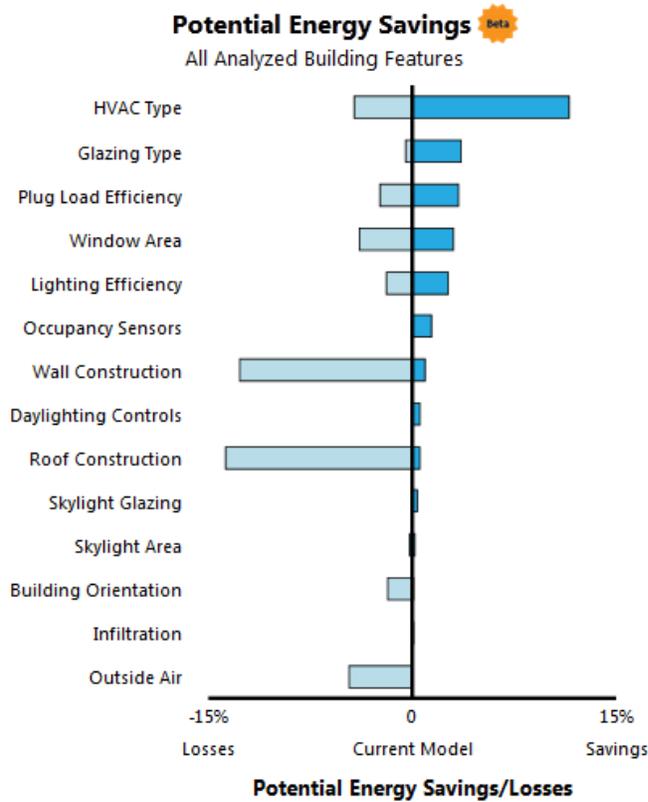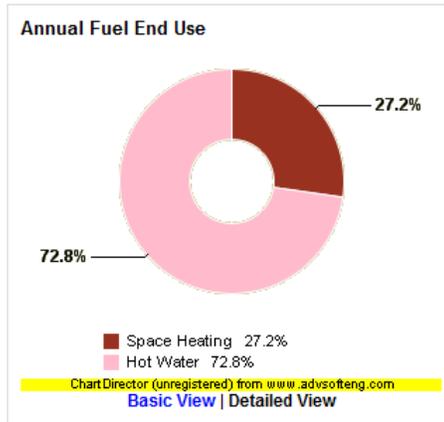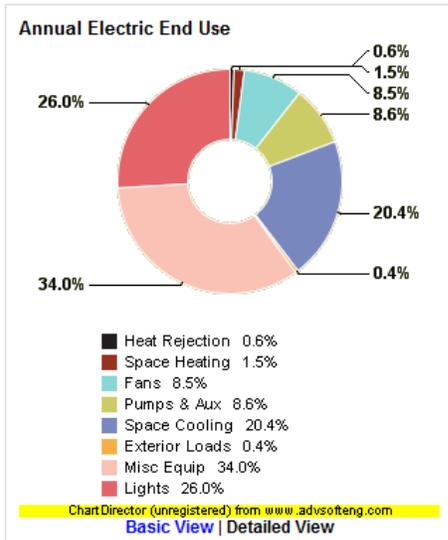




FLW 640 Modeled End Use Breakdowns and Potential Energy Savings Charts

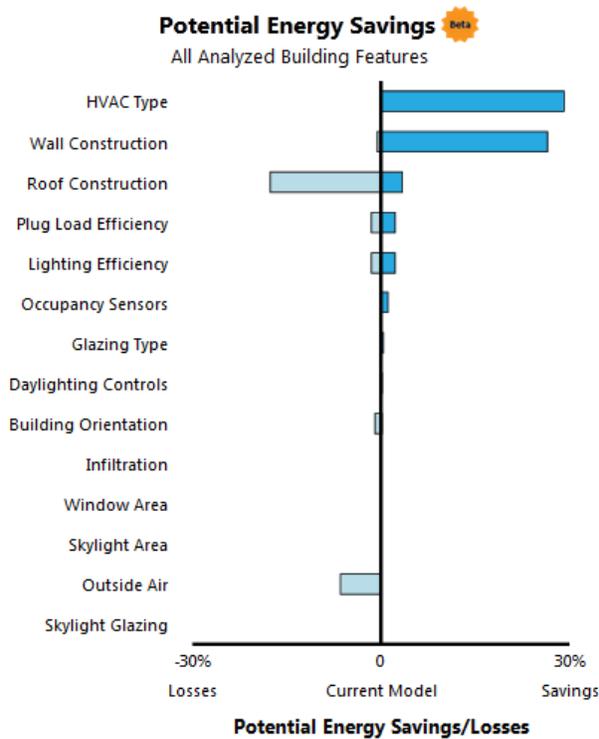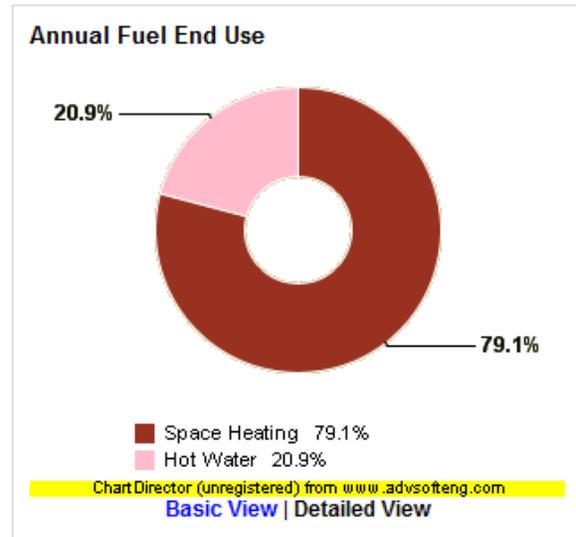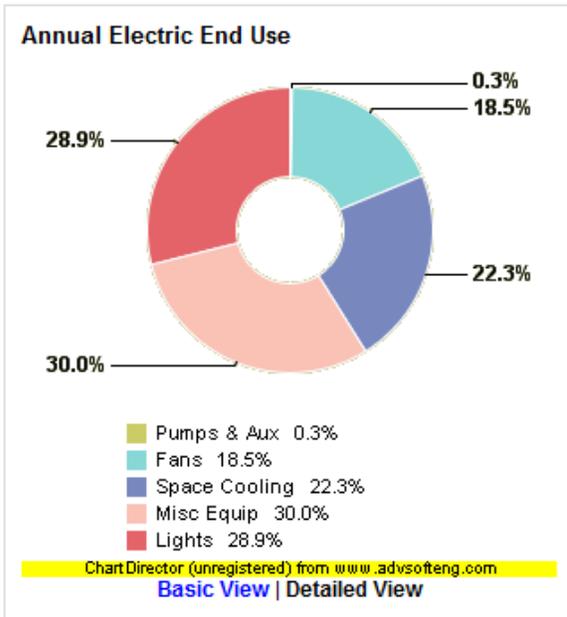

FLW Building 470 Modeled End Use Breakdowns and Potential Energy Savings Charts

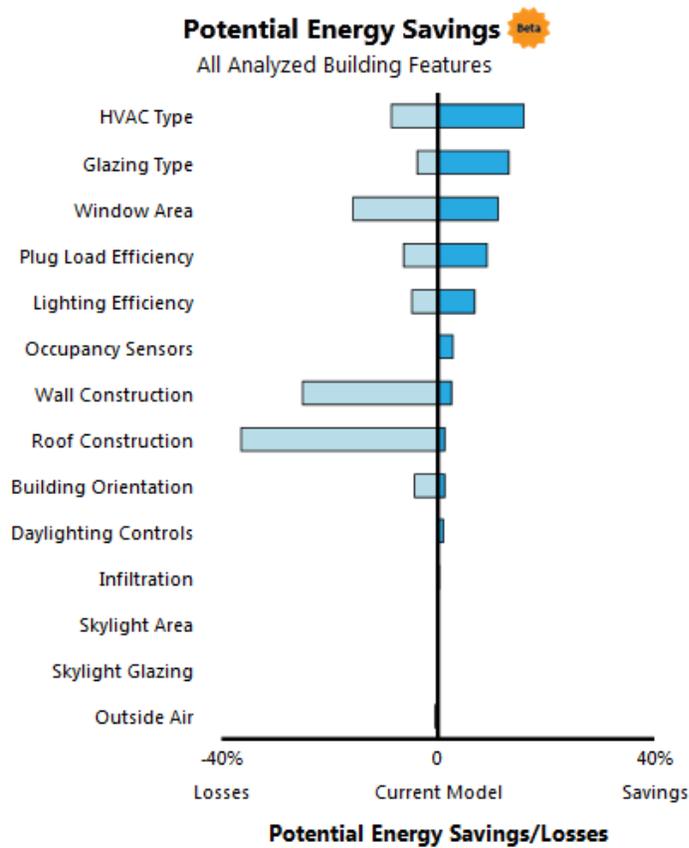
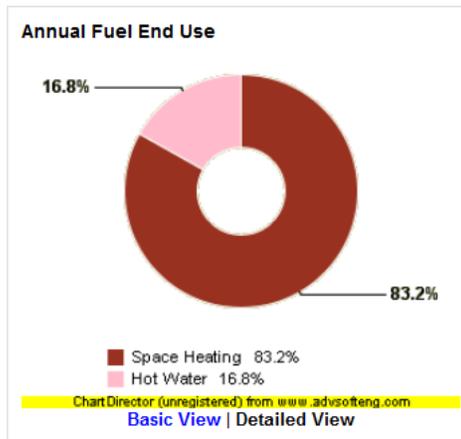
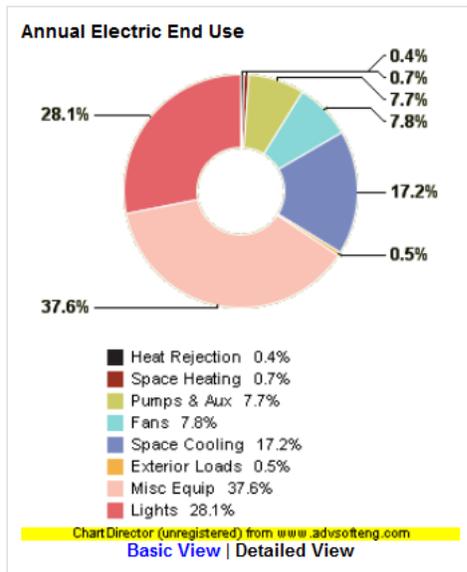


FLW 937 Modeled End Use Breakdowns and Potential Energy Savings Charts

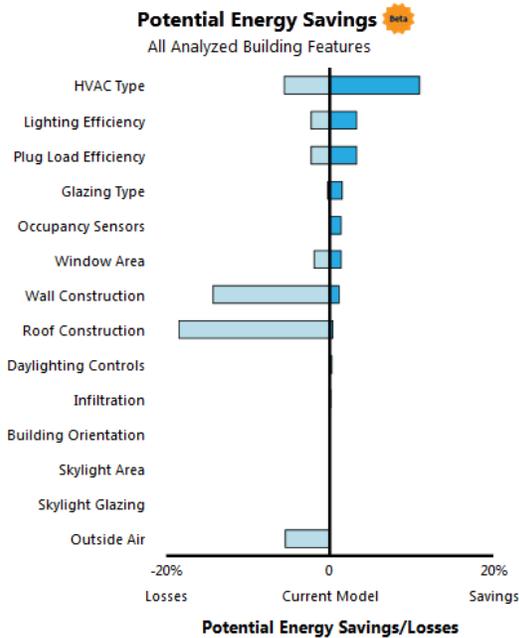
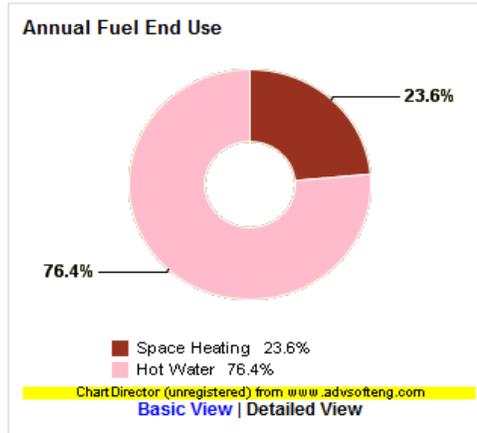
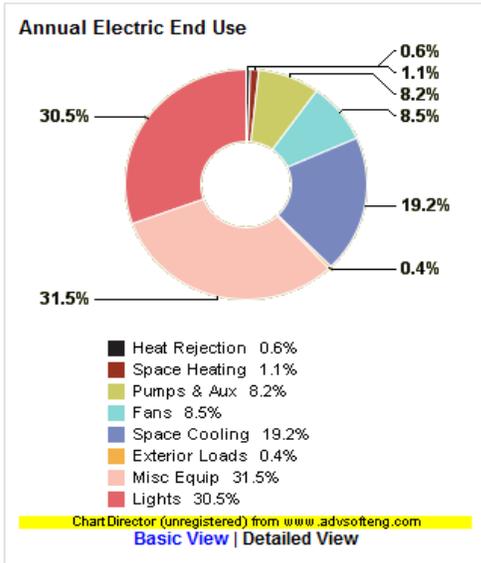


Project: FLW_937_V_Dorm_24_7
 Location: Fort Leonard Wood, MO United States
 Base Run: FLW_937_V_Dorm_Report_Ht_24_7_15p_HVAC Cha
 Date: 6/24/2013 4:39 PM




Panama City 110 -Modeled End Use Breakdowns and Potential Energy Savings Charts

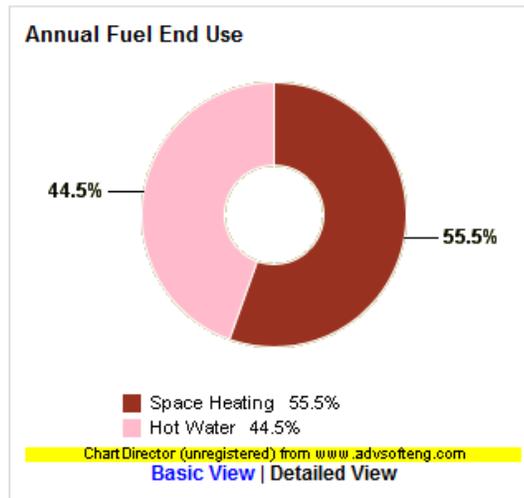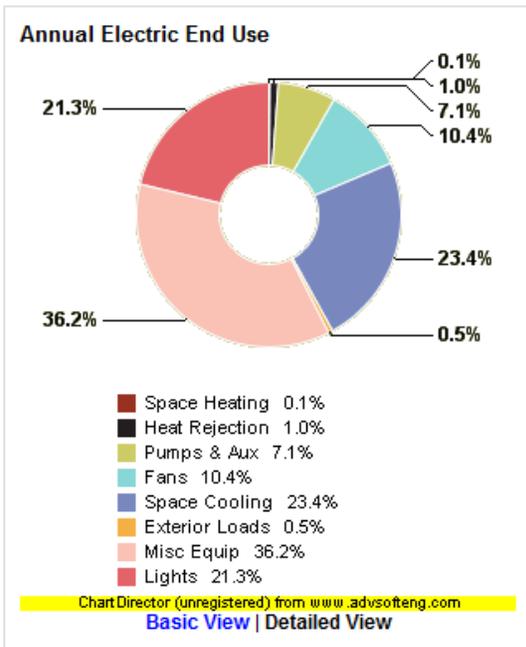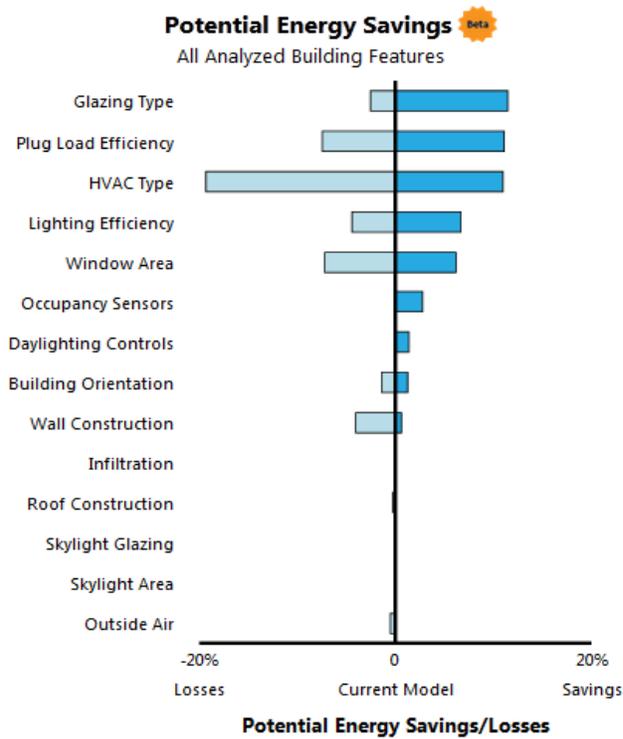




Panama City 484 -Modeled End Use Breakdowns and Potential Energy Savings Charts

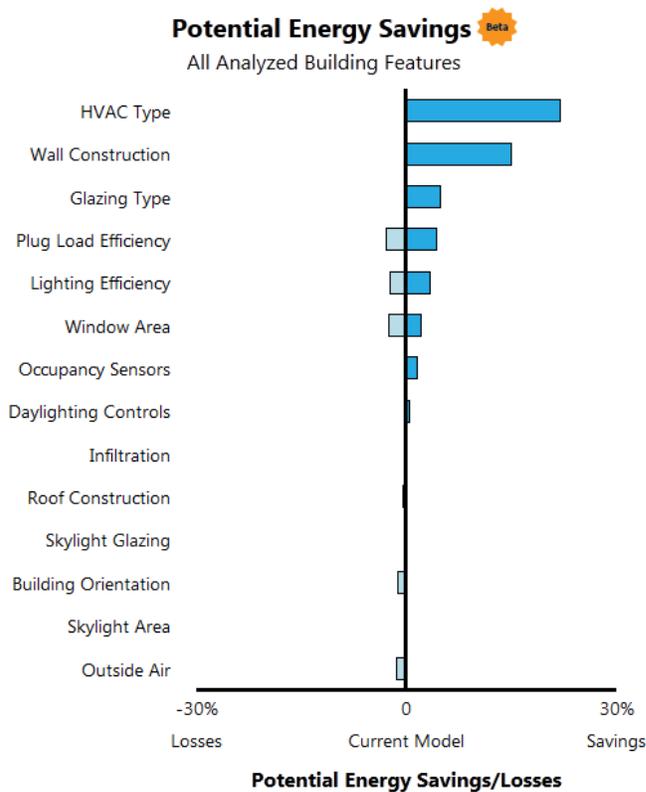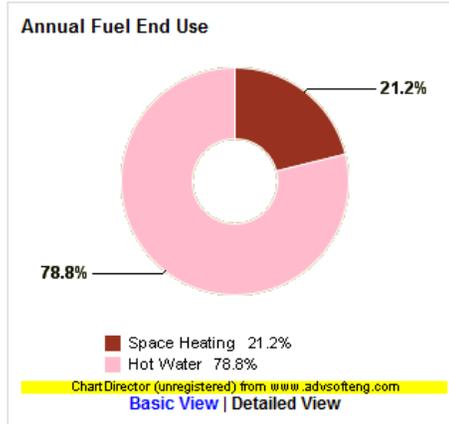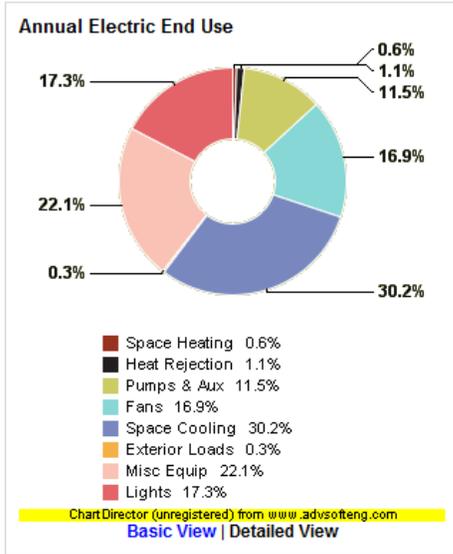



Panama City 581-Modeled End Use Breakdowns and Potential Energy Savings Charts

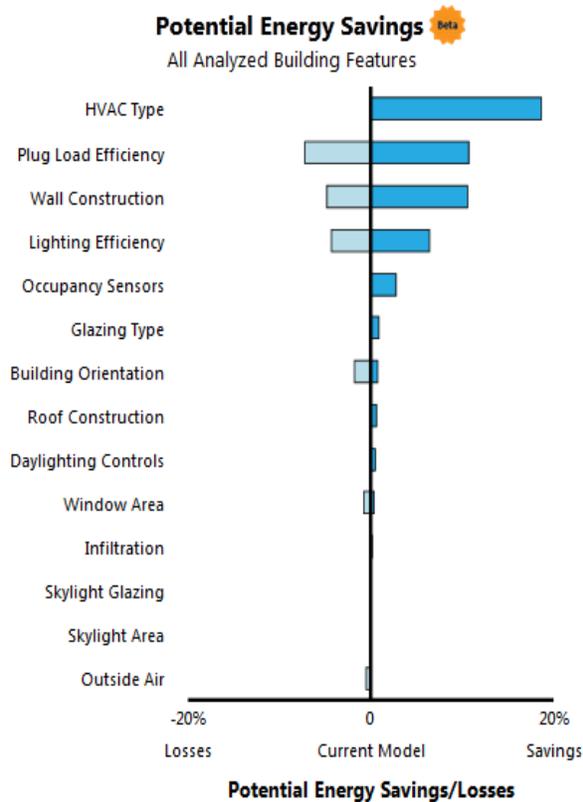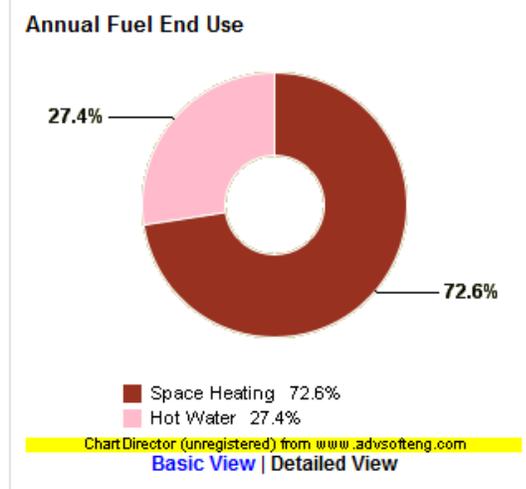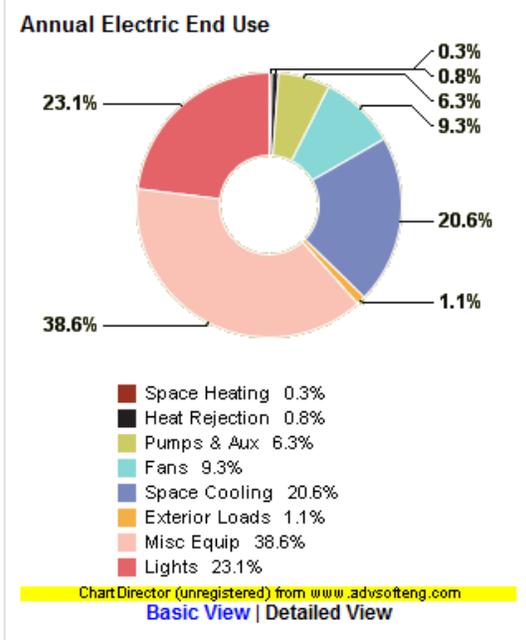




CERL Building 1-Modeled End Use Breakdowns and Potential Energy Savings Charts

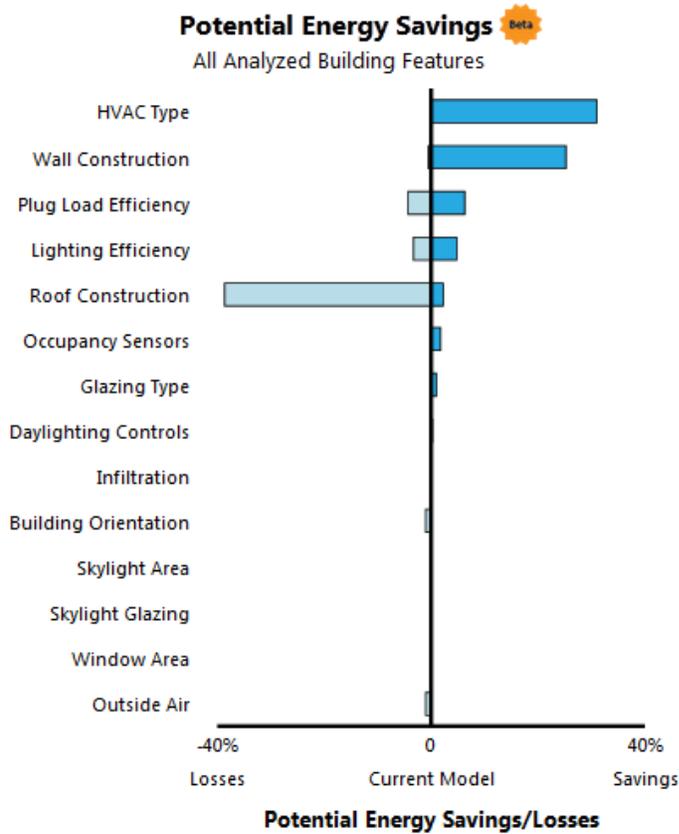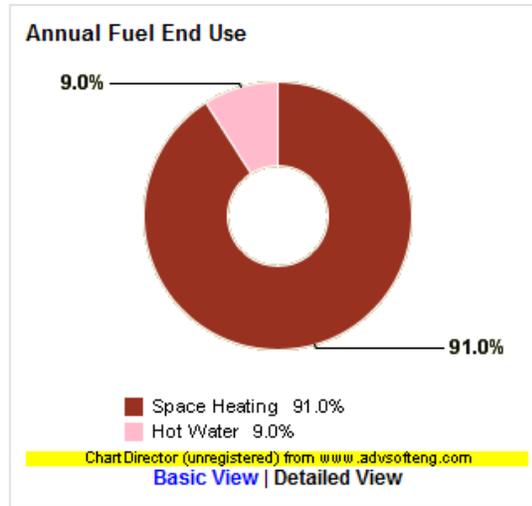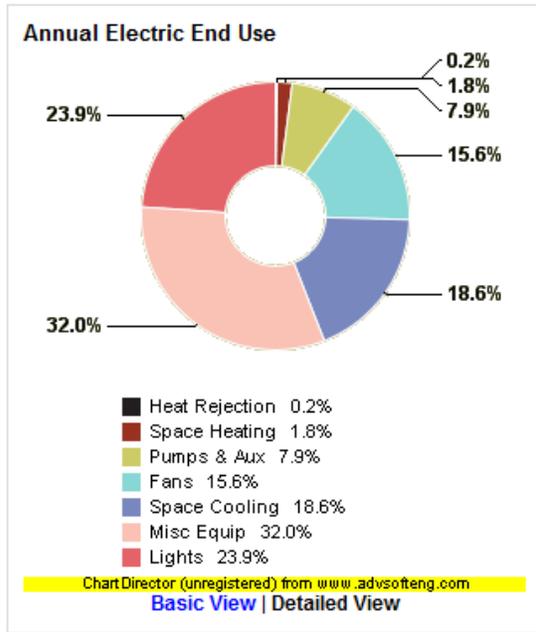



CERL Building 2-Modeled End Use Breakdowns and Potential Energy Savings Charts

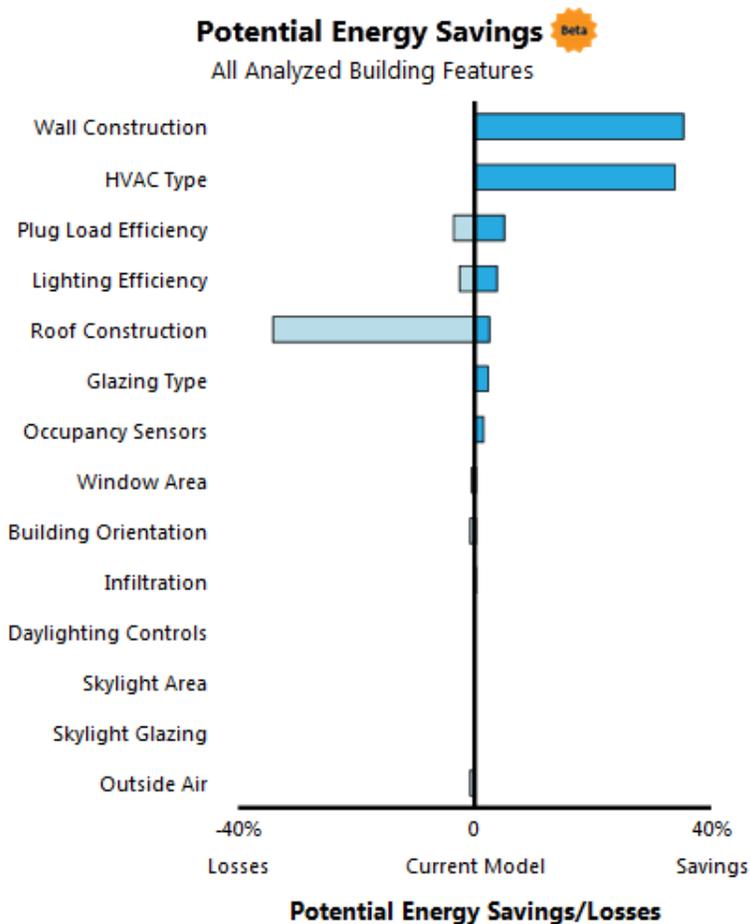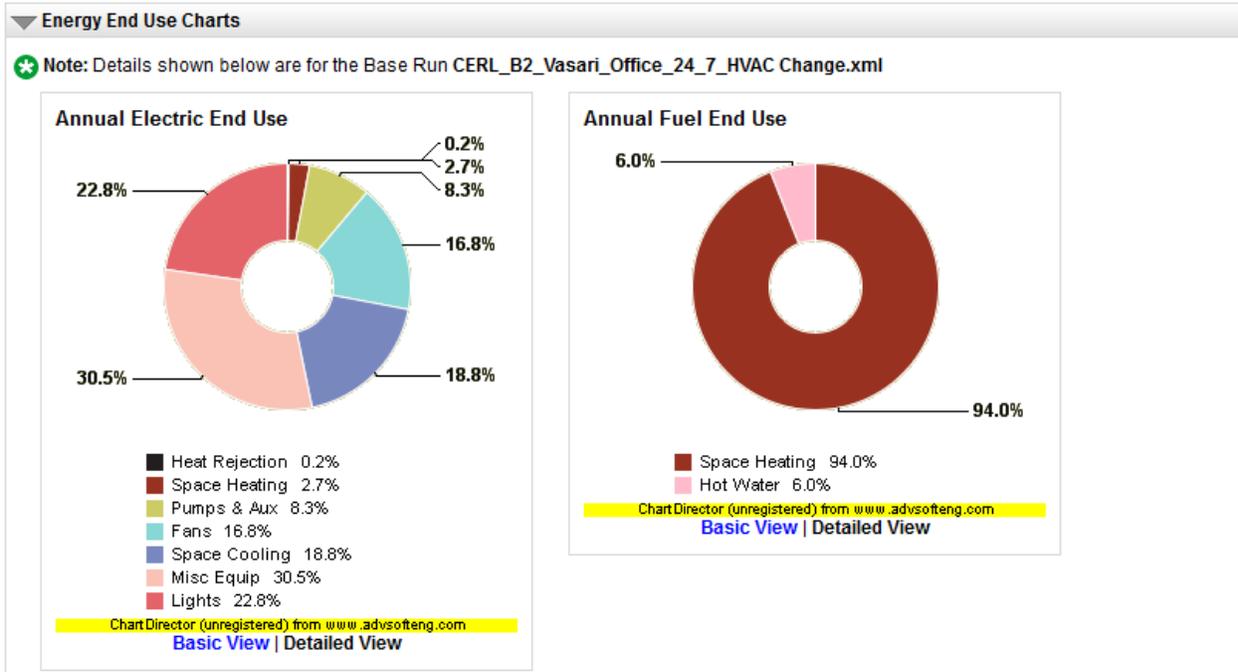

CERL Building 3-Modeled End Use Breakdowns and Potential Energy Savings Charts

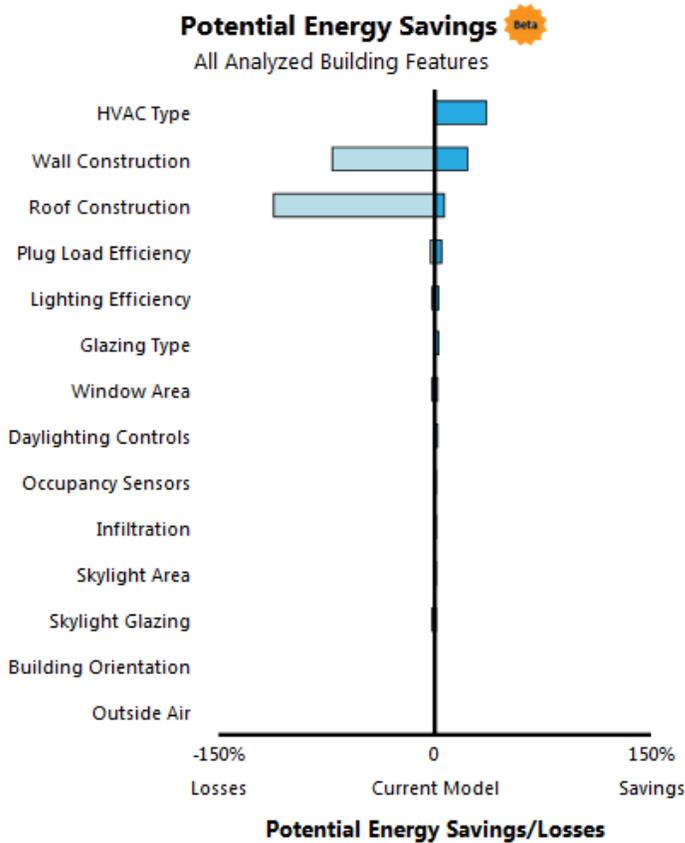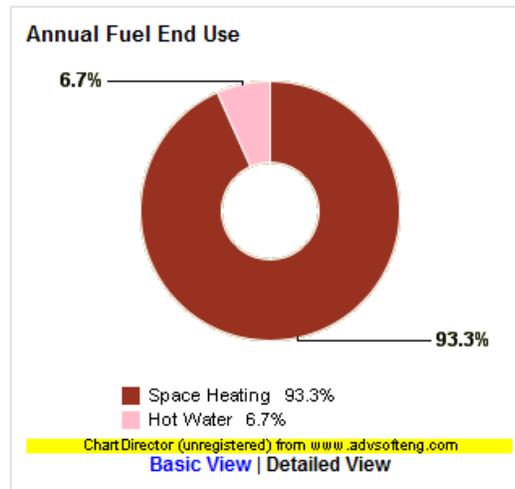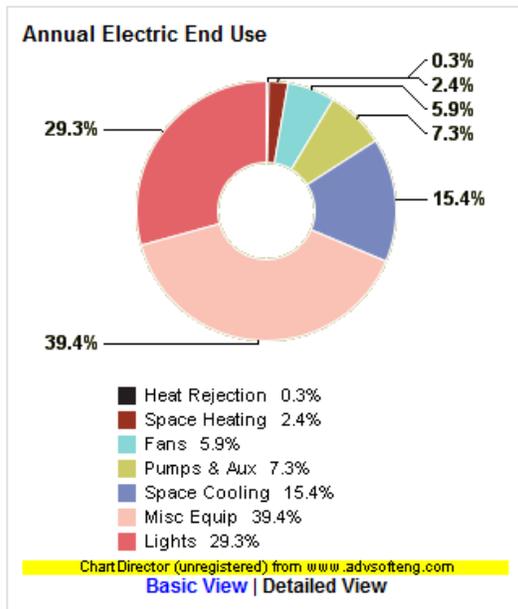


JBLM 3369-Modeled End Use Breakdowns and Potential Energy Savings Charts

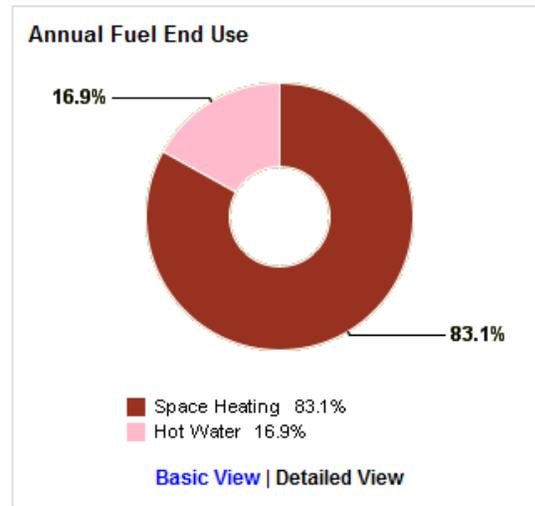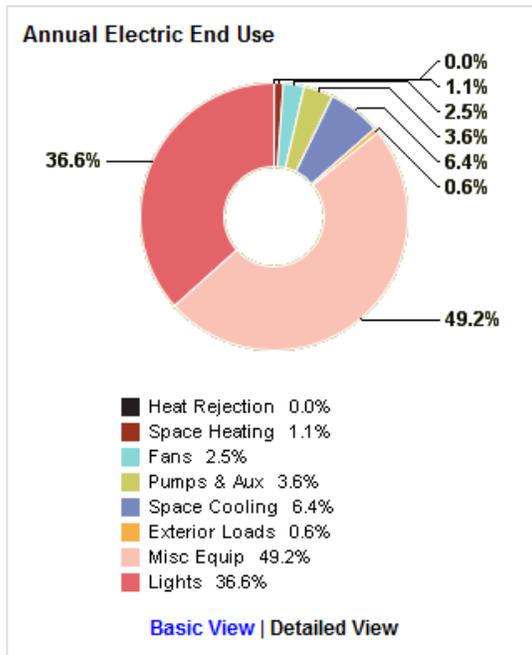

Potential Energy Savings Beta



All Analyzed Building Features

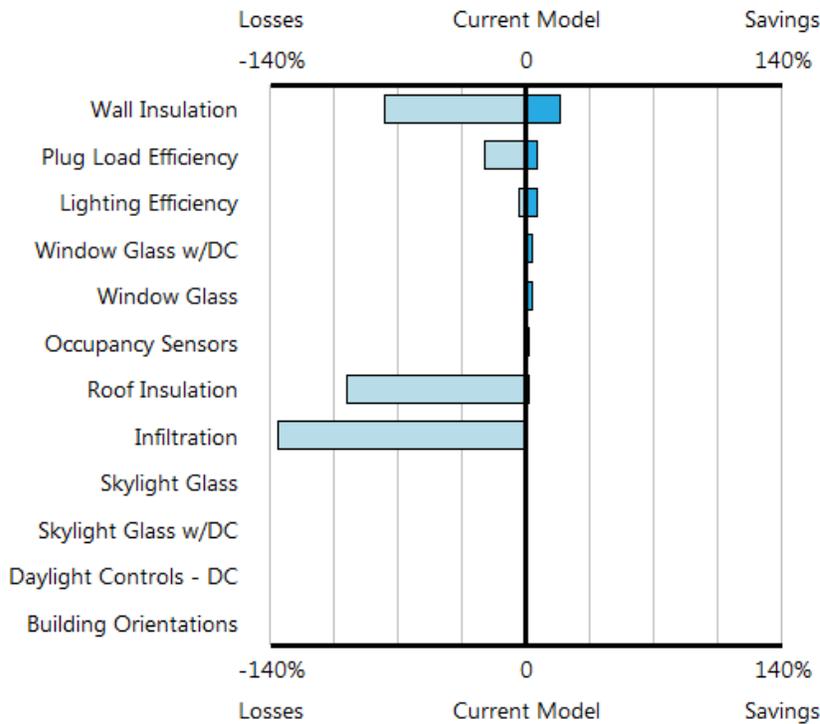

JBLM 9136-Modeled End Use Breakdowns and Potential Energy Savings Charts


Energy End Use Charts

Note: Details shown below are for the Base Run JBLM_9136_Vasari_Dorm_24_7_Short_Heat Only

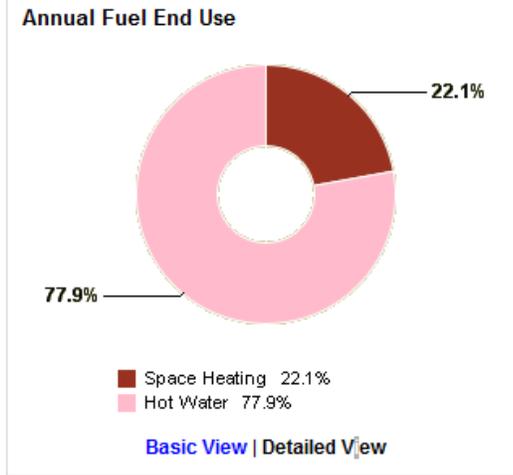
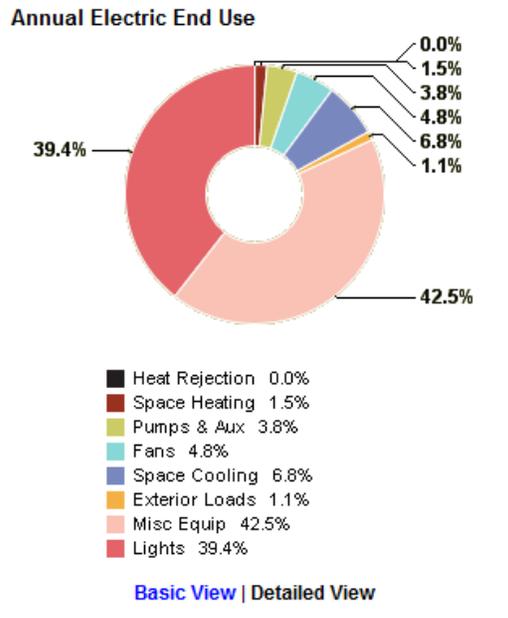


Potential Energy Savings Beta

All Analyzed Building Features

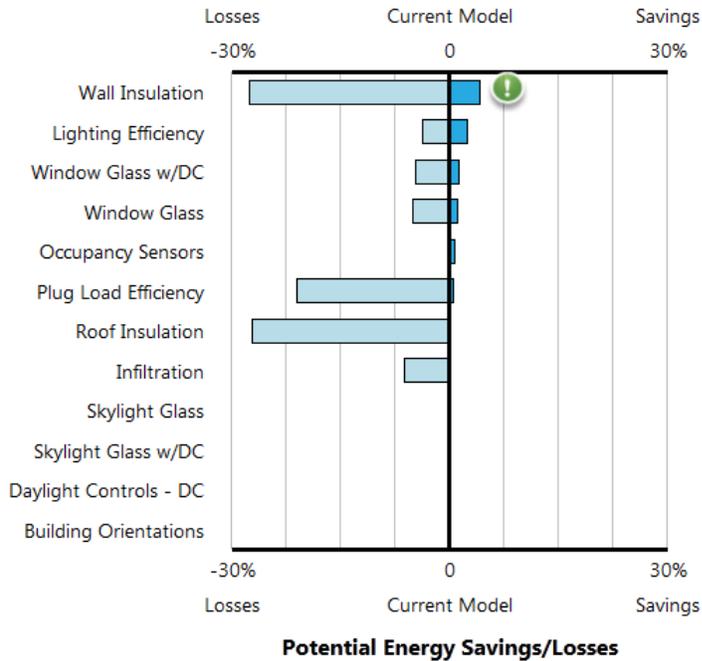


Port Hueneme 1100-Modeled End Use Breakdowns and Potential Energy Savings Charts

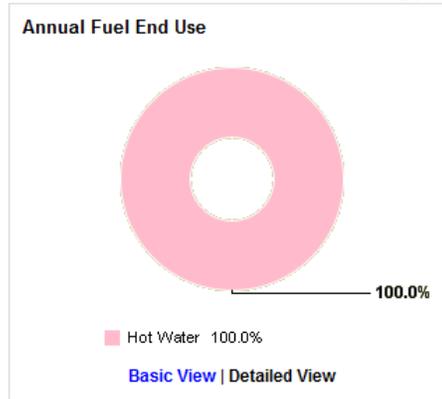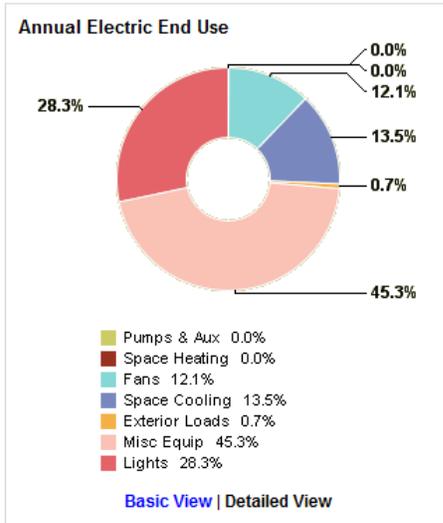

Potential Energy Savings Beta

All Analyzed Building Features


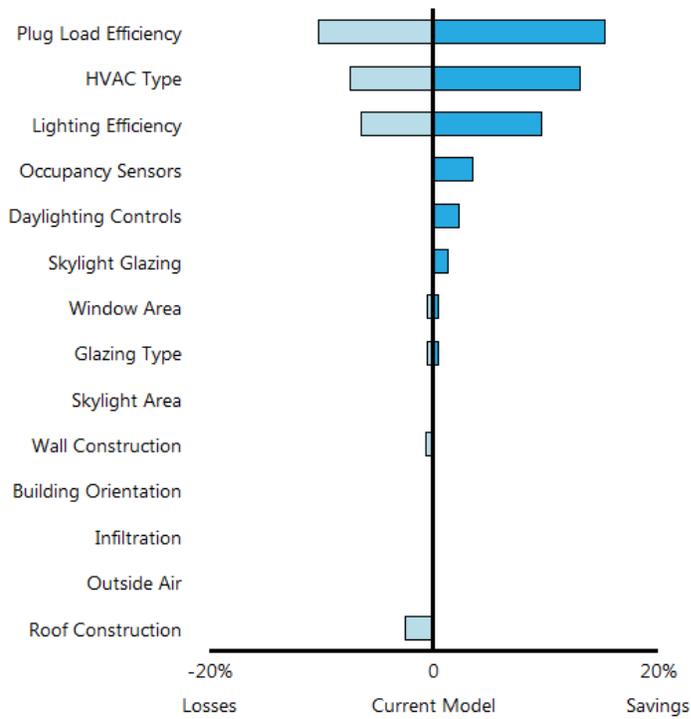


Potential Energy Savings/Losses

Project: PH_1100_V_Office_12_5
 Location: Port Hueneme, CA United States
 Base Run: PH_1100_Vasari_Office Only_12_5.xml
 Date: 4/26/2013 2:18 PM




Portsmouth 373-Modeled End Use Breakdowns and Potential Energy Savings Charts

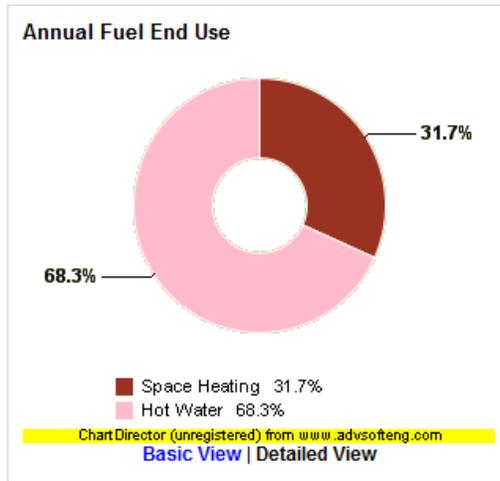
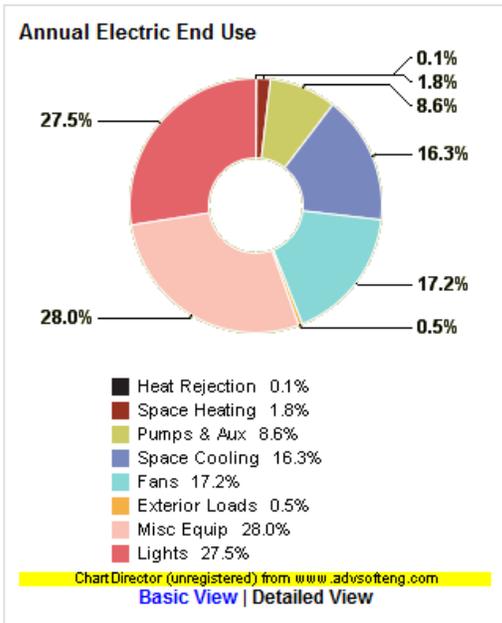


Potential Energy Savings Beta

All Analyzed Building Features

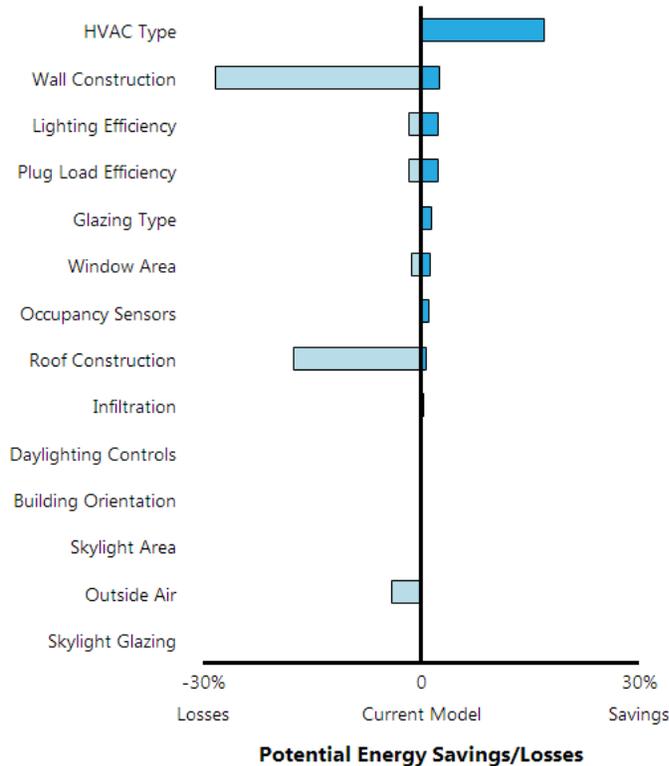


Seymour 3650-Modeled End Use Breakdowns and Potential Energy Savings Charts

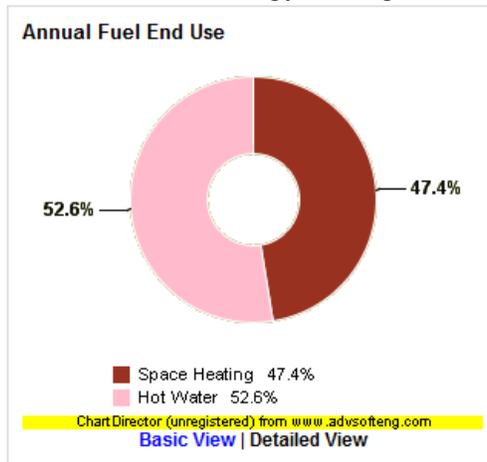
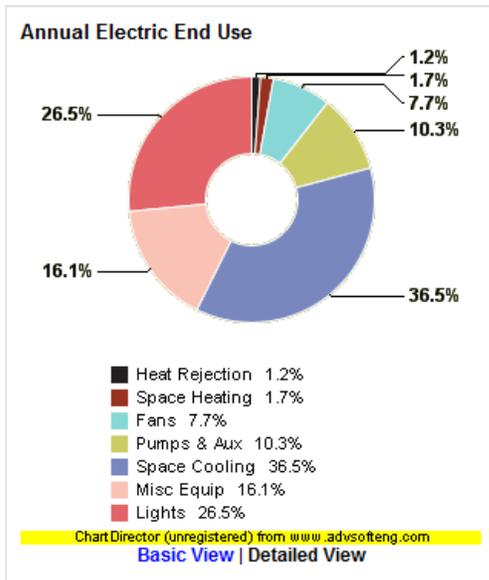


Potential Energy Savings Beta

All Analyzed Building Features

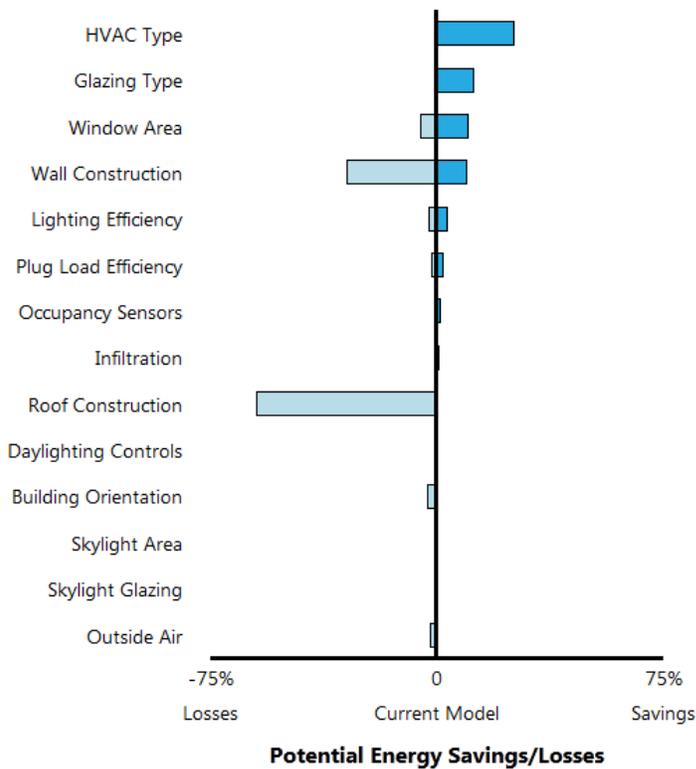


Seymour 4103-Modeled End Use Breakdowns and Potential Energy Savings Charts


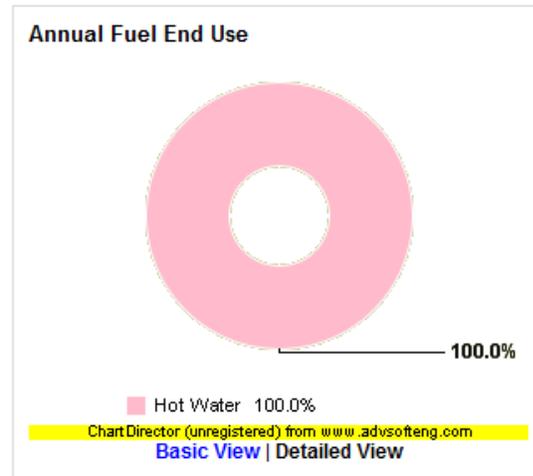
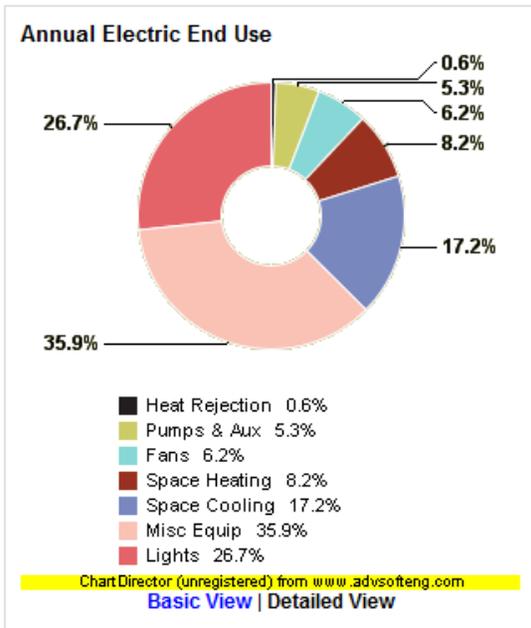


Potential Energy Savings Beta




All Analyzed Building Features

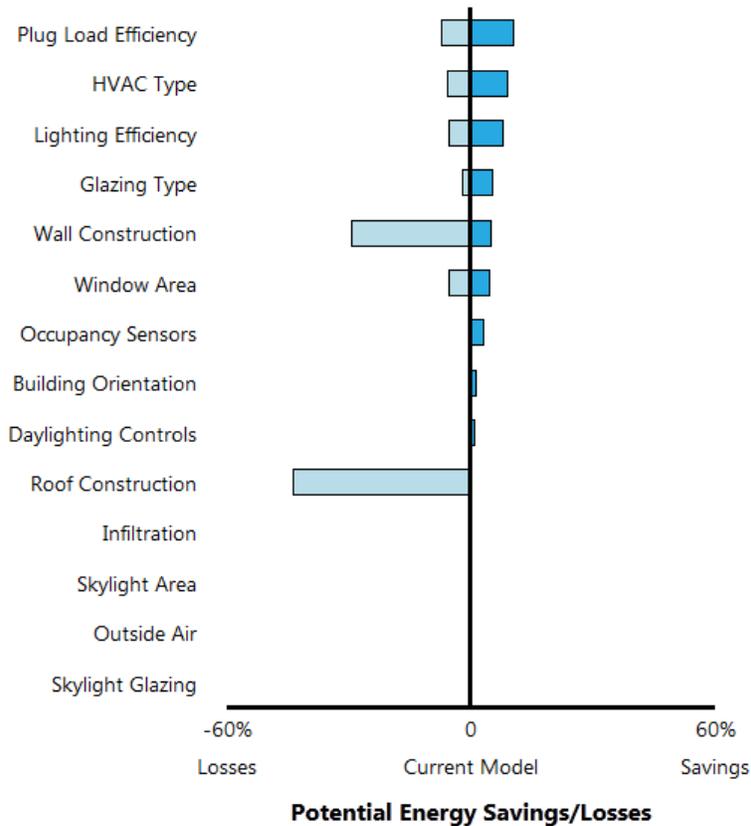



Seymour 4601-Modeled End Use Breakdowns and Potential Energy Savings Charts

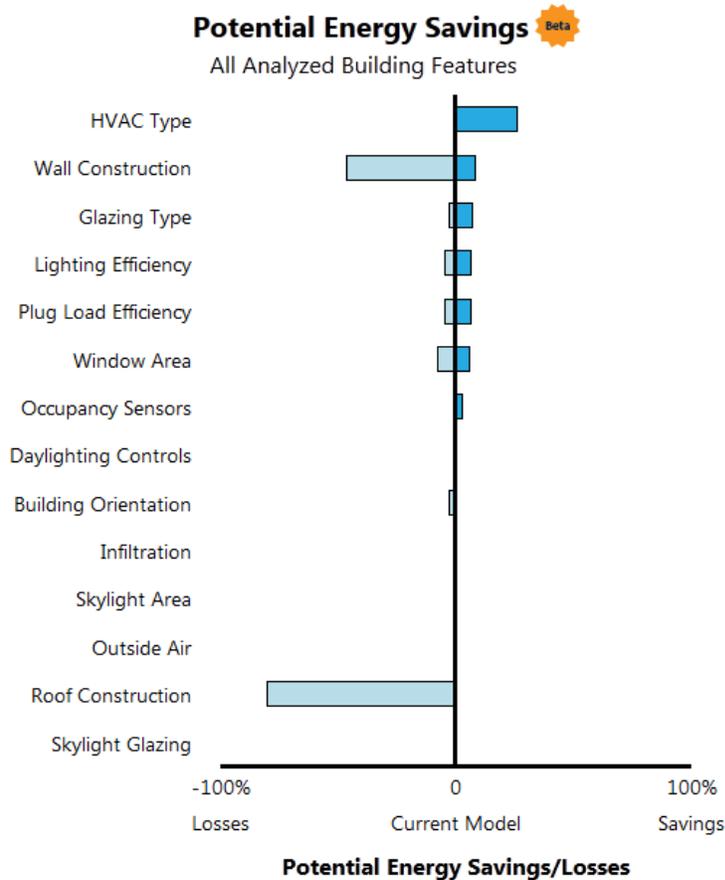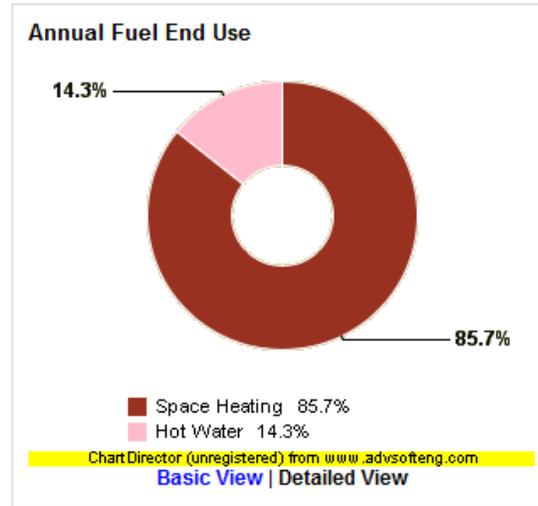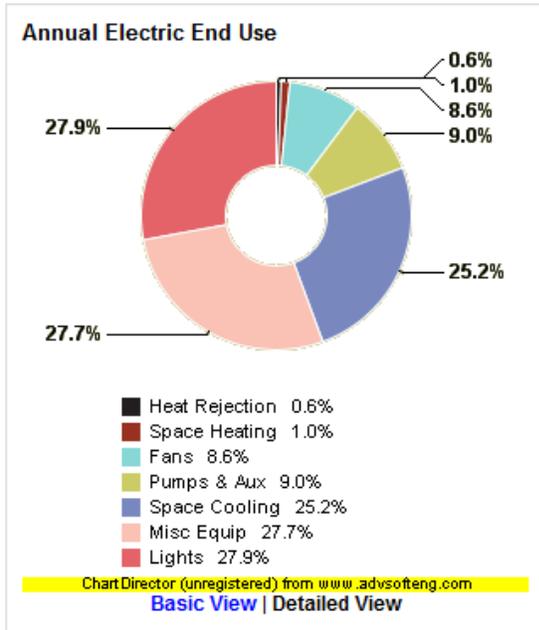

Building 4421-Modeled End Use Breakdowns and Potential Energy Savings Charts

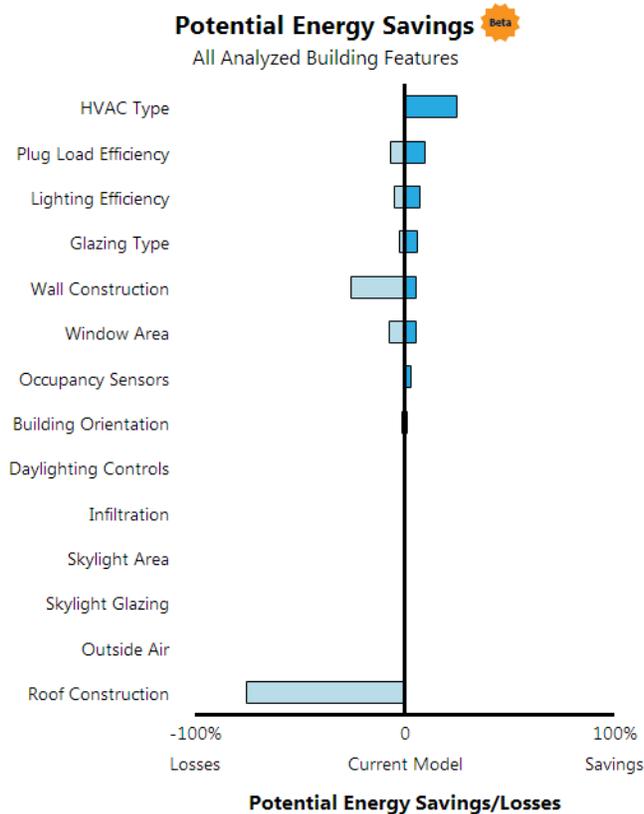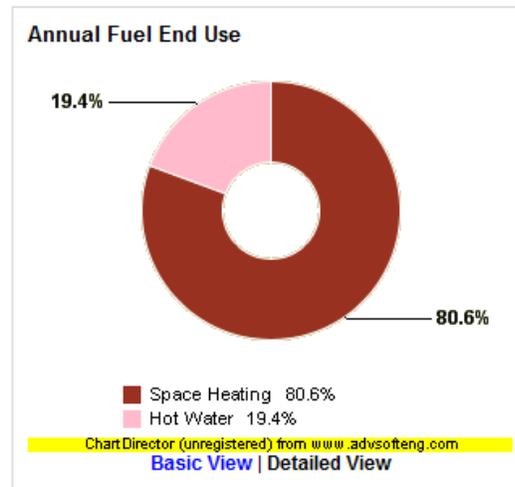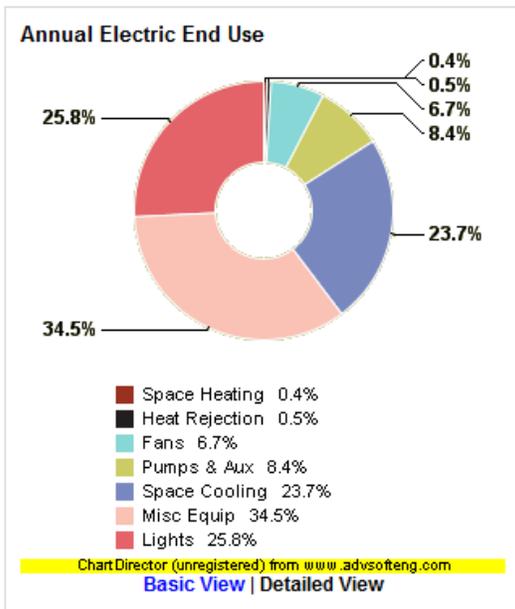

Seymour 4537-Modeled End Use Breakdowns and Potential Energy Savings Charts

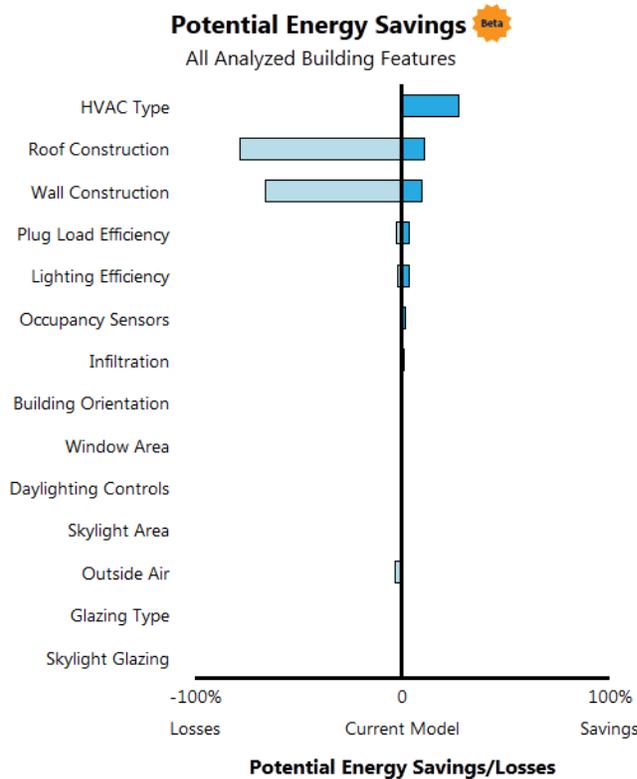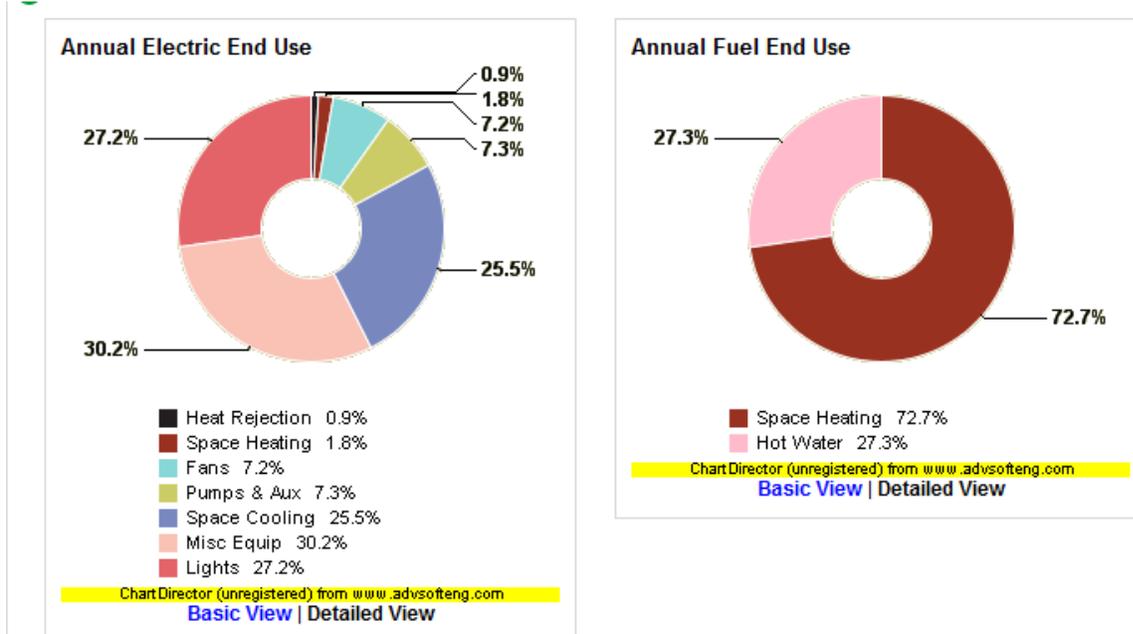

Appendix F: Building Feature Design Options within Automatic PES Analysis

(from Autodesk Technical Reference Material for the PES Beta on ADN: *Potential Energy Savings Chart– Technical Details* (Autodesk, 2013))

Definition of Building Feature Design Options

When defining the building type and project location in the [Energy Settings](#) dialog, a template is automatically selected from Green Building Studio and applied to the energy analytical model. This template contains the definitions of multiple variations of building feature design options that will be applied when generating simulation data for the Potential Energy Savings Analysis chart.

The specific set of building feature design options applied to the building is driven by two main characteristics of the building model: building type and location. Building size and height are then used to refine the selection of appropriate HVAC and construction systems.

Building Feature Design Options

HVAC Type

From the system types typical for the building type and size, a low performing system, relatively code compliant system, and very high-performing system were analyzed. Find the building type, climate, size and height in the tables below to see the specific systems analyzed for the building.

Selected HVAC Types for Building Type: Commercial Buildings, Large, all ASHRAE climate zones

| Building Type | Design Alt | Description |
|------------------------------|------------|---|
| Commercial Buildings - Large | HVC_5 | Chiller 5.96 COP, Boilers 84.5 thermal efficiency and room level 4-pipe fan coil units. |
| | HVC_6 | Chiller 5.96 COP with electric baseboards and/or reheat and variable volume central air handlers |
| | HVC_5 | Chiller 5.96 COP, Boilers 84.5 thermal efficiency and room level 4-pipe fan coil units. |
| | HVC_9 | Chiller 5.96 COP, Boilers 84.5 thermal efficiency and room level 2-pipe fan coil units. |
| | HVC_28 | More than 300 ton water-cooled centrifugal chiller 0.47 kW/ton, 86% boiler, premium efficiency with reheat, VAV fan control, VSD pumping, |
| | HVC_27 | 150-300 ton water-cooled centrifugal chiller 0.50 kW/ton, 86% boiler, premium efficiency with reheat, VAV fan control, VSD pumping,. |

| | | |
|--|--------|--|
| | HVC_31 | Packaged VAV, HW reheat, underfloor air distribution |
| | HVC_3 | 11.3 EER medium and large packaged VAV with 84.8% boiler heating |
| | HVC_4 | Chiller 5.96 COP, Boilers 84.5 thermal efficiency and variable volume central air handlers |

Note 1: Commercial buildings include Automotive Facility, Convention Center, Courthouse, Dining Bar Lounge Or Leisure, Dining Cafeteria Fast Food, Dining Family, Exercise Center, Fire Station, Gymnasium, Healthcare Clinic, Hospital Or Healthcare, Library, Manufacturing, Motion Picture Theatre, Museum, Office, Penitentiary, Performing Arts Theater, Police Station, Post Office, Religious Building, Retail, School Or University, Sports Arena, Town Hall, Transportation, Warehouse, and Workshop. Conditions for the large building vary by building type.

Selected HVAC Types for Building Type: Commercial Buildings, Small, all ASHRAE climate zones

| Building Type | Design Alt | Description |
|------------------------------|------------|---|
| Commercial Buildings - Small | HVC_22 | Premium Efficiency PTAC systems <15 kBtuh |
| | HVC_10 | 12 SEER/8.3 efficient packaged terminal heat pump (PTAC). Typically used in hotel/motel rooms. |
| | HVC_7 | 14 SEER/8.3 HSPF Small Split Packaged Heat Pump |
| | HVC_8 | Improved Efficiency Split/Packaged Heat Pump System with 12 SEER and 7.7 HSPF and Temp Economizer - Medium Units 5 - 11 ton |
| | HVC_34 | Premium Efficiency Packaged rooftop, <65 kBtu/h, DX cooling SEER 17, 85% AFUE natural gas heating. Premium efficiency on-demand water heater. |
| | HVC_6 | Chiller 5.96 COP with electric baseboards and/or reheat and variable volume central air handlers |
| | HVC_1 | < 5.5 ton packaged or split HVAC units, with gas heat. SEER = 14, AFUE = 0.9 |
| | HVC_2 | 5 - 11 ton packaged or split HVAC units, with gas heat. SEER = 12, AFUE = 0.9 |

Selected HVAC Types for Building Types: Multi-Family Housing, Dormitory, Hotel and Motel, all ASHRAE climate zones

| Building Type | Design Alt | Description |
|-----------------------------------|------------|--|
| Multi-Family Housing, Dorm, Hotel | HVC_10 | 12 SEER/8.3 efficiency packaged terminal heat pump (PTAC). Typically used in hotel/motel rooms. |
| | HVC_6 | Chiller 5.96 COP with electric baseboards and/or reheat and variable volume central air handlers |

| | | |
|--|--------|---|
| | HVC_2 | 5 - 11 ton packaged or split HVAC units, with gas heat. SEER = 12, AFUE = 0.9 |
| | HVC_31 | Packaged VAV, HW reheat, underfloor air distribution |
| | HVC_3 | 11.3 EER medium and large packaged VAV with 84.8% boiler heating |
| | HVC_4 | Chiller 5.96 COP, boilers 84.5 thermal efficiency and variable volume central air handlers |
| | HVC_5 | Chiller 5.96 COP, boilers 84.5 thermal efficiency and room level 4-pipe fan coil units. |
| | HVC_9 | Chiller 5.96 COP, boilers 84.5 thermal efficiency and room level 2-pipe fan coil units. Entire system is in either heating or cooling mode by season, not both. |

Exterior Wall Construction

From the envelope constructions typical for the climate zone and building size, a low performing option, relatively code compliant option and very high-performing option were analyzed. Find the project's ASHRAE climate zone and building type in the tables below to see the specific constructions analyzed for the building.

Selected exterior wall construction per ASHRAE climate zone, all Building Types except for Single Family Housing

| ASHRAE Climate Zone | Exterior Wall Construction (High Rise) | Exterior Wall Construction (Low Rise) |
|---------------------|---|---|
| 1 and 2 | Wall_1 16" O.C. metal frame wall without insulation Wall_4 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. metal frame wall Wall_17 Structurally Insulated Panel (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation | Wall_1 16" O.C. metal frame wall without insulation Wall_7 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall Wall_17 Structurally Insulated Panel (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation |
| 3, 4, 5, and 6 | Wall_1 16" O.C. metal frame wall without insulation Wall_17 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. metal frame wall Wall_17 Structurally Insulated Panel (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation | Wall_1 16" O.C. metal frame wall without insulation Wall_7 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall Wall_17 Structurally Insulated Panel (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation |
| 7 and 8 | Wall_1 16" O.C. metal frame wall | Wall_1 16" O.C. metal frame wall |

| | | |
|--|--|--|
| | Wall_4 without insulation 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. metal frame wall Wall_17 Structurally Insulated Panel 4 (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation | Wall_7 without insulation 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall Wall_17 Structurally Insulated Panel 4 (SIP) Wall 12.25 in (311 mm) thick, 48in o.c., R44 insulation |
|--|--|--|

Note: If a building has more than 3 stories, it is considered a high rise building. Otherwise it is a low rise building.

Selected exterior wall construction per ASHRAE climate zone for Single Family Housing

| ASHRAE Climate Zone | Design Alt | Exterior Wall Construction |
|---------------------|------------|---|
| 1 and 2 | Wall_5 | 16" O.C. wood frame wall without insulation |
| | Wall_7 | 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall |
| | Wall_8 | 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. wood frame wall |
| 3, 4, 5, and 6 | Wall_5 | 16" O.C. wood frame wall without insulation |
| | Wall_7 | 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall |
| | Wall_8 | 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. wood frame wall |
| 7 and 8 | Wall_5 | 16" O.C. wood frame wall without insulation |
| | Wall_7 | 9 inches (R30) of batt or blown-in cavity insulation in 16" O.C. 2x10 wood frame wall |
| | Wall_8 | 12 inches (R38) of batt or blown-in cavity insulation in 16" O.C. wood frame wall |

Glazing Type

From the glazing types typical for the specific climate zone and building size, a low performing option, relatively code compliant option, and very high-performing option were analyzed. Find the project's ASHRAE climate zone and building type in the tables below to see the specific glazing types analyzed for the building.

Selected glazing type per ASHRAE climate zone, all Building Types

| ASHRAE Climate Zone | Design Alt | Window Glazing Type |
|---------------------|------------|--|
| 1 and 2 | GLz_1 | Pyrolitic, high solar heat gain, high visible transmittance (U = 0.76, SHGC = 0.77, Tvis = 0.82) |
| | GLz_4 | High solar heat gain, high visible transmittance (U = 0.35, SHGC = 0.67, Tvis = 0.72) |
| | GLz_2 8 | Insulated Translucent Wall Panel, Ice Blue exterior & White interior (U=0.10, SHGC = 0.06, Tvis = 0.04) |
| 3, 4, 5, and 6 | GLz_1 | Pyrolitic, high solar heat gain, high visible transmittance (U = 0.76, SHGC = 0.77, Tvis = 0.82) |
| | GLz_4 | High solar heat gain, high visible transmittance (U = 0.35, SHGC = 0.67, Tvis = 0.72) |
| | GLz_7 | Low solar heat gain, medium visible transmittance (U = 0.23, SHGC = 0.28, Tvis = 0.41) |
| 7 and 8 | GLz_1 | Pyrolitic, high solar heat gain, high visible transmittance (U = 0.76, SHGC = 0.77, Tvis = 0.82) |
| | GLz_4 | High solar heat gain, high visible transmittance (U = 0.35, SHGC = 0.67, Tvis = 0.72) |
| | GLz_1 3 | Very low heat conductance, used in very cold climates (U = 0.22, SHGC = 0.47, Tvis = 0.64) |

Skylight Glazing

| ASHRAE Climate Zone | Design Alt | Skylight Glazing Type |
|---------------------|---------------|---|
| 1 and 2 | SkyGlz_1 8 | Mid-Range Performance Skylight (U = 0.69, SHGC = 0.49) |
| | SkyGlz_1 9 | High Performance Skylight (U = 0.35, SHGC = 0.27) |
| | SkyGlz_2 9 | Insulated Translucent Roof Panel, Ice Blue exterior & White interior, (U = 0.10, SHGC = 0.07, Tvis = 0.04) |

| | | |
|-------------------|-----------|---|
| 3, 4, 5, and 6 | SkyGlz_18 | Mid-Range Performance Skylight (U = 0.69, SHGC = 0.49) |
| | SkyGlz_19 | High Performance Skylight (U = 0.35, SHGC = 0.27) |
| | SkyGlz_27 | Insulated Translucent Roof Panel, Aqua exterior & White interior, (U = 0.29, SHGC = 0.23, Tvis = 0.20) |
| 7 and 8 | SkyGlz_18 | Mid-Range Performance Skylight (U = 0.69, SHGC = 0.49) |
| | SkyGlz_19 | High Performance Skylight (U = 0.35, SHGC = 0.27) |
| | SkyGlz_29 | Insulated Translucent Roof Panel, Ice Blue exterior & White interior, (U = 0.10, SHGC = 0.07, Tvis = 0.04) |

Roof Construction

From the roof constructions typical for the climate zone and building size, a low performing option, relatively code compliant option and very high-performing option were analyzed. Find the project's ASHRAE climate zone and building type in the tables below to see the specific constructions analyzed for the building.

Selected roof construction per ASHRAE climate zone, all Building Types

| ASHRAE Climate Zone | Design Alt | Roof Construction |
|---------------------|------------|---|
| 1 and 2 | Roof_14 | 4 inches (R15) of batt or blown-in insulation between metal 2x framing members |
| | Roof_15 | 12 inches (R38) of batt or blown-in attic/roof insulation between and over metal 2x framing members |
| | Roof_170 | Cool Roof; R38 continuous insulation over roof deck |
| 3, 4, 5, and 6 | Roof_13 | Metal frame roof without insulation |
| | Roof_15 | 12 inches (R38) of batt or blown-in attic/roof insulation between and over metal 2x framing members |
| | Roof_24 | 18-20 inches (R60) continuous rigid insulation over roof deck |
| 7 and 8 | Roof_14 | 4 inches (R15) of batt or blown-in insulation between metal 2x framing members |
| | Roof_175 | Structurally Insulated Panel (SIP) Roof 10.25 in (260 mm) thick, 48in o.c., R36 insulation |
| | Roof_15 | 12 inches (R38) of batt or blown-in attic/roof insulation between and over metal 2x framing members |

Lighting Efficiency and Plug Load Efficiency

Typically, the lighting power density and equipment power density varies in the baseline model by building use and space type. Multiple variations in the LPD and EPD for the model were analyzed by applying percentage variations to the baseline model submitted. The same variations were applied to all building types, sizes and climate zones.

Selected lighting power density (LPD), all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|--------------|--|
| LtEff_3 | 20% less of the Lighting Power Density (LPD) of the base model |
| LtEff_4 | 30% less of the Lighting Power Density (LPD) of the base model |
| LtEff_1 4 | 20% more of the Lighting Power Density (LPD) of the base model |

Refer to the GBS default table for the default LPD

Selected equipment power density (EPD), all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|------------|---|
| Eqq_3 | 20% less of the Equipment Power Density (EPD) of the base model |
| Eqq_4 | 30% less of the Equipment Power Density (EPD) of the base model |
| Eqq_14 | 20% more of the Equipment Power Density (EPD) of the base model |

Refer to the GBS default (Table A1) for the default EPD

Daylighting Controls and Occupancy Sensors

Includes on/off options for daylighting dimming controls and occupancy lighting controls. Daylighting control: On/Off controls for lighting systems according to daylight availability. When set to On, lighting is controlled by up to 2 daylight sensors per zone placed automatically by Green Building Studio

Daylighting control options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|------------|--------------------------|
| DL_1 | No daylighting control |
| DL_2 | With daylighting control |

Occupancy lighting control: On/Off controls for lighting systems according to occupancy. When set to 'On', lighting is turned off automatically when no occupants are in the space.

Available occupancy lighting control options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|--|
| OS_1 | No lighting control with occupancy sensors |
| OS_2 | With lighting control with occupancy sensors |

Outside Air and Infiltration

Includes options for outside air intake per area and per person, and infiltration rate.
 Outside air intake per person: the flow rate of fresh air intentionally introduced into building.
 Infiltration rate: the unconditioned outdoor air leak into conditioned spaces.

Outside air intake per person options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|--|
| OAp_13 | 10% more of the default outside air per person |
| OAp_14 | 20% more of the default outside air per person |

Refer to the GBS default (Table A1) for the default outside air per person

Infiltration rate options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|---|
| Inf_2 | 25% less of the default infiltration rate |
| Inf_3 | 50% less of the default infiltration rate |

Refer to the GBS default table for the default infiltration rate

Glazing Area and Skylight Area

Window area change options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|---|
| GLa_7 | 50% less of the window area of the base model |
| GLa_6 | 50% more of the window area of the base model |

Skylight area change options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|---|
| Skla_7 | 50% less of the skylight area of the base model |
| Skla_6 | 50% more of the skylight area of the base model |

Building Orientation

Building orientation options, all Building Types and all ASHRAE climate zones

| Design Alt | Description |
|-------------------|--|
| Ornt_3 | 30 degree clockwise rotation (+30°) of the base model |
| Ornt_5 | 60 degree clockwise rotation (+60°) of the base model |
| Ornt_7 | 90 degree clockwise rotation (+90°) of the base model |
| Ornt_9 | 120 degree clockwise rotation (+120°) of the base model |
| Ornt_11 | 150 degree clockwise rotation (+150°) of the base model |
| Ornt_13 | 180 degree clockwise rotation (+180°) of the base model |
| Ornt_23 | 30 degree counterclockwise rotation (-30°) of the base model |
| Ornt_21 | 60 degree counterclockwise rotation (-60°) of the base model |
| Ornt_19 | 90 degree counterclockwise rotation (-90°) of the base model |
| Ornt_17 | 120 degree counterclockwise rotation (-120°) of the base model |
| Ornt_15 | 150 degree counterclockwise rotation (-150°) of the base model |

GBS defaults for EPD, LPD, outside air flow per person and infiltration rate

| GBS Building Type | EPD (W/ ft²) | LPD (W/ ft²) | Outside Air Flow/Person (cfm/person) | Outside Air Flow/Area (cfm/ ft²) | Infiltration Flow (ACH) |
|---------------------------------|--|--|---|--|------------------------------------|
| Automotive Facility | 1.00 | 0.90 | N/A | 1.5 | 0.25 |
| Convention Center | 0.96 | 1.20 | 6.57 | 0.2 | 0.10 |
| Courthouse | 1.00 | 1.20 | 6.14 | 0.2 | 0.10 |
| Dining Bar Lounge Or Leisure | 0.79 | 1.30 | 9.96 | 0.2 | 0.25 |
| Dining Cafeteria Fast Food | 0.79 | 1.40 | 9.96 | 0.2 | 0.25 |
| Dining Family | 0.79 | 1.60 | 10.81 | 0.2 | 0.10 |
| Dormitory | 1.00 | 1.01 | 8.48 | 0.2 | 0.25 |
| Exercise Center | 1.00 | 1.01 | 22.88 | 0.2 | 0.25 |
| Fire Station | 1.00 | 1.01 | 18.01 | 0.2 | 0.10 |
| Gymnasium | 1.00 | 1.00 | 27.55 | 0.2 | 0.10 |
| Healthcare Clinic | 1.18 | 1.01 | 16.95 | 0.2 | 0.10 |
| Hospital Or Healthcare | 1.18 | 1.20 | 27.55 | 0.2 | 0.10 |
| Hotel | 0.50 | 1.01 | 11.65 | 0.2 | 0.10 |
| Library | 1.00 | 1.30 | 18.01 | 0.2 | 0.10 |
| Manufacturing | 1.00 | 1.30 | 16.95 | 0.2 | 0.10 |
| Motel | 0.50 | 1.01 | 11.65 | 0.2 | 0.25 |
| Motion Picture Theatre | 0.54 | 1.20 | 5.72 | 0.2 | 0.10 |
| Multi Family | 1.00 | 0.70 | N/A | 0.06 | 0.25 |
| Museum | 1.00 | 1.10 | 9.75 | 0.2 | 0.10 |
| Office | 1.34 | 1.01 | 18.01 | 0.2 | 0.10 |
| Parking Garage | 0.30 | 0.30 | N/A | 1.5 | 5.00 |
| Penitentiary | 1.00 | 1.01 | 10.38 | 0.2 | 0.25 |
| Performing Arts Theater | 0.54 | 1.60 | 11.44 | 0.2 | 0.25 |
| Police Station | 1.00 | 1.01 | 10.38 | 0.2 | 0.10 |
| Post Office | 1.00 | 1.10 | 18.01 | 0.2 | 0.10 |
| Religious Building | 0.96 | 1.30 | 5.93 | 0.2 | 0.10 |
| Retail | 0.94 | 1.50 | 16.53 | 0.2 | 0.10 |
| School Or University | 1.00 | 1.20 | 14.20 | 0.2 | 0.25 |
| Single Family | 0.43 | 0.45 | N/A | 0.06 | 0.50 |
| Sports Arena | 1.00 | 1.10 | 8.48 | 0.2 | 0.10 |
| Town Hall | 1.00 | 1.10 | 6.57 | 0.2 | 0.10 |
| Transportation | 1.00 | 1.01 | 8.69 | 0.2 | 0.10 |
| Warehouse | 0.43 | 0.80 | N/A | 0.06 | 0.10 |
| Workshop | 1.00 | 1.40 | 20.13 | 0.2 | 0.10 |

Note: When outside airflow per person is N/A, outside airflow per area is set to default.